



EME149A-20  
EME149A-60  
EME149D-20  
EME149D-60

ServSensor V4E Lite with 20 or 60 VAC or VDC Dry Contacts

**Use this intelligent environmental monitoring device to identify problems before they disrupt your equipment.**

Features an embedded Web server and Linux operating system.



**Contact  
Information**

Order toll-free in the U.S. or for FREE 24/7 technical support: Call 877-877-BBOX  
(outside U.S. call 724-746-5500)  
[www.blackbox.com](http://www.blackbox.com) • [info@blackbox.com](mailto:info@blackbox.com)

## Trademarks Used in this Manual

---

### Trademarks Used in this Manual

Black Box and the Double Diamond logo are registered trademarks of BB Technologies, Inc.

Bluetooth is a registered trademark of Bluetooth Sig, Inc.

Unicenter is a registered trademark of Computer Associates Think, Inc.

SiteScope is a registered trademark of Freshwater Software, Inc.

HP and OpenView are registered trademarks of Hewlett-Packard Company.

IBM and Tivoli are registered trademarks of International Business Machines Corporation.

WhatsUp is a registered trademark of Ipswitch, Inc.

Linux is a registered trademark of Linus Torvalds.

MS-DOS is a registered trademark of Microsoft Corporation.

Denika and WebNM are registered trademarks of Plixer International, Inc.

Big Brother is a registered trademark of Quest Software, Inc.

MRTG is a registered trademark of Rand Investments, Inc.

Modbus is a registered trademark of Schneider Automation, Inc.

Somix is a registered trademark of Somix Technologies, Inc.

Any other trademarks mentioned in this manual are acknowledged to be the property of the trademark owners.

We're here to help! If you have any questions about your application or our products, contact Black Box Tech Support at **877-877-2269** or go to **blackbox.com** and click on "Talk to Black Box." You'll be live with one of our technical experts in less than 60 seconds.



### Federal Communications Commission and Industry Canada Radio Frequency Interference Statements

This equipment generates, uses, and can radiate radio-frequency energy, and if not installed and used properly, that is, in strict accordance with the manufacturer's instructions, may cause interference to radio communication. It has been tested and found to comply with the limits for a Class A computing device in accordance with the specifications in Subpart B of Part 15 of FCC rules, which are designed to provide reasonable protection against such interference when the equipment is operated in a commercial environment. Operation of this equipment in a residential area is likely to cause interference, in which case the user at his own expense will be required to take whatever measures may be necessary to correct the interference.

Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

This digital apparatus does not exceed the Class A limits for radio noise emission from digital apparatus set out in the Radio Interference Regulation of Industry Canada.

Le présent appareil numérique n'émet pas de bruits radioélectriques dépassant les limites applicables aux appareils numériques de la classe A prescrites dans le Règlement sur le brouillage radioélectrique publié par Industrie Canada.

## Instrucciones de Seguridad (Normas Oficiales Mexicanas Electrical Safety Statement)

1. Todas las instrucciones de seguridad y operación deberán ser leídas antes de que el aparato eléctrico sea operado.
2. Las instrucciones de seguridad y operación deberán ser guardadas para referencia futura.
3. Todas las advertencias en el aparato eléctrico y en sus instrucciones de operación deben ser respetadas.
4. Todas las instrucciones de operación y uso deben ser seguidas.
5. El aparato eléctrico no deberá ser usado cerca del agua—por ejemplo, cerca de la tina de baño, lavabo, sótano mojado o cerca de una alberca, etc.
6. El aparato eléctrico debe ser usado únicamente con carritos o pedestales que sean recomendados por el fabricante.
7. El aparato eléctrico debe ser montado a la pared o al techo sólo como sea recomendado por el fabricante.
8. Servicio—El usuario no debe intentar dar servicio al equipo eléctrico más allá de lo descrito en las instrucciones de operación. Todo otro servicio deberá ser referido a personal de servicio calificado.
9. El aparato eléctrico debe ser situado de tal manera que su posición no interfiera su uso. La colocación del aparato eléctrico sobre una cama, sofá, alfombra o superficie similar puede bloquea la ventilación, no se debe colocar en libreros o gabinetes que impidan el flujo de aire por los orificios de ventilación.
10. El equipo eléctrico debe ser situado fuera del alcance de fuentes de calor como radiadores, registros de calor, estufas u otros aparatos (incluyendo amplificadores) que producen calor.
11. El aparato eléctrico deberá ser conectado a una fuente de poder sólo del tipo descrito en el instructivo de operación, o como se indique en el aparato.
12. Precaución debe ser tomada de tal manera que la tierra física y la polarización del equipo no sea eliminada.
13. Los cables de la fuente de poder deben ser guiados de tal manera que no sean pisados ni pellizcados por objetos colocados sobre o contra ellos, poniendo particular atención a los contactos y receptáculos donde salen del aparato.
14. El equipo eléctrico debe ser limpiado únicamente de acuerdo a las recomendaciones del fabricante.
15. En caso de existir, una antena externa deberá ser localizada lejos de las líneas de energía.
16. El cable de corriente deberá ser desconectado del cuando el equipo no sea usado por un largo periodo de tiempo.
17. Cuidado debe ser tomado de tal manera que objetos líquidos no sean derramados sobre la cubierta u orificios de ventilación.
18. Servicio por personal calificado deberá ser provisto cuando:
  - A: El cable de poder o el contacto ha sido dañado; u
  - B: Objetos han caído o líquido ha sido derramado dentro del aparato; o
  - C: El aparato ha sido expuesto a la lluvia; o
  - D: El aparato parece no operar normalmente o muestra un cambio en su desempeño; o
  - E: El aparato ha sido tirado o su cubierta ha sido dañada.

## Table of Contents

1. Specifications .....	6
2. Overview .....	7
2.1 Introduction.....	7
2.2 What's Included.....	7
2.3 Hardware Description .....	8
2.3.1 EME149A-20 Front Panel .....	8
2.3.2 EME149A-20 Back Panel .....	9
2.3.3 EME149A-60 Front Panel.....	10
2.3.4 EME149A-60 Back Panel .....	11
2.3.5 EME149D-20 Front Panel.....	12
2.3.6 EME149D-20 Back Panel.....	13
2.3.7 EME149D-60 Front Panel.....	14
2.3.8 EME149D-60 Back Panel .....	15
2.4 ServSensor with 20 or 60 Extra Dry Contact Inputs, VAC, or VDC.....	16
2.4.1 Extra Dry Contact Input Practical Applications.....	16
2.4.2 ServSensor with 20 or 60 Extra Dry Contact Web Interface Setup .....	17
3. Installation .....	20
3.1 Setting the IP Address.....	20
3.2 Testing the New IP Address with the "Ping" Command .....	22
3.3 Firmware Upgrade .....	23
3.4 Multiusers and Groups Setup.....	25
3.4.1 Group Setup.....	25
3.4.2 User Setup .....	28
3.5 Services and Security .....	30
3.5.1 Active Services Application (Disabling).....	30
3.5.2 Closing or Changing Ports Disabling HTTP and Enabling HTTPS.....	31
3.5.3 The SNMPv3 SSL Security Feature.....	32
3.5.4 Active Security .....	33
3.5.5 The NAC or Network Access Control Security Feature .....	34
3.6 Setting Up a Sensor.....	34
3.6.1 Notification Thresholds.....	36
3.6.2 Advanced Sensor Settings .....	38
3.7 Using an Internal Mic as a Sound Detection Sensor.....	46
3.8 Expansion Ports .....	49
4. Notifications.....	52
4.1 Adding a Notification.....	52
4.2 SNMP Trap.....	53
4.3 E-mail .....	57
4.4 SMS Notification.....	62
5. Mapping .....	68
5.1 Adding a Map .....	68
5.2 Monitoring via the Map Interface.....	72
6. Filters .....	73
6.1 Sensor Filters .....	73
6.2 Syslog Filters .....	74
7. Making the ServSensor Visible to the Internet .....	77
8. SEC to SEC SNMP Trap Receive .....	78
8.1 Introduction.....	78
8.2 SNMP Trap Sender (A) SEC (10.1.1.225) configuration .....	78
8.3 Getting OIDs for the SNMP Traps.....	84
8.4 SNMP Trap Receiver (B) SEC (10.1.1.137) configuration .....	89
9. SNMP Trap Receiver Controlling IO-digital8 Relay .....	94
10. Frequently Asked Questions (FAQs).....	103
Appendix A: Black Box Open Source Software License Disclaimer .....	111
A. Licensing Information .....	111
B. GNU GPL v2 .....	111
C. GNU GPL v3.....	116
D. GNU LGPL v2.1 .....	124
E. BSD and BSD like Licenses .....	130
F. Other Licenses .....	131

# Chapter 1: Specifications

---

## 1. Specifications

**Audio** — Sampling rate: 8 kHz

**Certifications** — AdRem NetCrunch, Quest Software–Big Brother®, Castle Rock, HP® OpenView®, IBM® Tivoli®, LorientPro, Logalot, MRTG®, SiteScope®, Somix®—WebNM® and Denika®, WhatsUp® Gold, Computer Associates Unicenter® TNG

**Components** — Manufactured using highly integrated, low-power surface-mount technology to ensure long-term reliability; MX25 processor, 128 MB nano flash; internal on-board memory slot

**Configuration** — Via Web browser (HTTP/HTTPS)

**Expandable Modules** — EME1X8: 8-port intelligent sensors module;  
EME1DC16: 16-port dry-contacts modules

**Mean Time Between Failures (MTBF)** — 400,000 hours

**Memory** — 28 MB nano flash

**Network Interface** — (1) 10/100BASE-T Ethernet RJ-45

**Operating System** — Embedded Linux

**Processor** — IM X25 CPU

**Protocols Supported (Client)** — DHCP, DNS, SMTP, (5) NTP, SNMP

**Connectors** — Inputs: (8) RJ-45 for connecting sensors; (4) RJ-45 expansion ports; (1) USB Version 1.1 Type A; (1) 2.5" jack for analog audio; (1) RS-485 2-pin terminal box (used for Modbus®);  
Dry contacts: EME149A-20, EME149D-20: (20);  
EME149A-60, EME149D-60: (60)  
Output: (1) 2.5" jack for analog audio; (1) 2.5" jack for microphone

**Indicators** — EME149A-20, EME149D-20: (42) LEDs: (1) Power LED, (1) Link LED, (40) LEDs (Status and Online) for (20) dry contacts;  
EME149D-20, EME149D-60: (122) LEDs: (1) Power LED, (1) Link LED, (120) LEDs (Status and Online) for (60) dry contacts

**Temperature Tolerance** — Operating: 32 to 131° F (0 to +55° C)

**Humidity** — 20 to 80%, noncondensing

**Power** — Input: 100–240 VAC, 47-63 Hz external power supply;  
Output: 7.0–9 VDC, 3 amps;  
Consumption: 6.15 watts, 0.82 amps

**Size** — EME149A-20, EME149D-20: 1.8"H x 17.08"W x 5.4"D (4.6 x 43.4 x 13.7 cm);  
EME149A-60, EME149D-60: 5"H x 18"W x 3.45"D (12.7 x 45.7 x 8.7 cm)

**Weight** — EME149A-20, EME149D-20: 5.73 lb. (2.6 kg);  
EME149A-60, EME149D-60: 6.83 lb. (3.1 kg)

## 2. Overview

### 2.1 Introduction

Used for environmental monitoring, the ServSensor V4E Lite identifies problems before they lead to business disruptions. This high-speed, accurate, intelligent monitoring device features a completely embedded host and Linux® operating system.

### 2.2 What's Included

Your package should contain the following items. If anything is missing or damaged, contact Black Box Technical Support at 724-746-5500.

- (1) ServSensor V4E Lite with 20 or 60 Dry Contacts VAC or VDC
- (1) 5-ft. crossover cable
- (2) rackmounting brackets with screws
- (1) power adapter
- (1) power cord
- (21) or (61) 2-wire terminal blocks (installed)
- (1) CD-ROM containing this user's manual and Help files

2.3 Hardware Description

Figures 2-1 through 2-8 illustrate the ServSensors’ front and back panels. Tables 2-1 through 2-8 describe their components.

2.3.1 EME149A-20 Front Panel

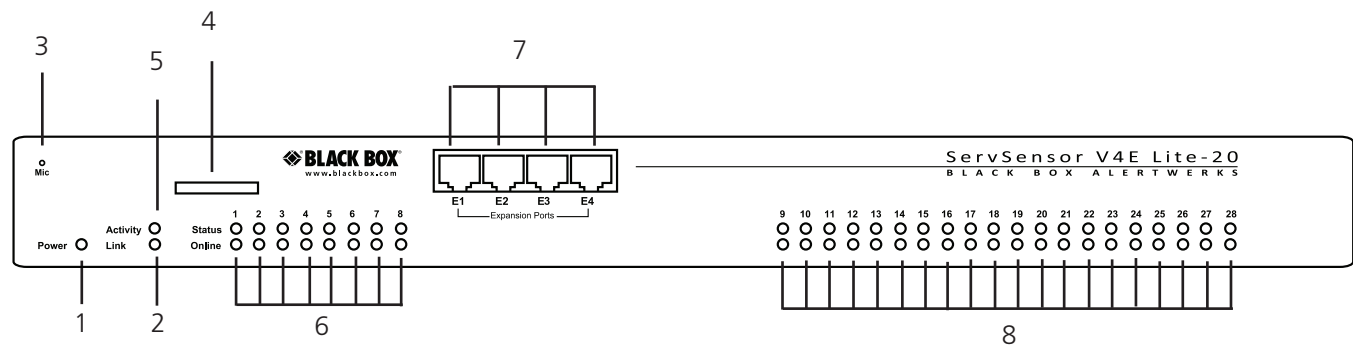


Figure 2-1. Front panel.

Table 2-1. Front-panel components.

Number	Component	Description
1	Power LED	When the unit is powered on, the power LED will be lit continuously. If the power LED is flashing, there is a problem with the CPU. Contact Technical Support at 724-746-5500 or info@blackbox.com.
2	Link LED	The Link LED indicates network connectivity. It lights when a network is connected to the ServSensor V4E Lite.
3	Mic	The mic is a small hole for access to the internal microphone. Use it as a sound sensor (or use an external mic).
4	SD memory card slot	Place your SD card in the removable SD memory card slot. It can store sounds recorded from the internal microphone and also the current firmware of the unit.
5	Activity LED	The Activity LED flashes when network traffic is sent to or received by the ServSensor V4E Lite.
6	Status/Online LEDs 1–8	<p>The Status/Online LEDs are numbered 1–8. They indicate the connectivity status of the sensors connected to each port. You can also use these LEDs to indicate system status during various operations.</p> <p>Additionally, the LEDs can indicate the progress of an upgrade. The red LEDs move from left to right to indicate activity, and all the green LEDs indicate overall progress of the upgrade. When all the red lights are off and the green are on, the upgrade/recovery process is complete.</p> <p>These lights also indicate if the unit is operating in safe mode. This is when the unit loads the operating system (OS) with a minimal set of drivers. If your device enters safe mode after rebooting, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p> <p>The unit may enter recovery mode if a firmware upgrade is incomplete. In this case, the unit displays a continuously lit row of red LEDs. If this happens, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p>

Table 2-1 (Continued). Front panel components.

Number	Component	Description
7	Expansion ports E1–E4	Use the four expansion ports numbered E1–E4 to connect the 8-port expansion module (EME1X8) and/or the 16 dry-contact expansion module (EME1DC16).
8	(40) LED indicators	There are two LEDs (Status and Online) for each dry contact.

### 2.3.2 EME149A-20 Back Panel

Figure 2-2 shows the ServSensor's back panel. Table 2-2 describes its components.

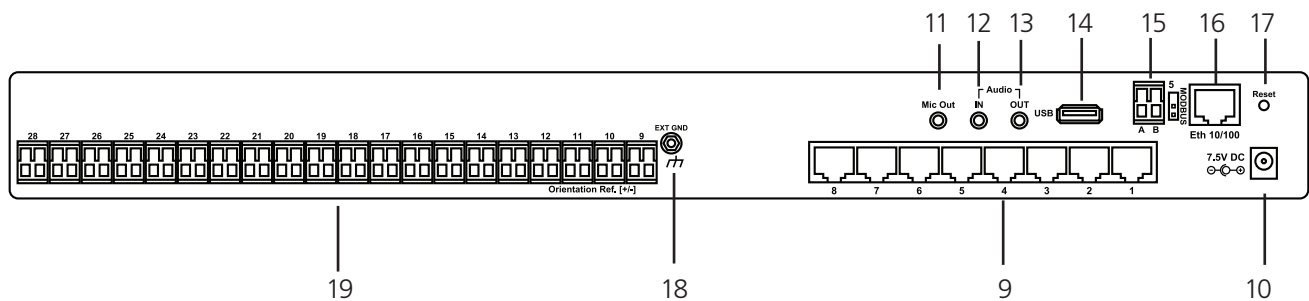


Figure 2-2. Back panel.

Table 2-2. Back panel components.

Number	Component	Description
9	(8) RJ-45 connectors	Use these ports to connect Intelligent Sensors to the ServSensor V4E Lite.
10	Barrel connector	This is a 7.5-VDC plug. Connect a 7.0–9.0-V, 2.5-A power supply (included).
11	Mic out connector	Connect an external microphone for voice modem applications.
12	Audio in	Connect an external microphone.
13	Audio out	Connect the output for external speakers.
14	USB Type A port	Use the USB 1.1 port to connect a USB GBarPRS/GSM compatible modem, a USB Wi-Fi dongle, or a USB Bluetooth® dongle.
15	2-pin terminal block (RS-485 port)	The ServSensor V4E Lite supports Modbus master or slave.
16	RJ-45 10/100 network port	Use this RJ-45 port to connect your ServSensor V4E Lite to the network.
17	Reset	Press this button to reset the ServSensor V4E Lite.
18	EXT GND	Use the EXT. GND connector to externally ground the unit.
19	(20) dry contacts	(20) VAC dry contacts



2.3.3 EME149A-60 Front Panel

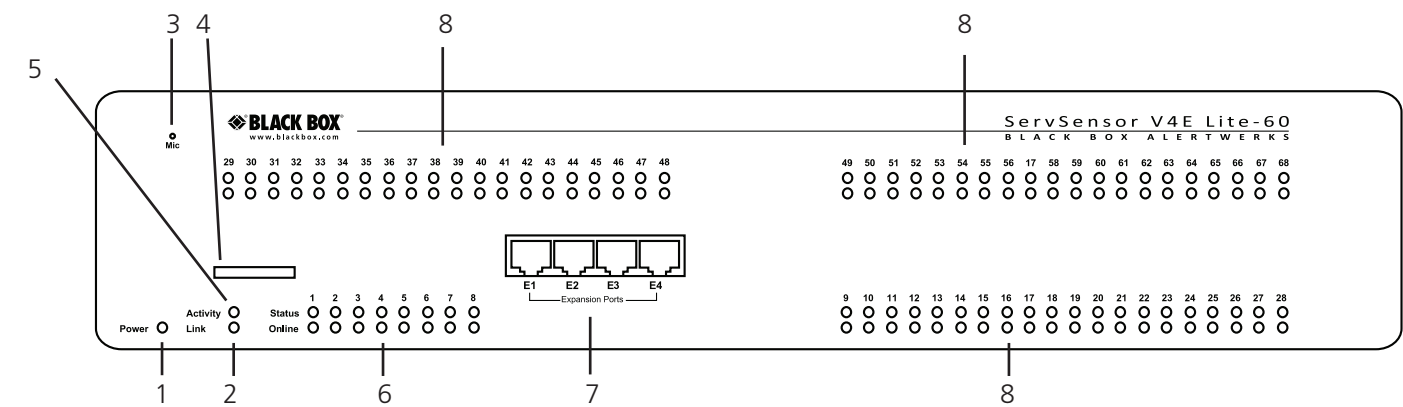


Figure 2-3. EME149A-60 Front panel.

Table 2-3. Front-panel components.

Number	Component	Description
1	Power LED	When the unit is powered on, the power LED will be lit continuously. If the power LED is flashing, there is a problem with the CPU. Contact Technical Support at 724-746-5500 or info@blackbox.com.
2	Link LED	The Link LED indicates network connectivity. It lights when a network is connected to the ServSensor V4E Lite.
3	Mic	The mic is a small hole for access to the internal microphone. Use it as a sound sensor (or use an external mic).
4	SD memory card slot	Place your SD card in the removable SD memory card slot. It can store sounds recorded from the internal microphone and also the current firmware of the unit.
5	Activity LED	The Activity LED flashes when network traffic is sent to or received by the ServSensor V4E Lite.
6	Status/Online LEDs 1–8	<p>The Status/Online LEDs are numbered 1–8. They indicate the connectivity status of the sensors connected to each port. You can also use these LEDs to indicate system status during various operations.</p> <p>Additionally, the LEDs can indicate the progress of an upgrade. The red LEDs move from left to right to indicate activity, and all the green LEDs indicate overall progress of the upgrade. When all the red lights are off and the green are on, the upgrade/recovery process is complete.</p> <p>These lights also indicate if the unit is operating in safe mode. This is when the unit loads the operating system (OS) with a minimal set of drivers. If your device enters safe mode after rebooting, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p> <p>The unit may enter recovery mode if a firmware upgrade is incomplete. In this case, the unit displays a continuously lit row of red LEDs. If this happens, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p>

Table 2-3 (Continued) . Front panel components.

Number	Component	Description
7	Expansion ports E1–E4	Use the four expansion ports numbered E1–E4 to connect the 8-port expansion module (EME1X8) and/or the 16 dry-contact expansion module (EME1DC16).
8	(120) LED indicators	There are two LEDs (Status and Online) for each dry contact.

### 2.3.4 EME149A-60 Back Panel

Figure 2-4 shows the ServSensor's back panel. Table 2-4 describes its components.

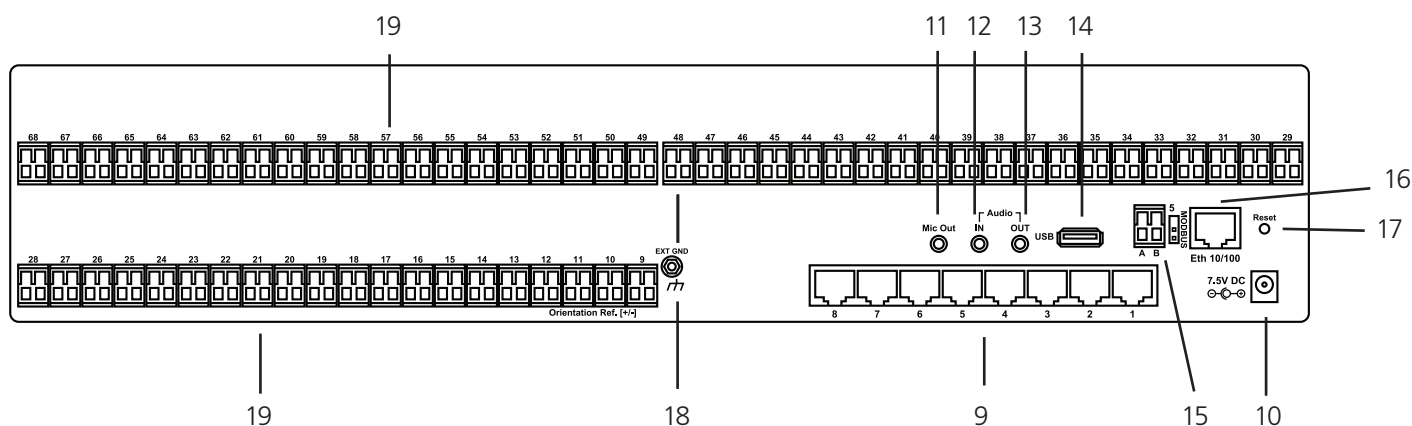


Figure 2-4. EME149A-60 back panel.

Table 2-4. Back panel components.

Number	Component	Description
8	(8) RJ-45 connectors	Use these ports to connect Intelligent Sensors to the ServSensor V4E Lite.
9	Barrel connector	This is a 7.5-VDC plug. Connect a 7.0–9.0-V, 2.5-A power supply (included).
10	Mic out connector	Connect an external microphone for voice modem applications.
11	Audio in	Connect an external microphone.
12	Audio out	Connect the output for external speakers.
13	USB Type A port	Use the USB 1.1 port to connect a USB GBarPRS/GSM compatible modem, a USB Wi-Fi dongle, or a USB Bluetooth® dongle.
14	2-pin terminal block (RS-485 port)	The ServSensor V4E Lite supports Modbus master or slave.
15	RJ-45 10/100 network port	Use this RJ-45 port to connect your ServSensor V4E Lite to the network.
16	Reset	Press this button to reset the ServSensor V4E Lite.
17	EXT GND	Use the EXT. GND connector to externally ground the unit.
18	(60) dry contacts	(60) VAC dry contacts

2.3.5 EME149D-20 Front Panel

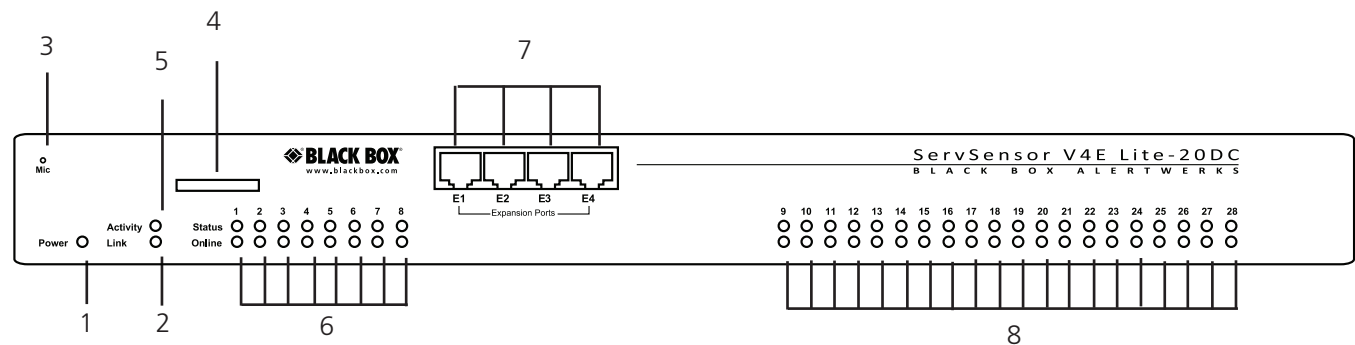


Figure 2-5. Front panel.

Table 2-5. Front-panel components.

Number	Component	Description
1	Power LED	When the unit is powered on, the power LED will be lit continuously. If the power LED is flashing, there is a problem with the CPU. Contact Technical Support at 724-746-5500 or info@blackbox.com.
2	Link LED	The Link LED indicates network connectivity. It lights when a network is connected to the ServSensor V4E Lite.
3	Mic	The mic is a small hole for access to the internal microphone. Use it as a sound sensor (or use an external mic).
4	SD memory card slot	Place your SD card in the removable SD memory card slot. It can store sounds recorded from the internal microphone and also the current firmware of the unit.
5	Activity LED	The Activity LED flashes when network traffic is sent to or received by the ServSensor V4E Lite.
6	Status/Online LEDs 1–8	<p>The Status/Online LEDs are numbered 1–8. They indicate the connectivity status of the sensors connected to each port. You can also use these LEDs to indicate system status during various operations.</p> <p>Additionally, the LEDs can indicate the progress of an upgrade. The red LEDs move from left to right to indicate activity, and all the green LEDs indicate overall progress of the upgrade. When all the red lights are off and the green are on, the upgrade/recovery process is complete.</p> <p>These lights also indicate if the unit is operating in safe mode. This is when the unit loads the operating system (OS) with a minimal set of drivers. If your device enters safe mode after rebooting, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p> <p>The unit may enter recovery mode if a firmware upgrade is incomplete. In this case, the unit displays a continuously lit row of red LEDs. If this happens, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p>

Table 2-5 (Continued). Front-panel components.

Number	Component	Description
7	Expansion ports E1–E4	Use the four expansion ports numbered E1–E4 to connect the 8-port expansion module (EME1X8) and/or the 16 dry-contact expansion module (EME1DC16).
8	(40) LED indicators	There are two LEDs (Status and Online) for each dry contact.

2.3.6 EME149D-20 Back Panel

Figure 2-6 shows the ServSensor’s back panel. Table 2-6 describes its components.

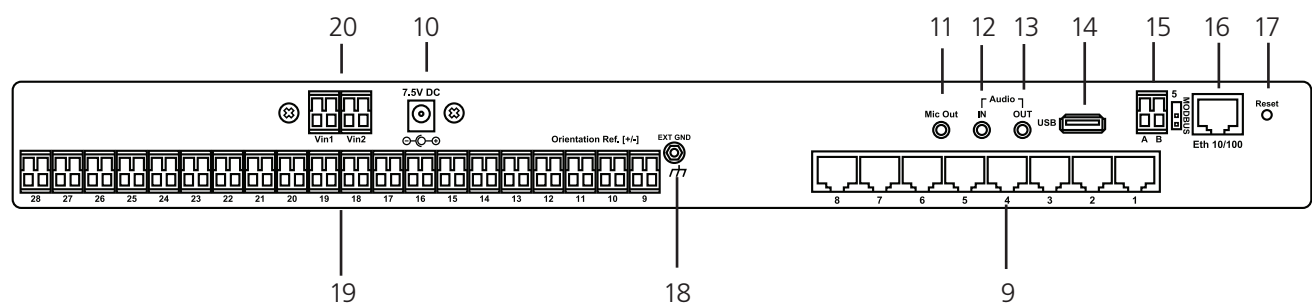


Figure 2-6. EME149D-20 back panel.

Table 2-6. Back-panel components.

Number	Component	Description
9	(8) RJ-45 connectors	Use these ports to connect Intelligent Sensors to the ServSensor V4E Lite.
10	Barrel connector	This is a 7.5-VDC plug. Connect a 7.0–9.0-V, 2.5-A power supply (included).
11	Mic out connector	Connect an external microphone for voice modem applications.
12	Audio in	Connect an external microphone.
13	Audio out	Connect the output for external speakers.
14	USB Type A port	Use the USB 1.1 port to connect a USB GBarPRS/GSM compatible modem, a USB Wi-Fi dongle, or a USB Bluetooth® dongle.
15	2-pin terminal block (RS-485 port)	The ServSensor V4E Lite supports Modbus master or slave.
16	RJ-45 10/100 network port	Use this RJ-45 port to connect your ServSensor V4E Lite to the network.
17	Reset	Press this button to reset the ServSensor V4E Lite.
18	EXT GND	Use the EXT. GND connector to externally ground the unit.
19	(20) dry contacts	(20) VDC dry contacts
20	DC power connector	7.5 VDC power inputs

2.3.7 EME149D-60 Front Panel

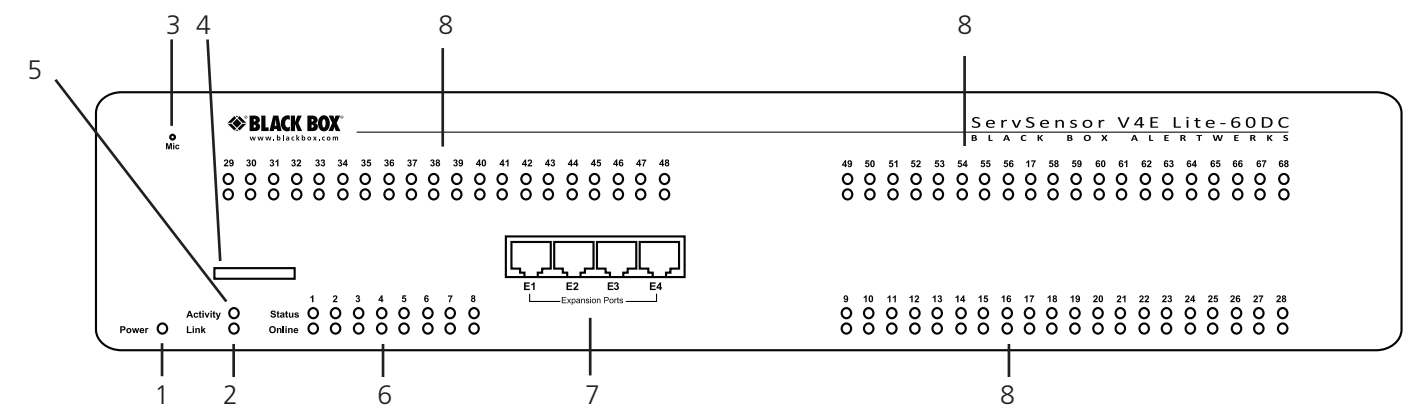


Figure 2-7. Front panel.

Table 2-7. Front-panel components.

Number	Component	Description
1	Power LED	When the unit is powered on, the power LED will be lit continuously. If the power LED is flashing, there is a problem with the CPU. Contact Technical Support at 724-746-5500 or info@blackbox.com.
2	Link LED	The Link LED indicates network connectivity. It lights when a network is connected to the ServSensor V4E Lite.
3	Mic	The mic is a small hole for access to the internal microphone. Use it as a sound sensor (or use an external mic).
4	SD memory card slot	Place your SD card in the removable SD memory card slot. It can store sounds recorded from the internal microphone and also the current firmware of the unit.
5	Activity LED	The Activity LED flashes when network traffic is sent to or received by the ServSensor V4E Lite.
6	Status/Online LEDs 1–8	<p>The Status/Online LEDs are numbered 1–8. They indicate the connectivity status of the sensors connected to each port. You can also use these LEDs to indicate system status during various operations.</p> <p>Additionally, the LEDs can indicate the progress of an upgrade. The red LEDs move from left to right to indicate activity, and all the green LEDs indicate overall progress of the upgrade. When all the red lights are off and the green are on, the upgrade/recovery process is complete.</p> <p>These lights also indicate if the unit is operating in safe mode. This is when the unit loads the operating system (OS) with a minimal set of drivers. If your device enters safe mode after rebooting, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p> <p>The unit may enter recovery mode if a firmware upgrade is incomplete. In this case, the unit displays a continuously lit row of red LEDs. If this happens, contact Black Box Technical Support at 724-746-5500 or info@blackbox.com.</p>

Table 2-7 (Continued). Front-panel components.

Number	Component	Description
7	Expansion ports E1–E4	Use the four expansion ports numbered E1–E4 to connect the 8-port expansion module (EME1X8) and/or the 16 dry-contact expansion module (EME1DC16).
8	(120) LED indicators	There are two LEDs (Status and Online) for each dry contact.

### 2.3.8 EME149D-60 Back Panel

Figure 2-8 shows the ServSensor’s back panel. Table 2-8 describes its components.

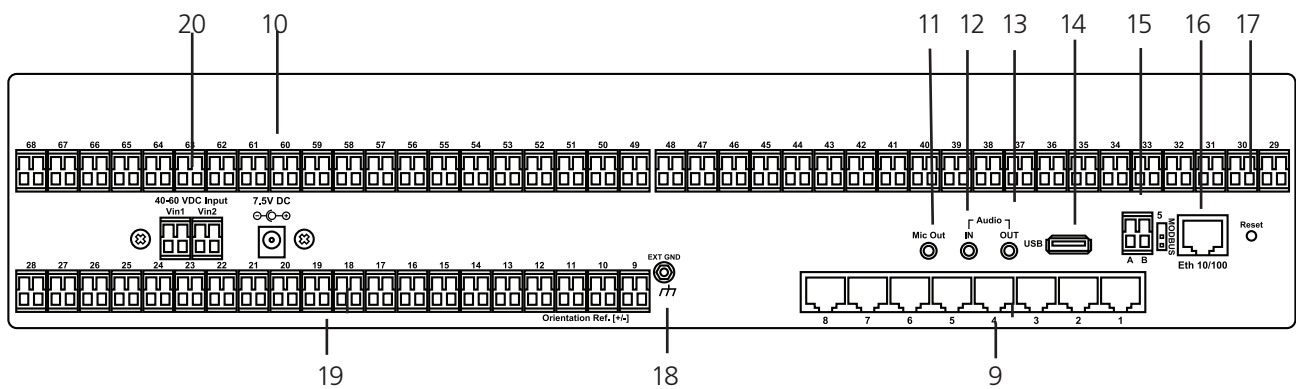


Figure 2-8. EME149D-60 back panel.

Table 2-8. Back-panel components.

Number	Component	Description
9	(8) RJ-45 connectors	Use these ports to connect Intelligent Sensors to the ServSensor V4E Lite.
10	Barrel connector	This is a 7.5-VDC plug. Connect a 7.0–9.0-V, 2.5-A power supply (included).
11	Mic out connector	Connect an external microphone for voice modem applications.
12	Audio in	Connect an external microphone.
13	Audio out	Connect the output for external speakers.
14	USB Type A port	Use the USB 1.1 port to connect a USB GBarPRS/GSM compatible modem, a USB Wi-Fi dongle, or a USB Bluetooth® dongle.
15	2-pin terminal block (RS-485 port)	The ServSensor V4E Lite supports Modbus master or slave.
16	RJ-45 10/100 network port	Use this RJ-45 port to connect your ServSensor V4E Lite to the network.
17	Reset	Press this button to reset the ServSensor V4E Lite.
18	EXT GND	Use the EXT. GND connector to externally ground the unit.
19	(60) dry contacts	(60) VDC dry contacts
20	DC power connector	DC power input

### 2.4 ServSensor with 20 or 60 Extra Dry Contact Inputs, VAC, or VDC

The 20 or 60 extra dry contact inputs on the ServSensor can be configured as inputs only up to 5 Volts in normal operation. In opto-isolation mode they can input up to 30 Volts DC. This will protect these inputs and the unit from high voltages and spikes.

Opto-isolators provide complete electrical separation between the ServSensor and the dry contact. The base units are therefore protected against possible large voltage spikes caused by lightning, for example.

The figure below shows the jumpers (on the dry contact board) set up to provide opto-isolators support.

Refer to the rear panel of the ServSensor above for the other connections on the rear panel, as they are exactly the same in functionality.

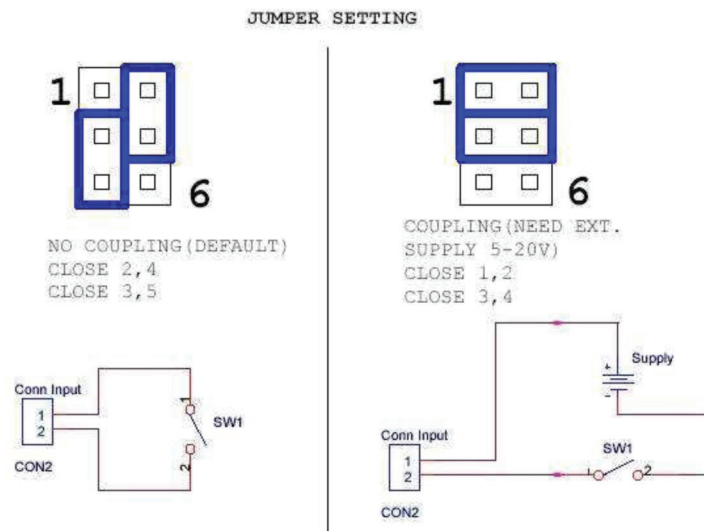


Figure 2-9. Jumper settings.

The OID for the extra dry contact inputs is:- .1.3.6.1.4.1.3854.1.2.2.1.18.1.3.<port>

#### 2.4.1 Extra Dry Contact Input Practical Applications

The extra dry contact inputs can be used to monitor many types of equipment, for example, you can run the connection from warning lights on alarm panels to the dry contact inputs, so that when the warning light on the alarm panel is activated, the dry contact is triggered in the unit's Web interface, thus allowing you to send notifications via emails or SNMP traps.



## 2.4.2 ServSensor with 20 or 60 Extra Dry Contact Web Interface Setup

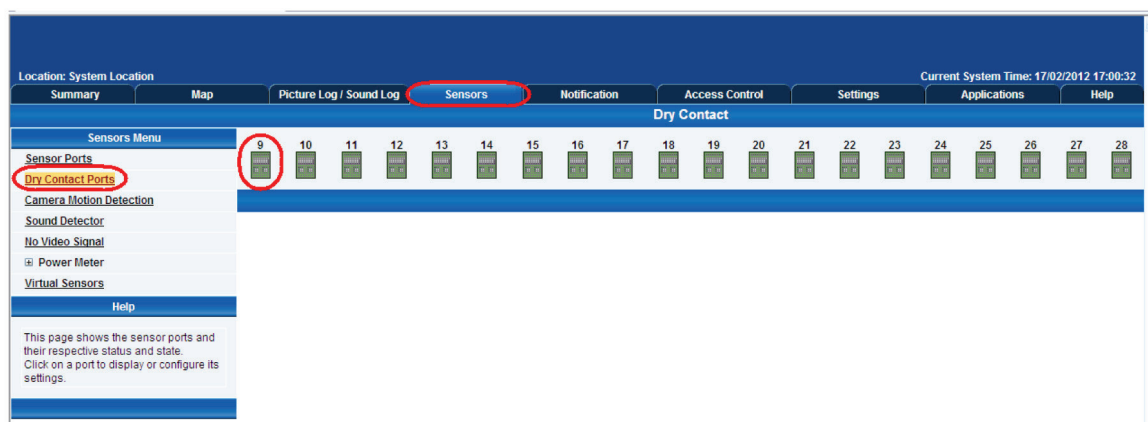


Figure 2-10. Sensors page.

First login to the ServSensor Web interface, then navigate to the Sensors Page, then click on the Dry Contact Ports link in the left hand column. You can now click on the dry contact port to set up that port as shown in the screen shot above.

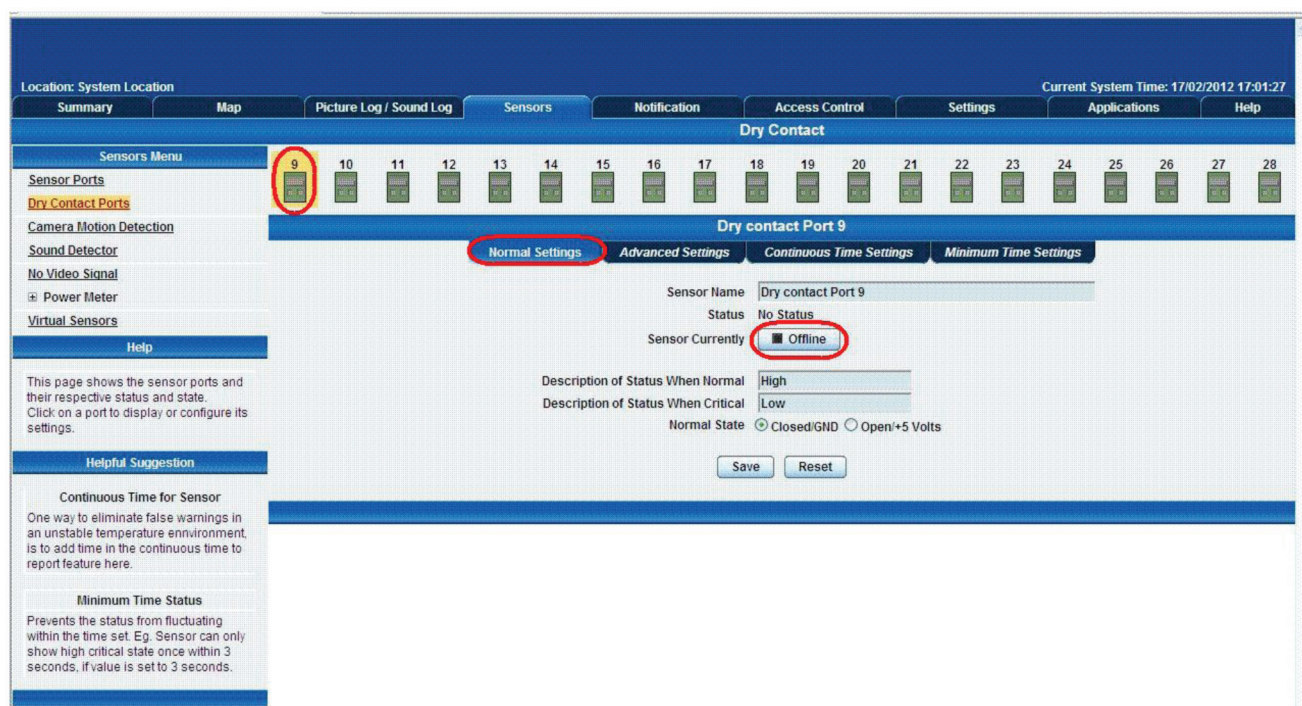


Figure 2-11. Normal settings screen.

In the Normal tab settings we can see that the sensor is currently offline, so to enable the dry contact port we would click on the Offline button.

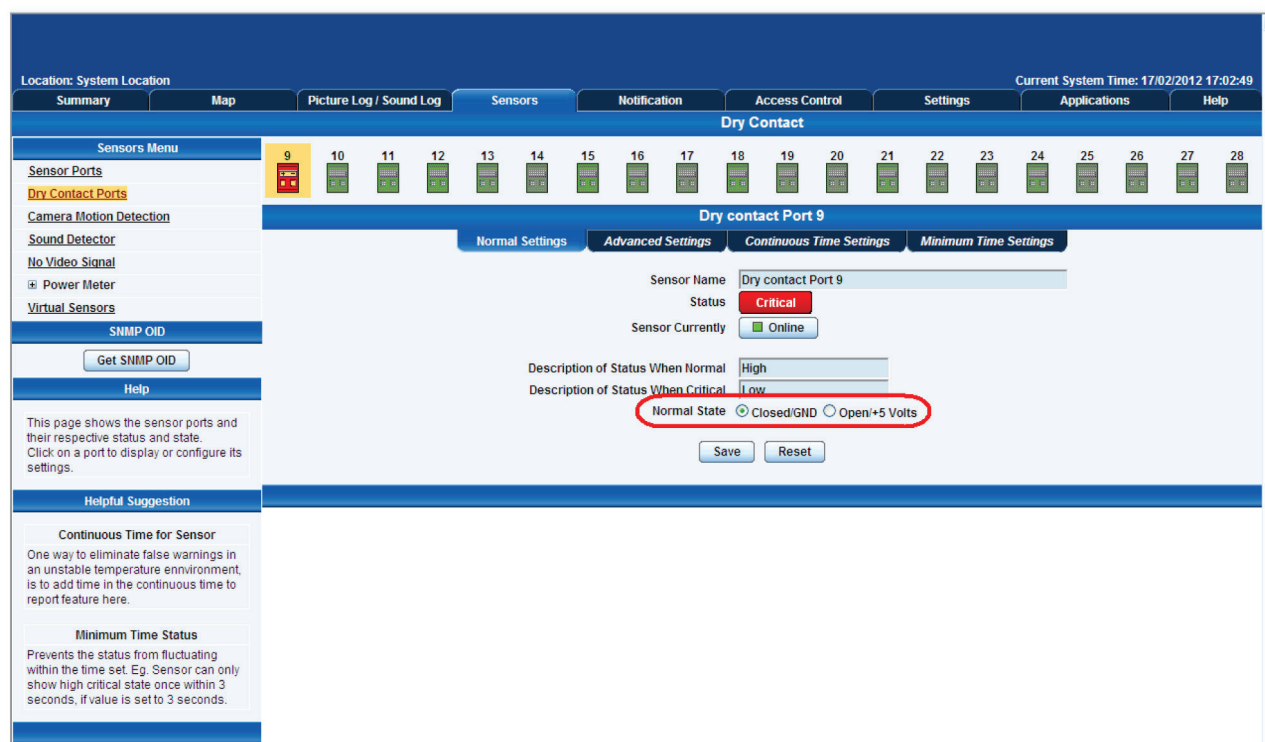


Figure 2-12. Critical status screen.

We can see the dry contact input is now Critical and we can set how we require the Normal State to be as shown above—either in the Closed GND or Open +5VDC. We can also rename our normal and critical state of the input.

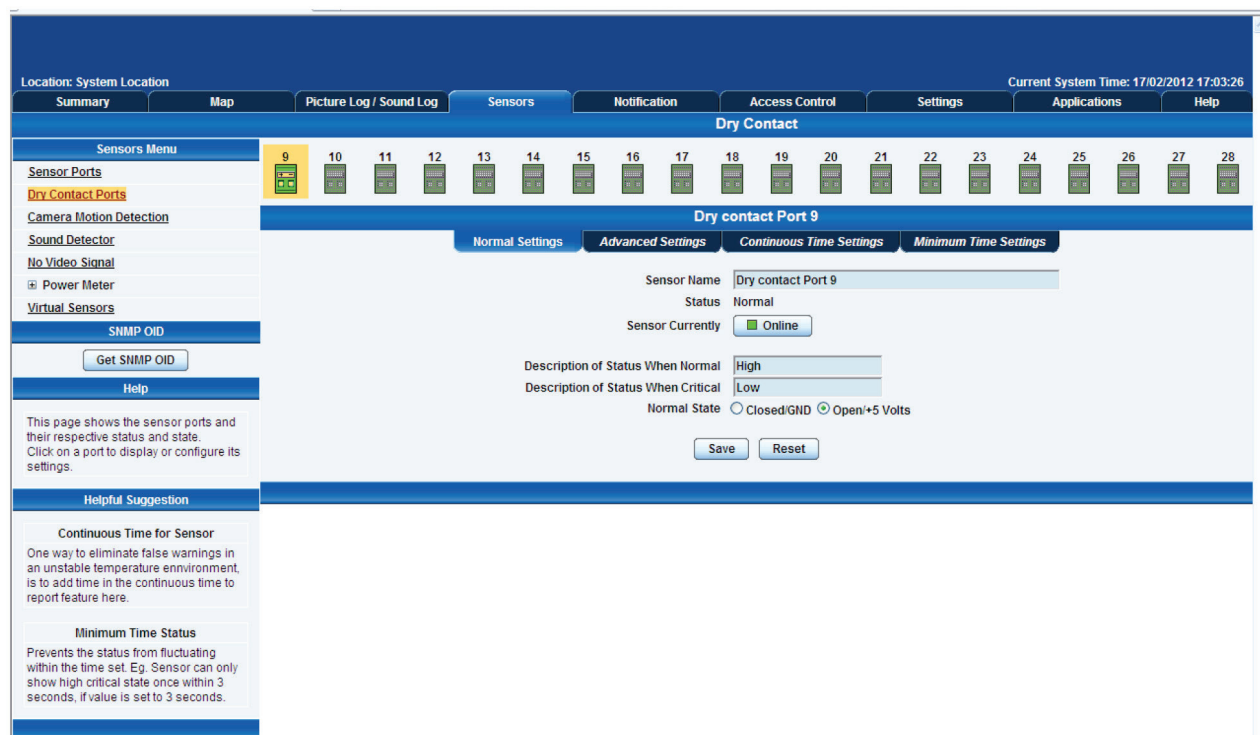


Figure 2-13. Online selected.

We can see that the dry contact input now is in the normal state as shown in the screen shot on the previous page.

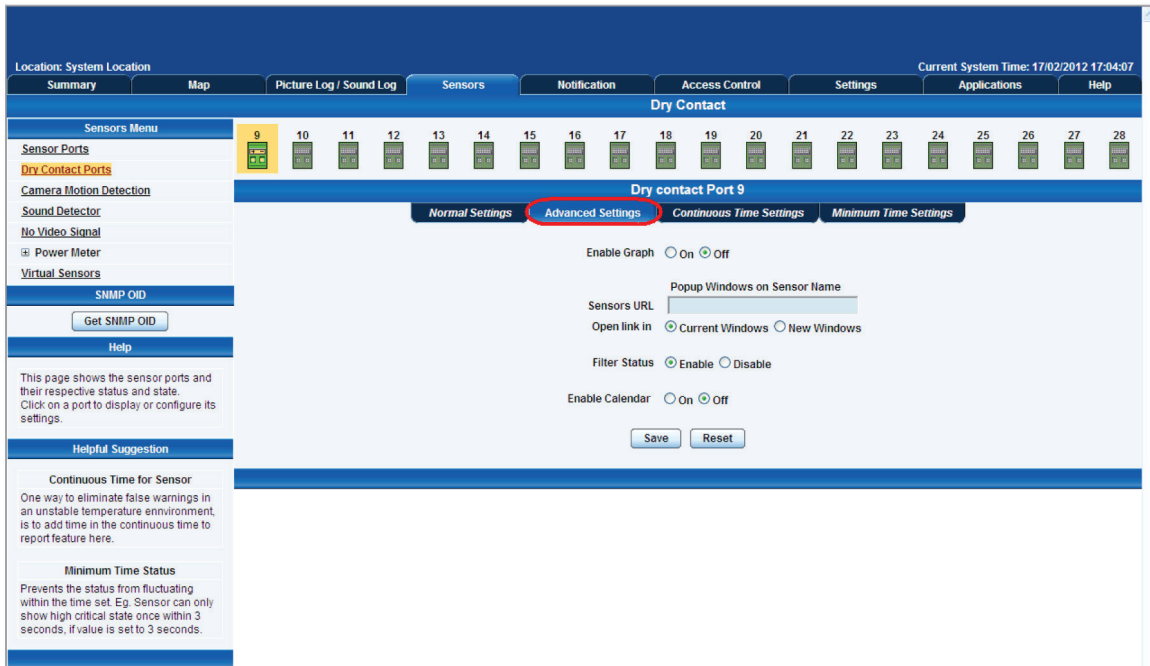


Figure 2-14. Advanced settings screen.

If we click on the Advanced tab, we can set the graphing to “on,” set the sensor URL, set the Filter Status, and enable the Calendar. (More on the Sensor URL and Filter Status in sections 3.6 and 6.1).

## Chapter 3: Installation

### 3. Installation

#### 3.1 Setting Up the IP Address

The ServSensor V4E Lite is shipped with the default IP address of 192.168.0.100. Follow the steps listed below to change this IP address to fit your own network configuration.

Before starting, make sure you have these items:

- (1) RJ-45 male CAT5 crossover cable
- (1) PC with Ethernet card or LAN socket
- (1) Power socket for the unit to connect to

To set up the IP address:

1. Connect the ServSensor V4E Lite via its Ethernet port to your computer's Ethernet port with a CAT5 crossover cable.
2. Open a Web browser and type the default IP address (as in Figure 3-1), then press the Enter key.

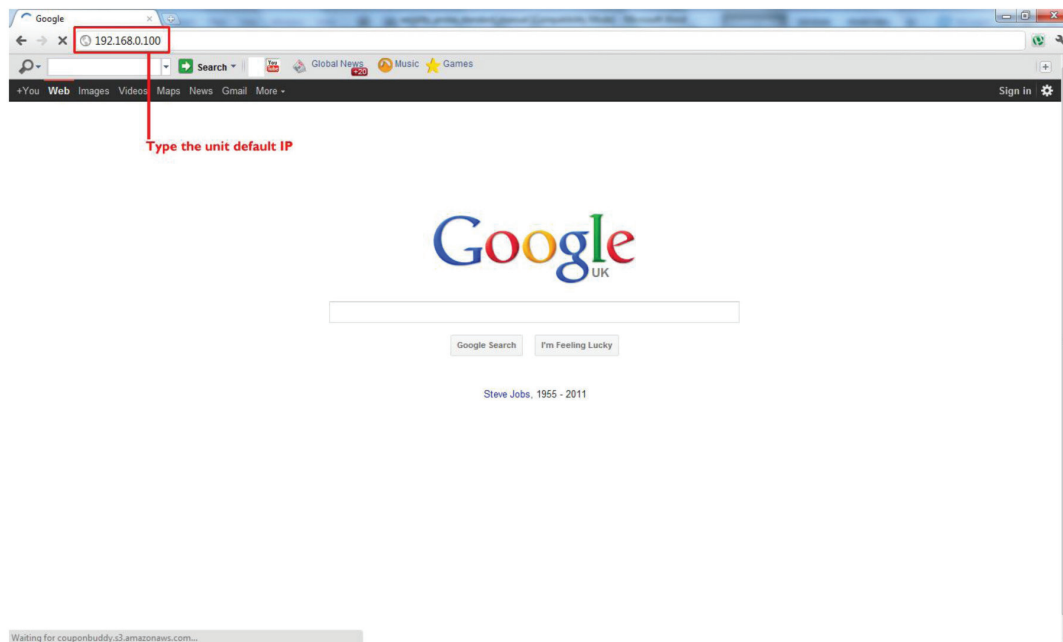


Figure 3-1. Google Web Browser screen.

*NOTE: In some cases, your computer might not be able to connect to this default IP address. In this situation, you will need to change the IP address of your PC. See the instructions above.*

3. After you press the Enter key in Step 2, Figure 3-2 appears. The default password for Admin is "public." Change the password to make your unit secure.



Figure 3-2. User Type/Password screen.

4. Next, the home page will be displayed. It looks similar to the screen shown in Figure 3-3.



Figure 3-3. Settings tab.

5. Click on the "Settings" tab, then click on "Ethernet network" from the list on the left frame of the page. See Figure 3-4.

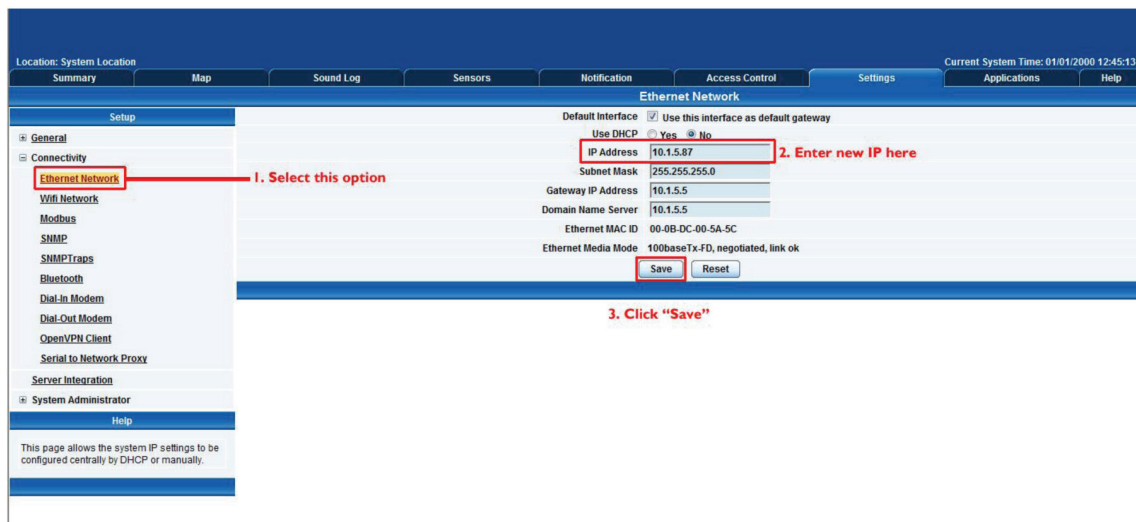


Figure 3-4. Ethernet Network screen.



## Chapter 3: Installation

To change the IP address of the ServSensor V4E Lite:

1. Select Ethernet network.
2. Input the new IP address.
3. Click the "Save" button.

### 3.2 Testing the New IP Address with the "Ping" Command

Once you assign the new IP address, use the "ping" command to test the ServSensor V4E Lite. You can also use this command as a diagnostic tool to check whether your unit is connected to the network. See Figure 3-5.

1. Click "Start."
2. Click "Run."
3. Type "ping (IP address that the user entered)," and press Enter. An example IP address (10.1.5.206) is shown in Figure 3-5.

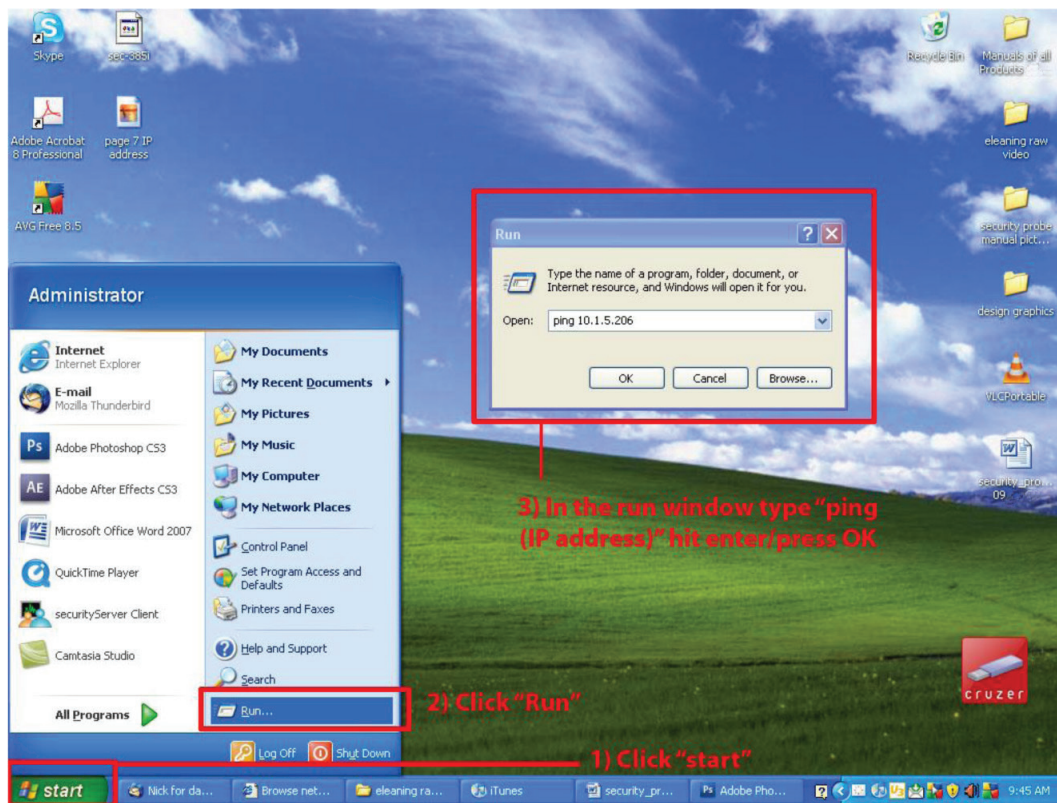


Figure 3-5. Ping Command screen.

4. After you press the "Enter" key, an MS-DOS® prompt window showing the test results appears (see Figure 3-6). If you get a message saying "request timed out," either the IP address is incorrect or a ServSensor V4E Lite is not connected to the network.



Page 23

Make sure you are running the latest firmware. Please contact Black Box Technical Support at 724-746-5500 or [info@blackbox.com](mailto:info@blackbox.com) for the latest firmware.

This tutorial gives you the information you need to upgrade the firmware.

- Log in as administrator.
- Click the “Settings” tab.





## Chapter 3: Installation

1. Click "System Administrator" and then "System Maintenance."
2. Click "Upgrade."

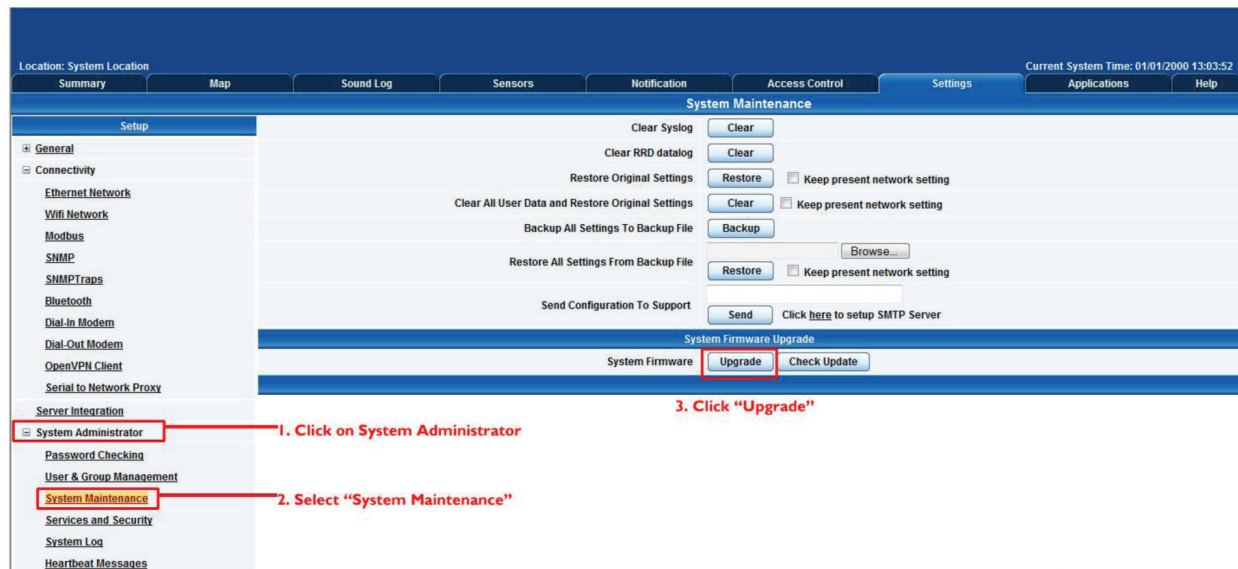


Figure 3-8. System Administrator, System Maintenance screen.

3. The popup screen shown in Figure 3-9 appears.

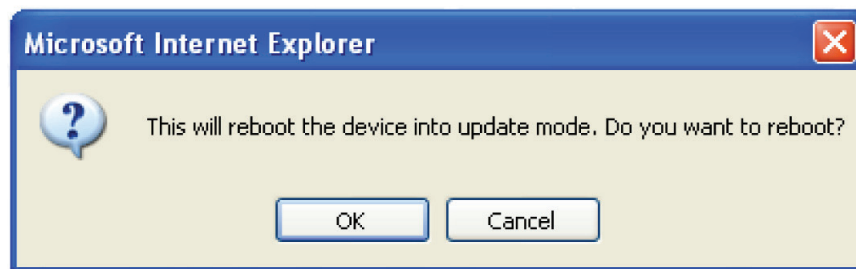


Figure 3-9. Reboot prompt.

4. Click "OK." The unit will reboot in Safe Mode. Then you will be redirected to the Safe Mode Web-based interface. This can take some time, so please be patient. The page will display the message shown in Figure 3-10 when rebooting.



Figure 3-10. Firmware Upgrade Rebooting screen.

5. After the ServSensor reboots, the page shown in Figure 3-11 appears. Click “Browse” and navigate to the firmware file you downloaded, then click “Upgrade.”

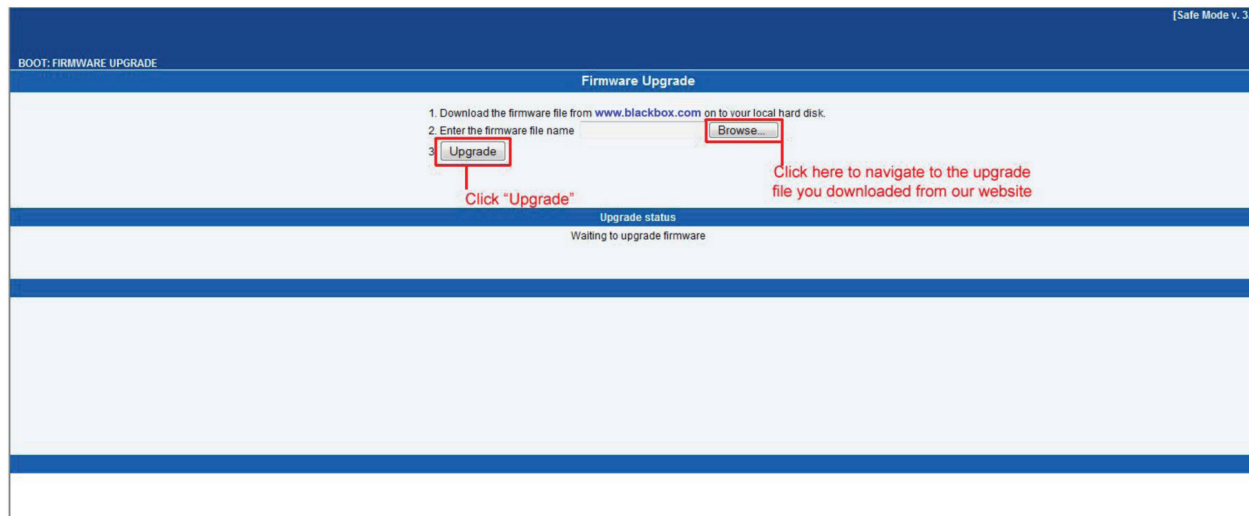


Figure 3-11. Upgrade button.

6. During the process, you will see the messages shown in Figure 3-12.

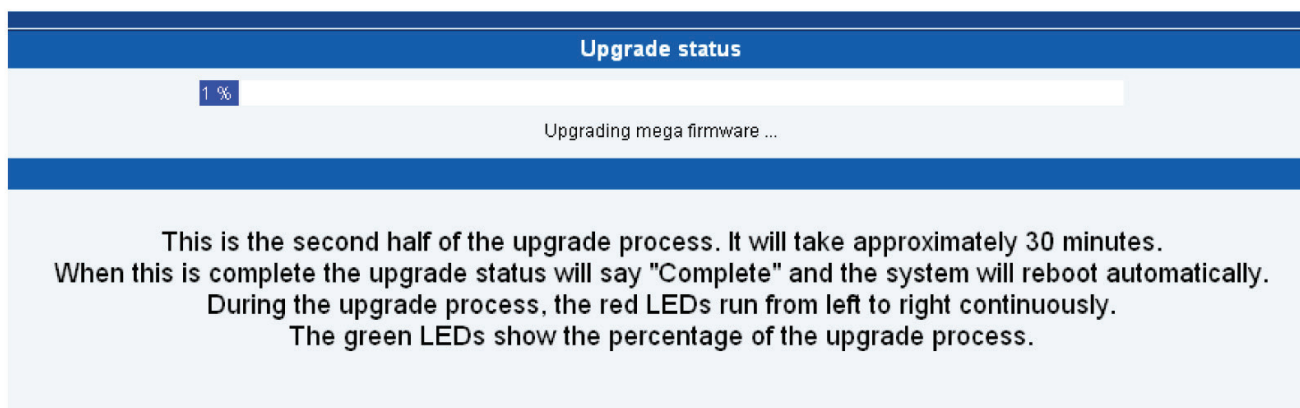


Figure 3-12. Upgrade Status screen.

7. The unit will then reboot. The process is complete when the LEDs are back to their “normal” status.

## 3.4 Multi-users and Groups Setup

### 3.4.1 Group Setup

1. Log in to the ServSensor V4E Lite with the Administrator password. The default will be “public” if you have not changed this yet.

2. Click on the Settings page, then System Administrator, then User & Group Management as shown in Figure 3-13.

*NOTE: The following screen diagrams may appear small and hard to read. Please use the zoom feature in your PDF reader program to increase the size of the page to better view these screen diagrams.*

## Chapter 3: Installation

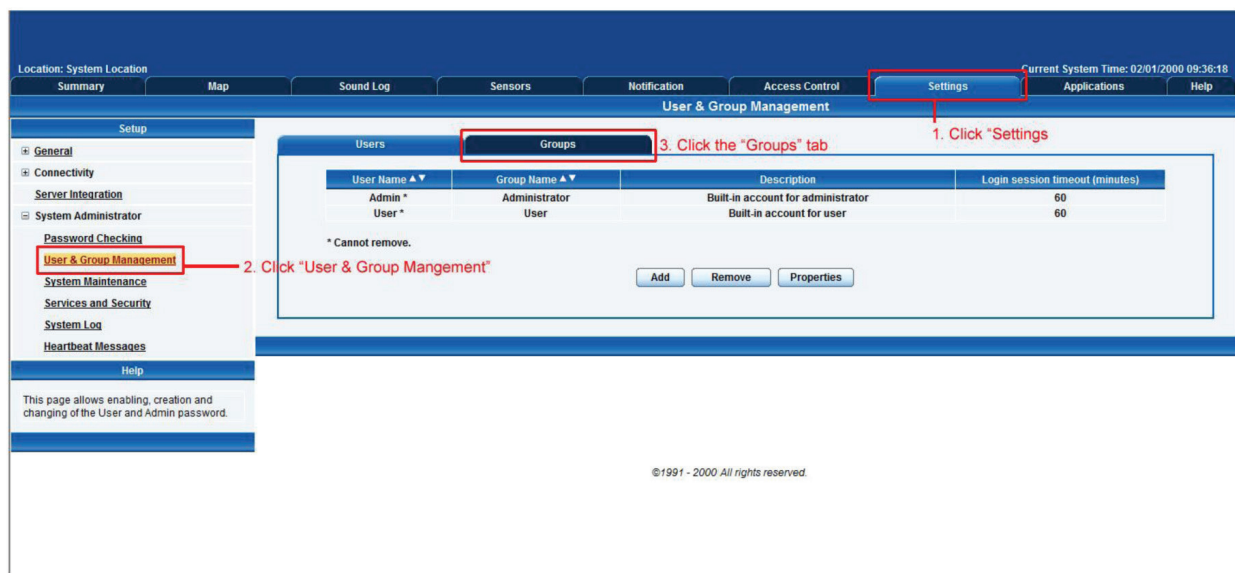


Figure 3-13. Group Setup screen.

3. Click on the "Go to Group Setup" link that will take you to the Groups page shown in Figure 3-14.

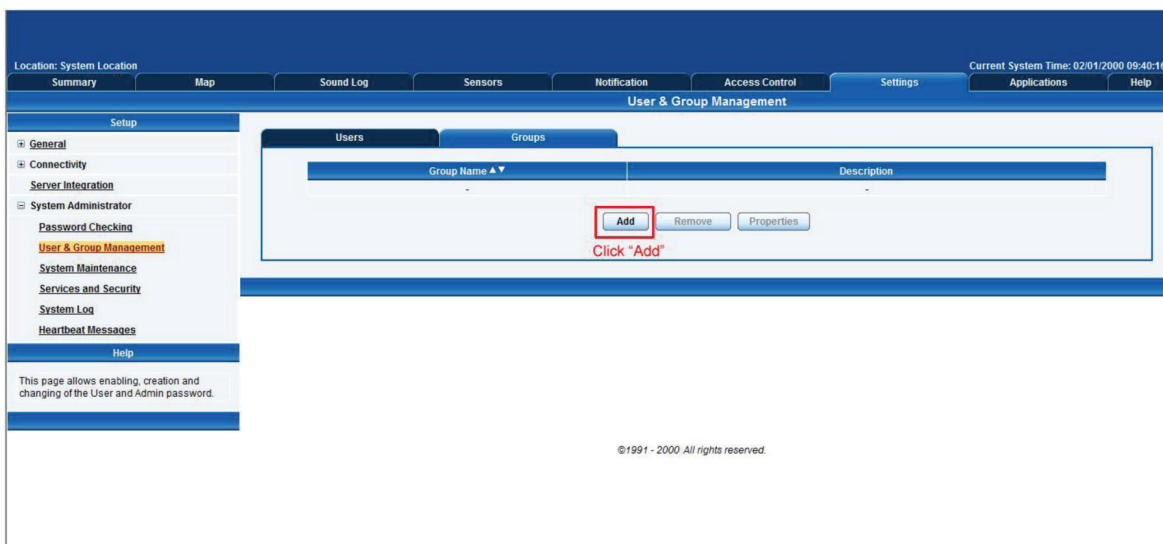


Figure 3-14. Groups page.

4. Click on the “Add” button to add your groups as shown in Figure 3-14.

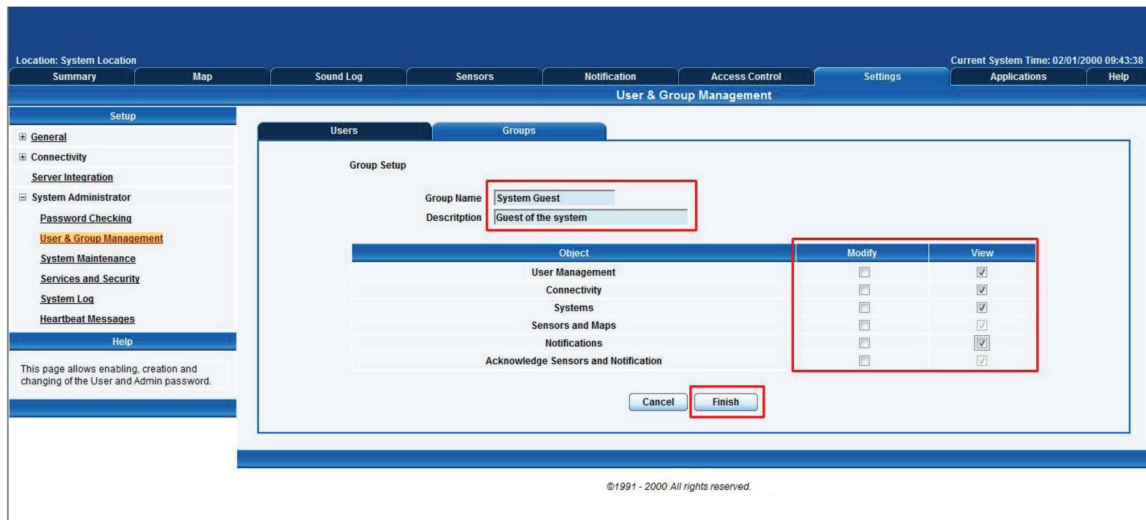


Figure 3-15. User & Group Management screen.

5. Enter your group name. For example, we have added a group called “System Guest” and entered our description.

6. Check the objects with the Web interface that this group will be able to Modify and View. Then, click the “Finish” button to save your group. (See Figure 3-15.)

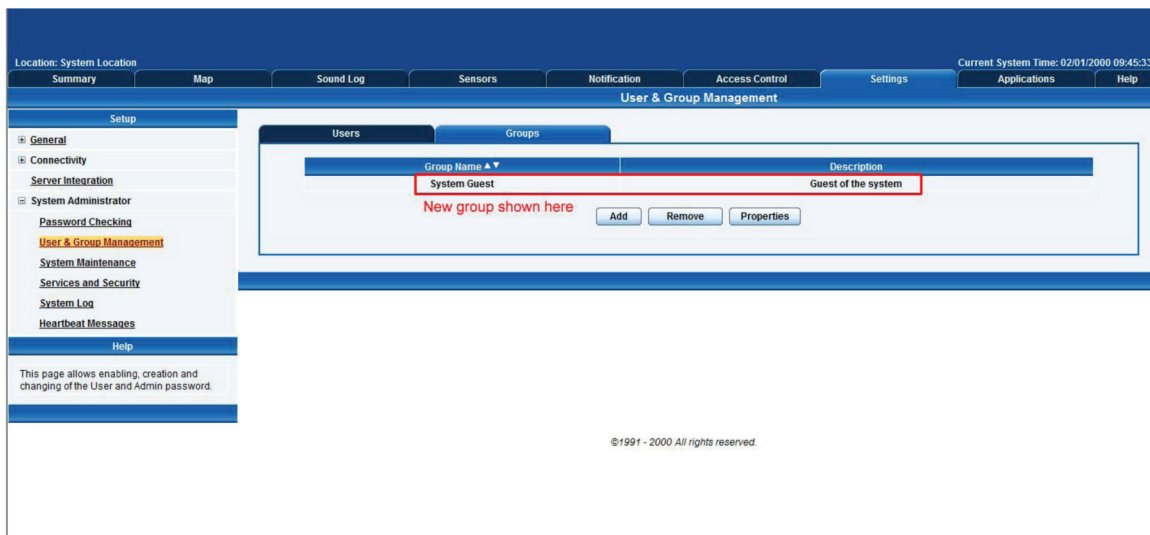


Figure 3-16. System Guest group added.

## Chapter 3: Installation

7. The new group “System Guest” has been added to our group list as shown in Figure 3-16.

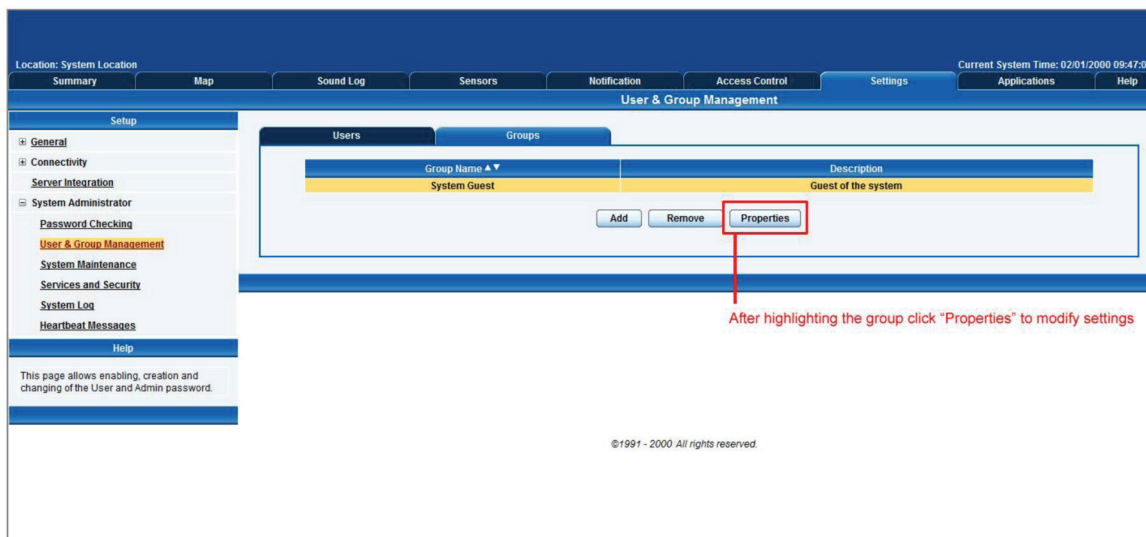


Figure 3-17. User & Group Management screen.

8. If you want to modify your group settings, click on the group you want to modify. Then click on the “Properties” button as shown in Figure 3-17.

### 3.4.2 User Setup

1. Click on the “Users” tab and then click the “Add” button to add the new users to your groups as shown in Figure 3-18.

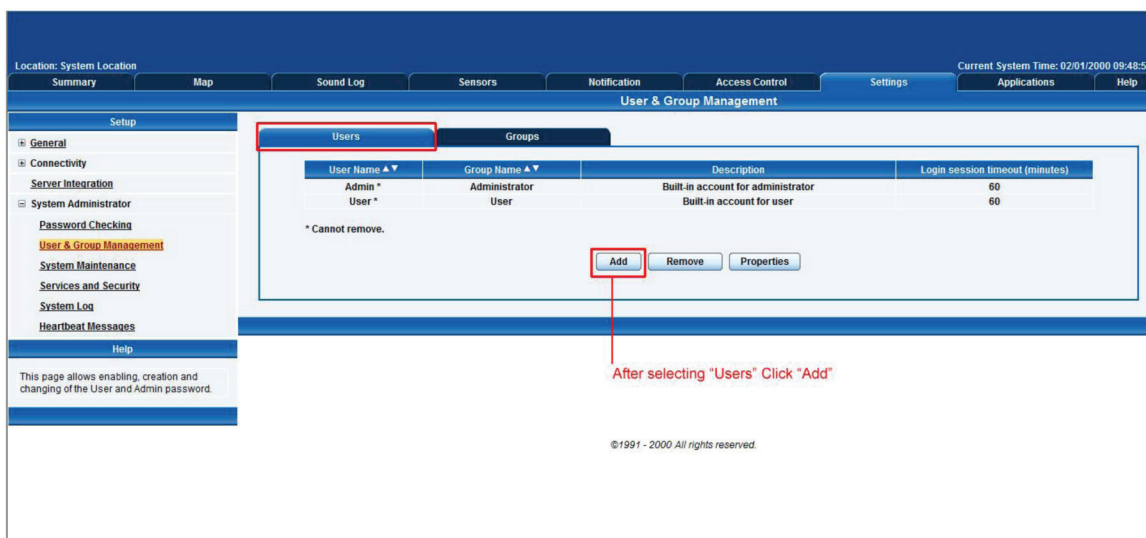


Figure 3-18. User Setup screen.

2. Enter your user details as shown in Figure 3-19. In our example, we have entered Bob Smith as your Guest into our “System Guest” group. We have also added the option so that this user cannot change his login password. After adding your users for each group, click the “Finish” button to save each user.

Location: System Location

Summary Map Sound Log Sensors Notification Access Control Settings Applications Help

Current System Time: 02/01/2000 09:54:49

User & Group Management

Setup

- General
- Connectivity
- Server Integration
- System Administrator
- Password Checking
- User & Group Management
- System Maintenance
- Services and Security
- System Log
- Heartbeat Messages

This page allows enabling, creation and changing of the User and Admin password.

User Setup

Enter the user name, password, description and then select the member of the group.

User Details

User Name: BobSmith

Password: \*\*\*\*\*

Confirm Password: \*\*\*\*\*

Description: Guest

Login session timeout (minutes): 60

Member of Group: System Guest

☒ User Cannot Change Password

Cancel Finish

Click "Finish" when you have completed your data entry

©1991 - 2000 All rights reserved.

Figure 3-19. Enter user details.

3. The new user has been entered into our list of users.

Location: System Location

Summary Map Sound Log Sensors Notification Access Control Settings Applications Help

Current System Time: 02/01/2000 09:57:16

User & Group Management

Users

User Name ▲▼	Group Name ▲▼	Description	Login session timeout (minutes)
Admin *	Administrator	Built-in account for administrator	60
User *	User	Built-in account for user	60
BobSmith	System Guest	Guest	60

\* Cannot remove.

Add Remove Properties

©1991 - 2000 All rights reserved.

Figure 3-20. User list.

4. To modify a user's setting, click on the user to select it, then click the “Properties” button as shown in Figure 3-21.

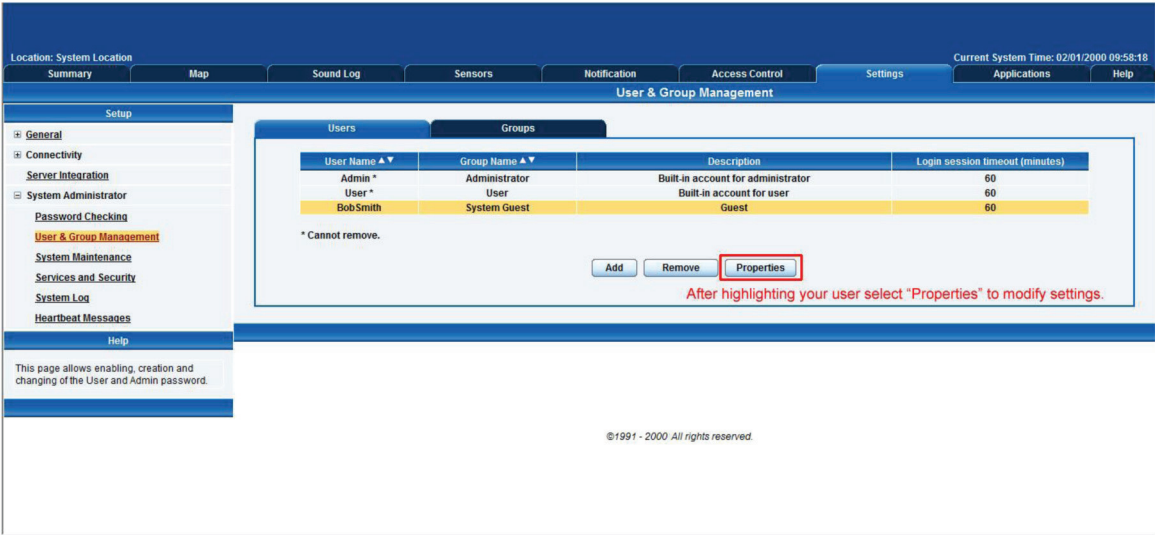


Figure 3-21. Properties button.

3.5 Services and Security

3.5.1 Active Services Application (Disabling)



Figure 3-22. Services and Security screen.

You can enable or disable the Nagios, Secure Shell, and Telnet applications running on the unit to make it more secure.



### 3.5.2 Closing or Changing Ports Disabling HTTP and Enabling HTTPS



Figure 3-23. Active services.

You can also close or change the ports used to access the unit's Web interface, disable HTTP, and enable HTTPS only.

The "s" at the conclusion of HTTPS stands for secure. The SSL/TLS connection type is used primarily for high-value sites or "pages," to make it more likely to be unreadable to someone at the end points.

The traffic between client and the ServSensor V4E Lite is not cached along the various units as it moves across the Internet, so it can't be accessed by someone after the connection is terminated.

### 3.5.3 The SNMPv3 SSL Security Feature

The screenshot shows the 'Services and Security' configuration page. The 'Active Services' section lists several services with checkboxes: Nagios, Secure Shell, Telnet, Web Interface (HTTP), Secure Web Interface (HTTPS), Simple Network Management Protocol Version 1 (SNMPv1), Simple Network Management Protocol Version 3 (SNMPv3), Serial to Network Proxy (ser2net), AKCess Pro Server Integration, and Ethernet Watchdog. The 'Add Key' button is highlighted with a red box. Below the 'Add Key' button, the 'Simple Network Management Protocol Version 1 (SNMPv1)' and 'Simple Network Management Protocol Version 3 (SNMPv3)' checkboxes are also highlighted with a red box. The 'Save' and 'Reset' buttons are at the bottom.

Figure 3-24. Add Key screen.

Use the SNMPv3 SSL (Secure Sockets Layer), which is the standard security technology for establishing the encrypted link between the ServSensor and the Web browser. The link ensures that all data passed between the ServSensor and the browser remains private and integral.

SNMPv3 provides important security features:

- Confidentiality—Encrypts packets to prevent snooping by an unauthorized source.
- Integrity—Message integrity to ensure that a packet has not been tampered with in transmit.
- Authentication—To verify that the message is from a valid source.

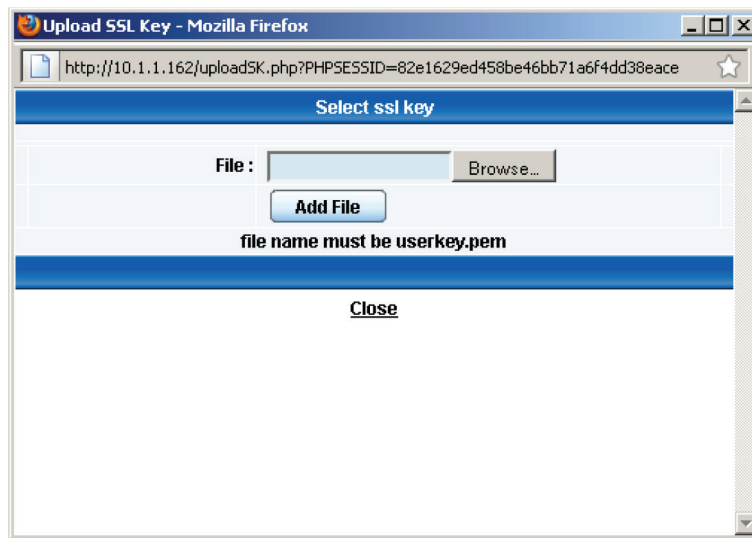


Figure 3-25. Select SSL Key screen.

### 3.5.4 Active Security

In the active security section, you can enable users who are logged into the unit's Web interface to "Acknowledge" alarms, which is normally reserved only for the Administrator.

When the unit boots up, it will announce the IP address that it has been configured with. As an added security feature, this announcement can be disabled so that the IP address remains unknown.

Active Security	
Active Security	<input type="checkbox"/> Allow Users to Acknowledge Alarms
	<input checked="" type="checkbox"/> Announcement IPAddress When Login
<div>SaveReset</div>	

Figure 3-26. Active Security screen.

3.5.5 The NAC or Network Access Control Security Feature



Figure 3-27. Network Access Control screen.

The NAC or Network Access Control feature enables you to restrict access to the Web interface for only certain IP addresses, or deny access to the Web interface for only certain IP addresses.

3.6 Setting Up a Sensor

This section describes the basic setup of a sensor, using a Black Box temperature sensor as an example. If you require information on specific functions of a particular sensor, then download the manual for that sensor from our Web site, [www.blackbox.com](http://www.blackbox.com).

- 1. Plug the sensor into one of the RJ-45 “intelligent sensor ports” on the ServSensor’s rear panel. In this example, we will use Port 1. See Figure 3-28.

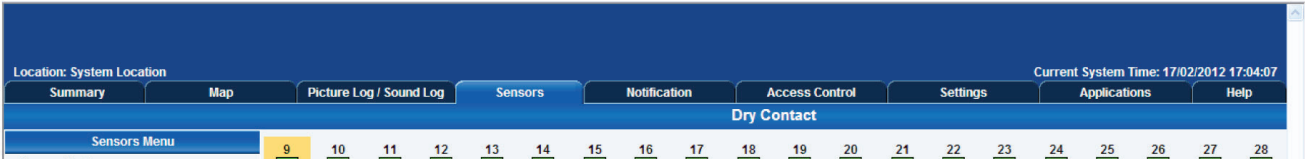


Figure 3-28. Intelligent sensor Port 1.

- 2. Point your browser to the ServSensor’s IP address (the default is 192.168.0.100). Log in as the administrator using your administrator password (the default is “public”). You will then be taken to the summary page shown in Figure 3-29.

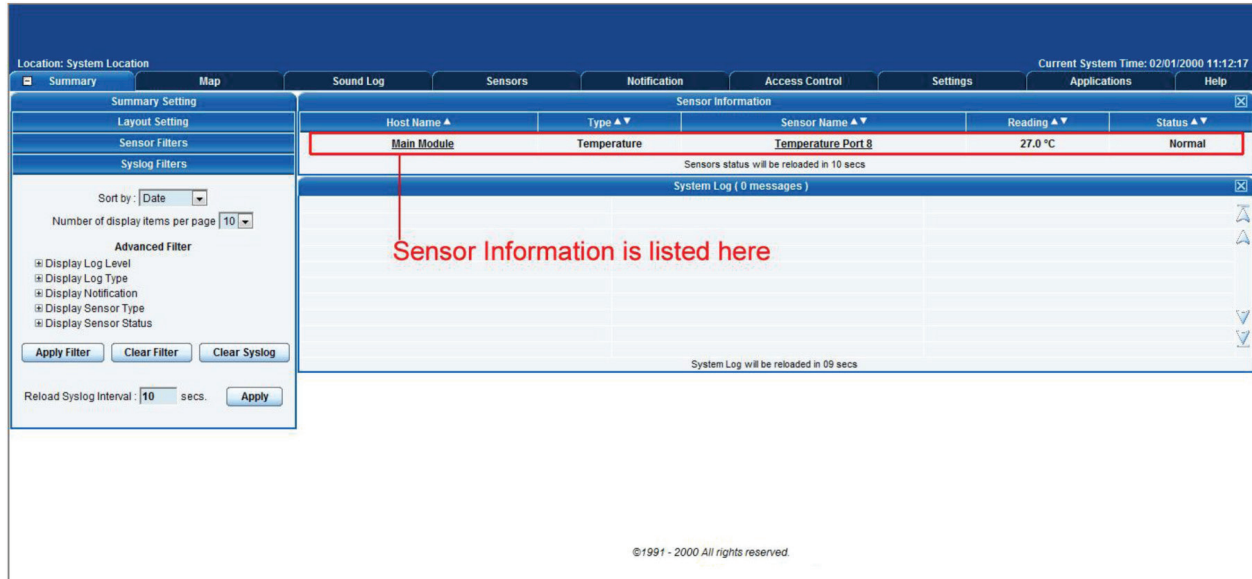


Figure 3-29. Summary page.

The temperature sensor should be listed, along with its current reading and status.

This summary page enables you to quickly see which sensors are connected and their status, view the system log, and also view footage from any connected cameras. Next are some of the tools the Web-based interface provides for getting feedback from the sensors.

3. Click on the temperature sensor's name (indicated in Figure 3-29). This will bring you to Figure 3-30, the Sensors page.

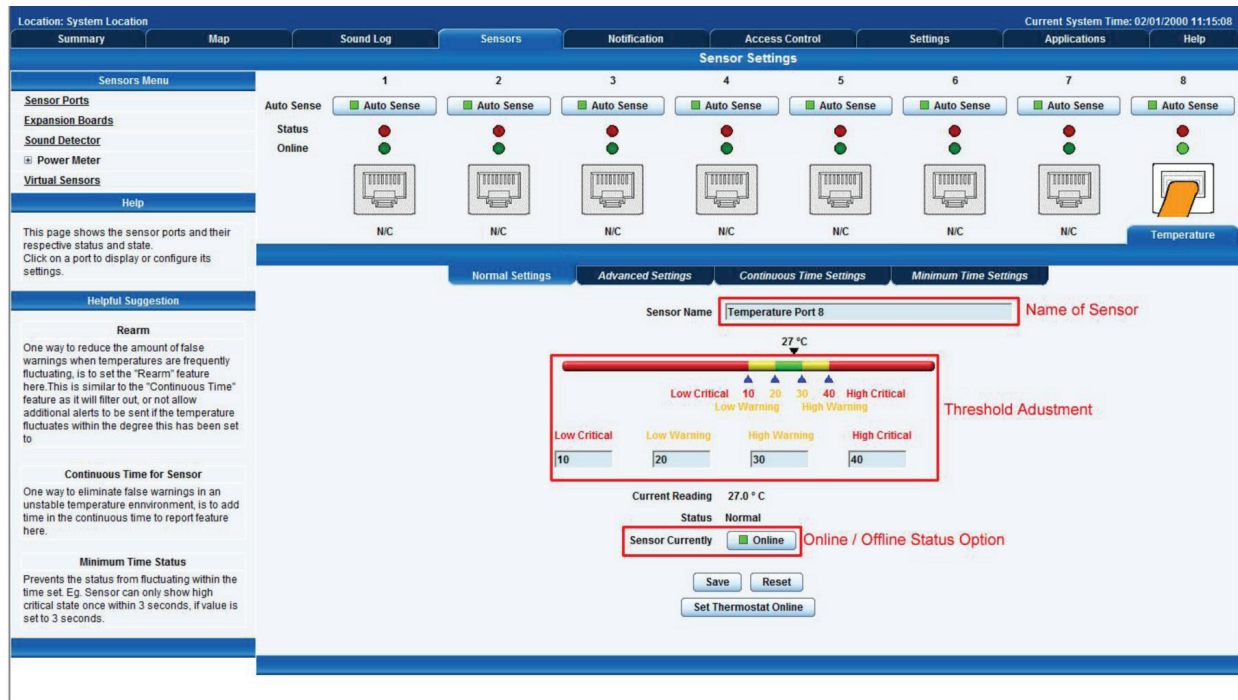


Figure 3-30. Sensors page.

NOTE: Another way to access this page is to click on the "Sensors" tab at the top of the page.

## 3.6.1 Notification Thresholds

From this page, you can carry out various operations as indicated above. You can also view the current status (normal, low critical, high critical, etc). In Figure 3-30, the sensor indicates a temperature of 27° C and a status of Normal. If you click on the blue marker arrow next to the "Threshold adjustment" label (shown in Figure 3-30), you can drag this marker to re-configure the thresholds. After dragging the marker, click "Save." In Figure 3-31, you can see that this marker has been moved to make a new threshold, and the sensor status has changed along with it.

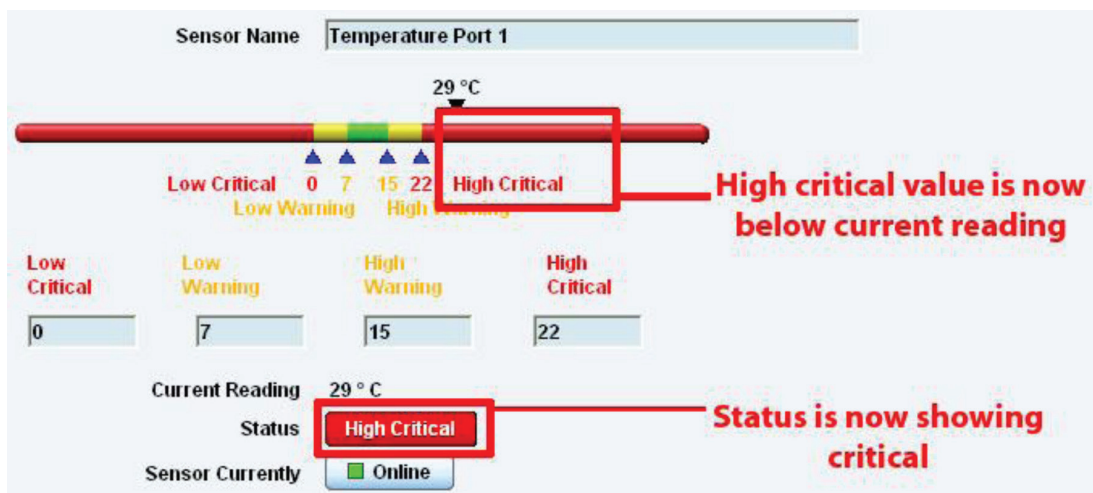


Figure 3-31. High critical status shown.



If the marker is then dragged back above the current temperature reading, the status should return to a normal condition again. (See Figure 3-32.)

*NOTE: If this does not happen right away, press the browser's refresh button.*

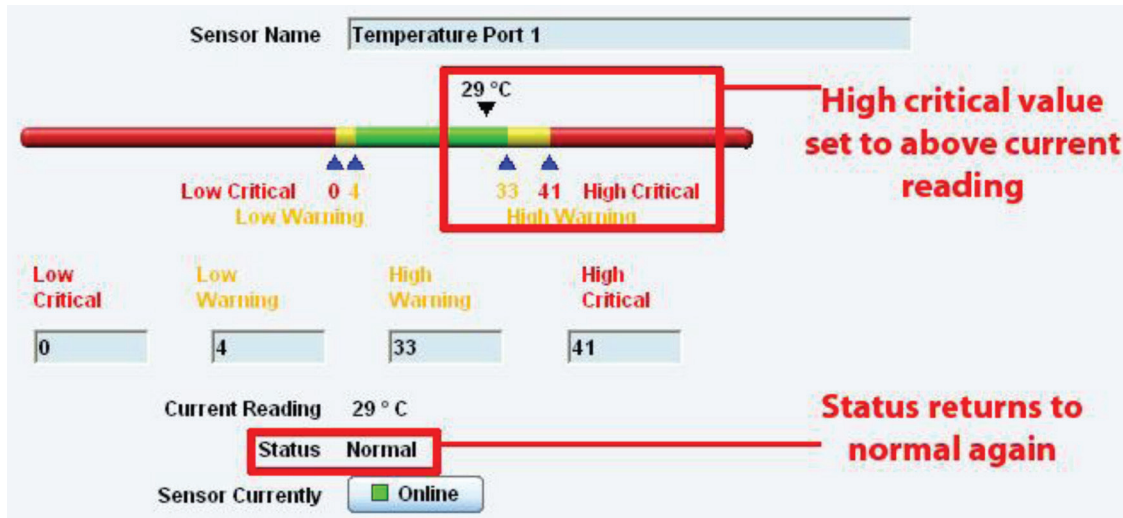


Figure 3-32. Normal status indicated.

If you want to take a sensor offline, then click on the “Sensor Currently” button. This will place the sensor offline and you won’t have to physically unplug it. See Figure 3-33.

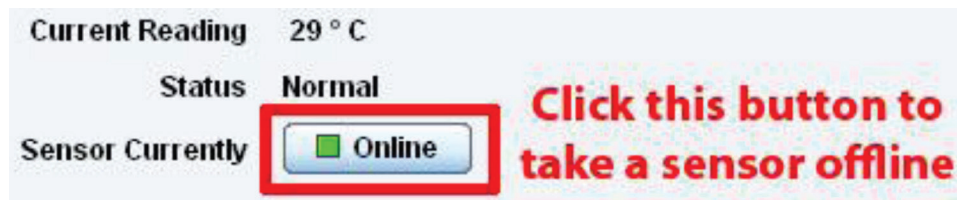


Figure 3-33. Sensor Online/Offline screen.

Your page will look similar to Figure 3-34 after you take the sensor offline.

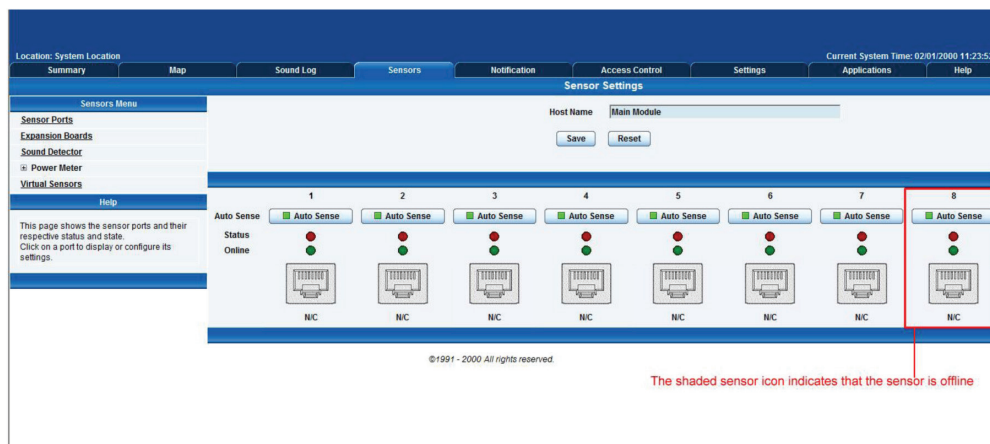


Figure 3-34. Sensor Offline screen.

## Chapter 3: Installation

To bring a sensor back online, select the type from the drop-down menu and click “Save.” See Figure 3-35.

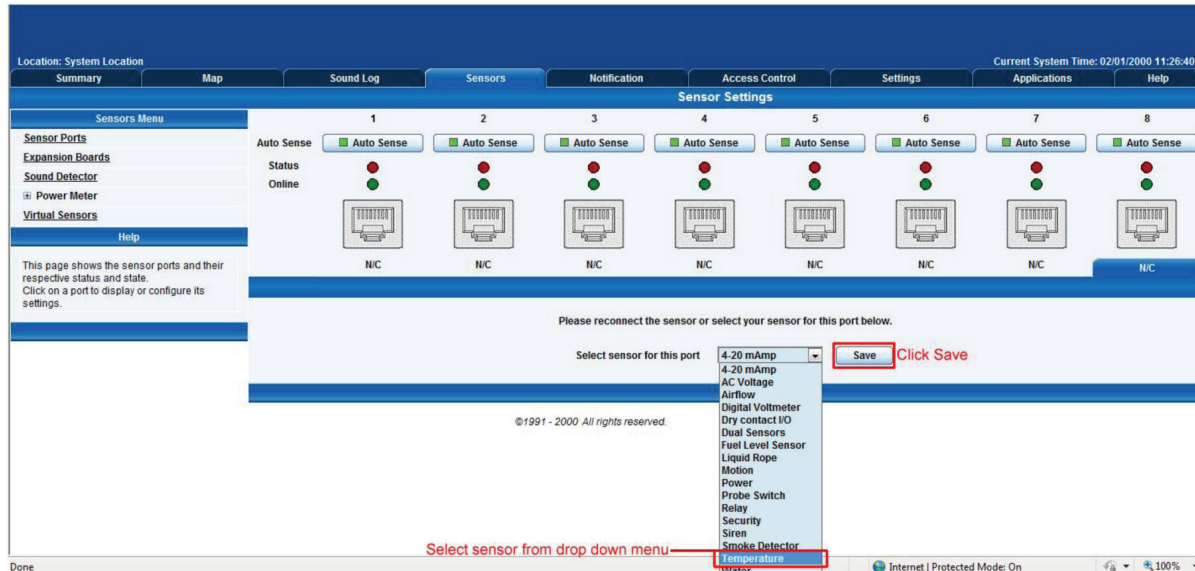


Figure 3-35. Select Sensor Type screen.

### 3.6.2 Advanced Sensor Settings

Click on the Advanced Settings tab to get the options shown in Figure 3-36.


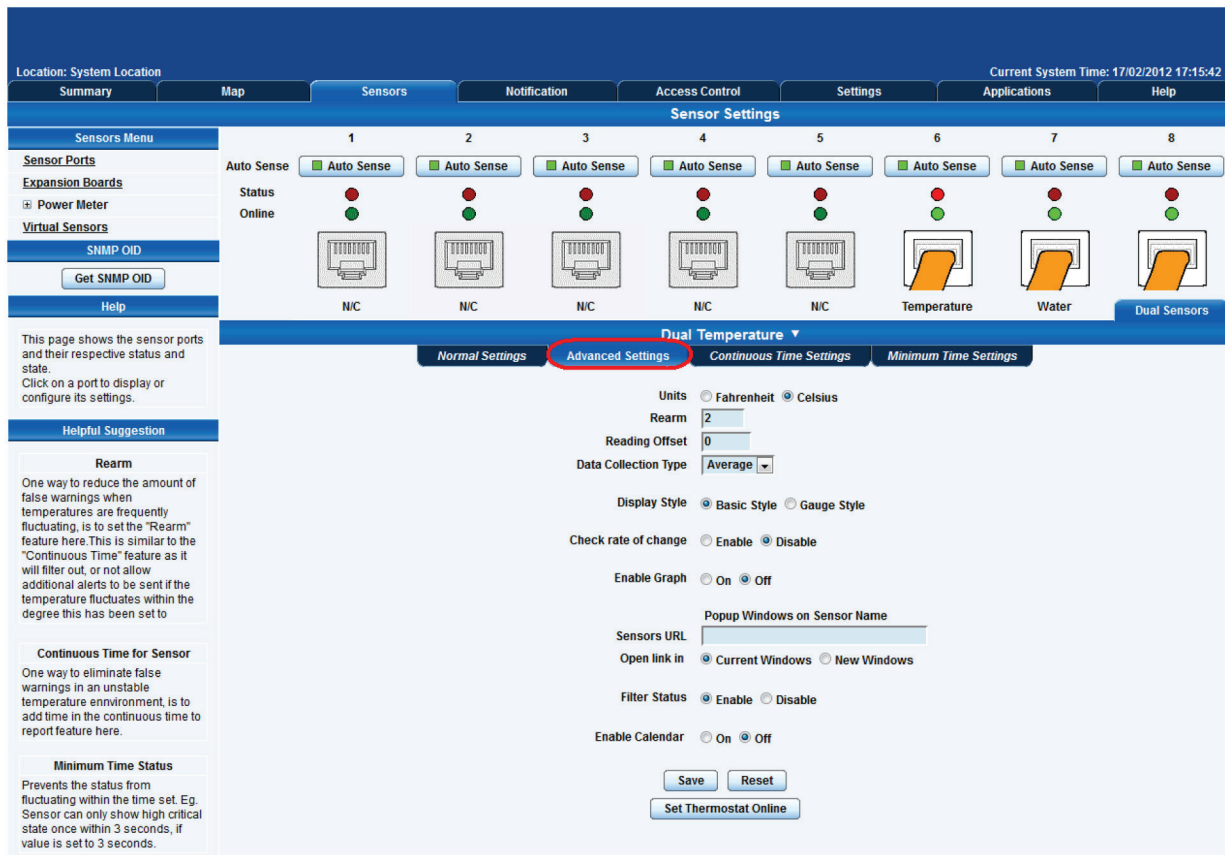


Figure 3-36. Advanced Sensor Settings screen.



Advanced Mode Functions:

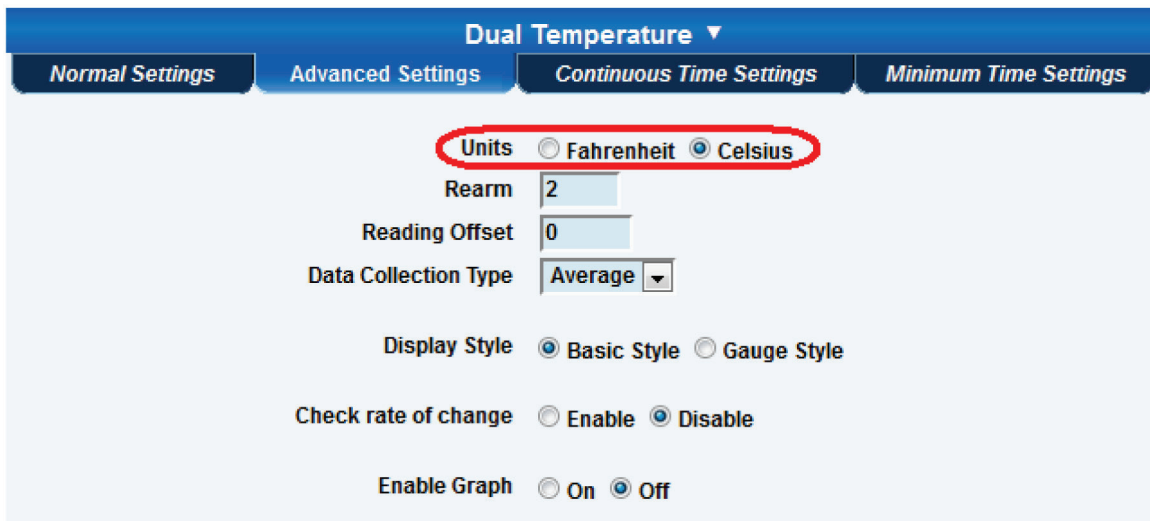

**Dual Temperature ▼**

**Normal Settings** **Advanced Settings** *Continuous Time Settings* *Minimum Time Settings*

**Units** ☐ Fahrenheit ☒ Celsius

**Rearm**

**Reading Offset**

**Data Collection Type**


**Display Style** ☒ Basic Style ☐ Gauge Style

**Check rate of change** ☐ Enable ☒ Disable

**Enable Graph** ☐ On ☒ Off

Figure 3-37. Advanced mode functions, units.

**Units:** Changes units from C to F or vice versa.

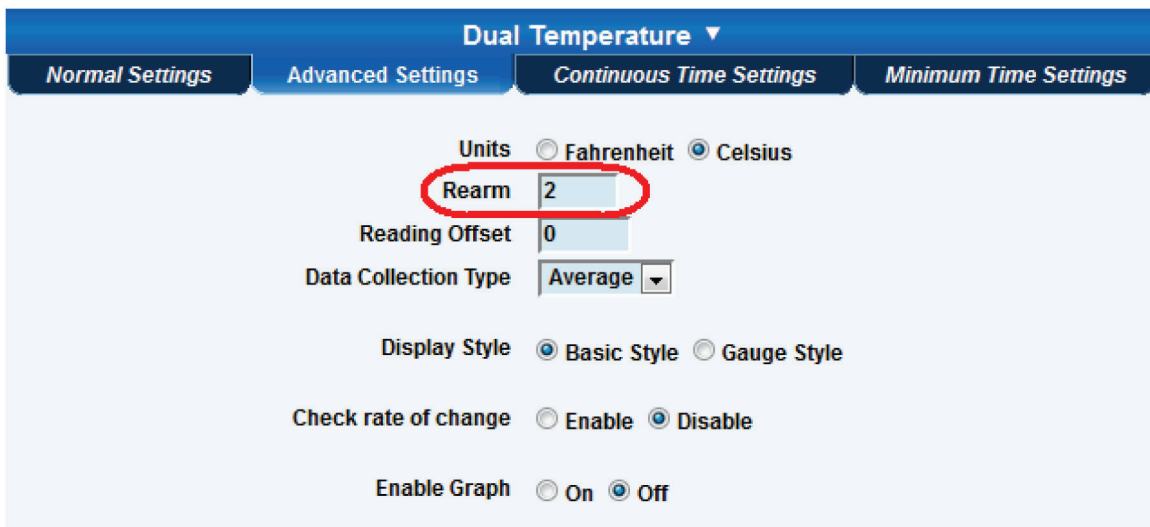

**Dual Temperature ▼**

**Normal Settings** **Advanced Settings** *Continuous Time Settings* *Minimum Time Settings*

**Units** ☐ Fahrenheit ☒ Celsius

**Rearm**

**Reading Offset**

**Data Collection Type**

**Display Style** ☒ Basic Style ☐ Gauge Style

**Check rate of change** ☐ Enable ☒ Disable

**Enable Graph** ☐ On ☒ Off

Figure 3-38. Advanced mode functions, rearm.

**Rearm:** The Rearm parameter is useful for sensors, such as the temperature and humidity sensors, whose values can vary.

This prevents the sensor from flickering between two states. For example, if the Warning High threshold for the temperature sensor is set to 80 degrees, and the sensor temperature varies between 79 and 80, you could be faced with a very large number of e-mails, traps, and events logged. The Rearm parameter prevents this by forcing the temperature to drop by the Rearm value before changing the state back to normal. In this example, if Rearm is set to 2, then the sensor would have to drop from 80 down to 77 before the status would change from Warning High back to normal.

**Dual Temperature ▾**

**Normal Settings** **Advanced Settings** **Continuous Time Settings** **Minimum Time Settings**

Units ☐ Fahrenheit ☒ Celsius

Rearm

**Reading Offset**

Data Collection Type

Display Style ☒ Basic Style ☐ Gauge Style

Check rate of change ☐ Enable ☒ Disable

Enable Graph ☐ On ☒ Off

Figure 3-39. Advanced settings, reading offset.

**Reading offset:** A calibration tool. If you want to calibrate the temperature sensor, for example, you could enter an offset value of 5. This means that if the sensor reads 20 degrees then it would record as 25 degrees. This figure can also be a minus figure (for example, -5 would show 15 degrees instead of 20).

**Dual Temperature ▾**

**Normal Settings** **Advanced Settings** **Continuous Time Settings** **Minimum Time Settings**

Units ☐ Fahrenheit ☒ Celsius

Rearm

Reading Offset

**Data Collection Type**

Display Style ☒ Basic Style ☐ Gauge Style

Check rate of change ☐ Enable ☒ Disable

Enable Graph ☐ On ☒ Off

Popup Windows on Sensor Name

Sensors URL

Open link in ☒ Current Windows ☐ New Windows

Filter Status ☒ Enable ☐ Disable

Enable Calendar ☐ On ☒ Off

Figure 3-40. Advanced settings, data collection type.

### Data Collection Type

This refers to the data collection from the sensor and how the data is then displayed on the graphs.

There are three options for collection of data: Average, Highest, and Lowest. The default setting is "Average."

When the data collection type is set to "Average," the output graphs for the daily, monthly, and yearly all have the same size on the screen. For the daily graph, each data point on the graph is one data point collected from the sensor. But for the monthly and yearly graph, to display more data into the same size as for the daily graph, some consolidation on the data is needed. One data point on the monthly and yearly graph is the average of the sensor data in a range.

The maximum and minimum values showing on the monthly and yearly graphs are the value of this consolidated data and not the raw data over that period of time.

When the Data Collection Type is set to the highest setting, then you will get the graphing output displaying the sensor's highest reading. This is the same for the lowest setting.

The screenshot shows the 'Dual Temperature' settings interface. At the top, there are four tabs: 'Normal Settings', 'Advanced Settings' (which is active), 'Continuous Time Settings', and 'Minimum Time Settings'. Under the 'Advanced Settings' tab, the following settings are visible:

- Units:** Radio buttons for 'Fahrenheit' and 'Celsius' (selected).
- Rearm:** A text input field containing the number '2'.
- Reading Offset:** A text input field containing the number '0'.
- Data Collection Type:** A dropdown menu currently set to 'Average'.
- Display Style:** This section is highlighted with a red oval. It contains two radio buttons: 'Basic Style' (selected) and 'Gauge Style'.
- Check rate of change:** Radio buttons for 'Enable' and 'Disable' (selected).
- Enable Graph:** Radio buttons for 'On' and 'Off' (selected).
- Popup Windows on Sensor Name:** A text input field.
- Sensors URL:** A text input field.
- Open link in:** Radio buttons for 'Current Windows' (selected) and 'New Windows'.
- Filter Status:** Radio buttons for 'Enable' (selected) and 'Disable'.
- Enable Calendar:** Radio buttons for 'On' and 'Off' (selected).

At the bottom of the settings area, there are three buttons: 'Save', 'Reset', and 'Set Thermostat Online'.

Figure 3-41. Advanced settings, display style.

### Display Style

You can keep the sensors "Display Style" in the Web interface as the Basic Style (slide bar) or you can change it to "Gauge Style."

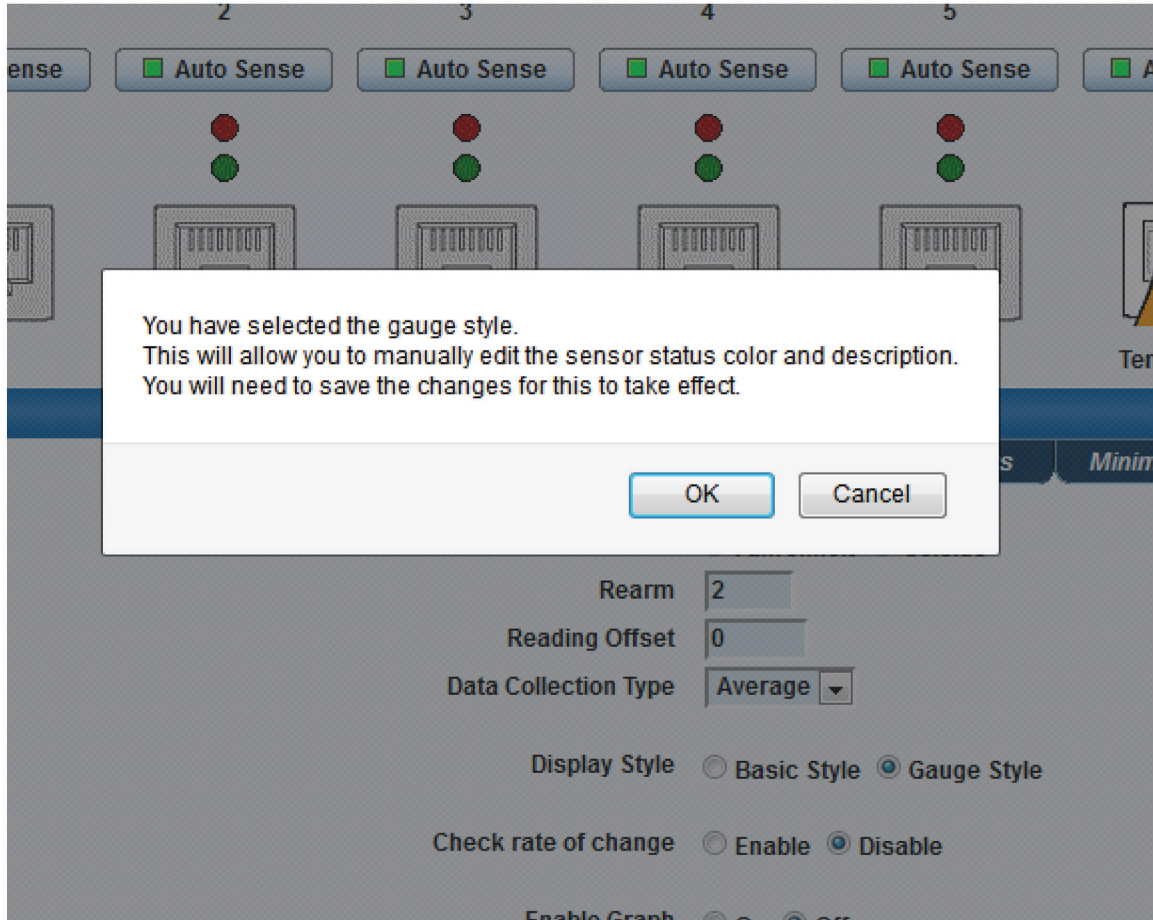


Figure 3-42. Gauge Style screen.

When switching to the Gauge Style type, you will first be prompted with the popup dialog box shown above.

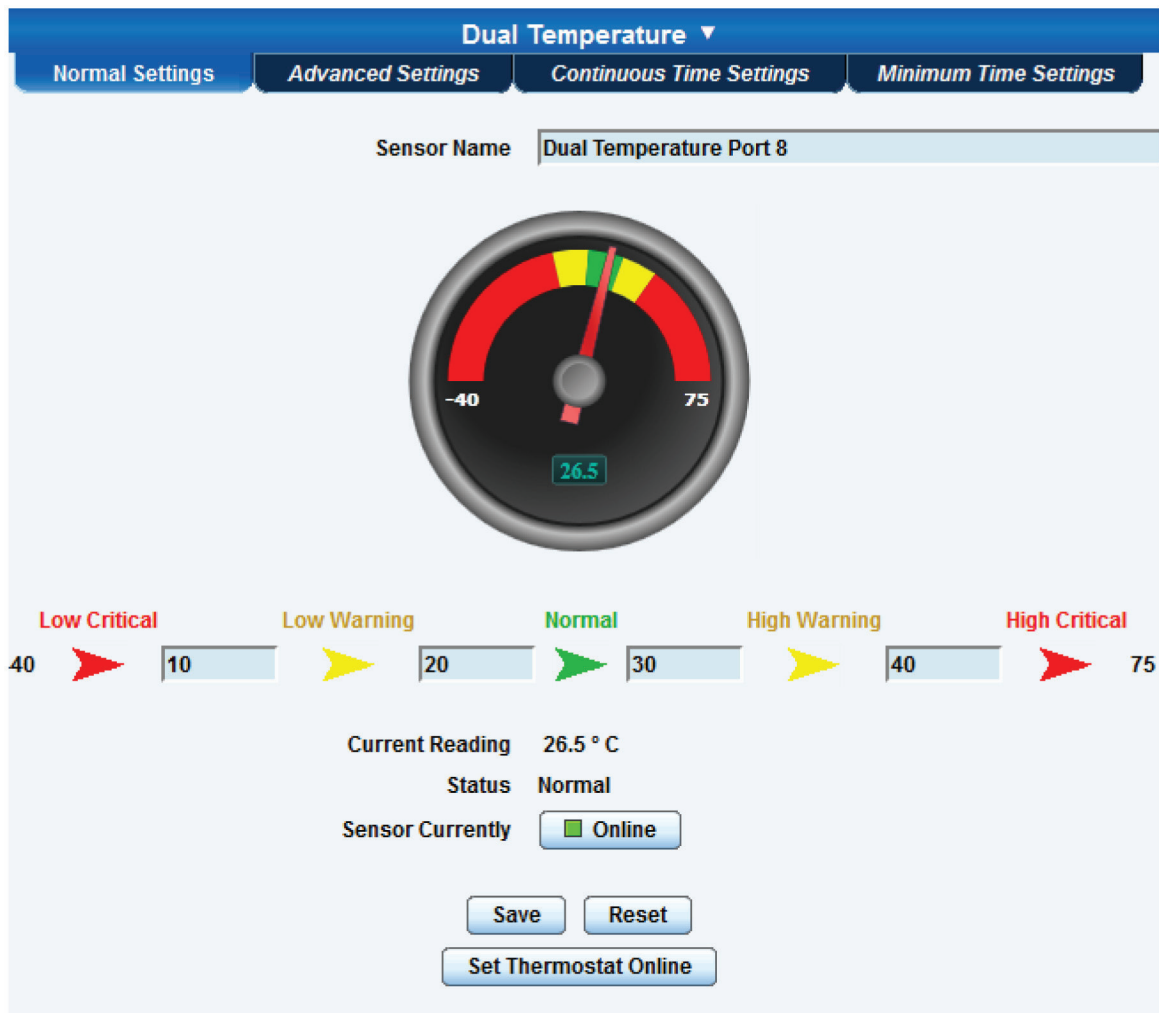


Figure 3-43. Sensor threshold levels.

You will now see the new display where you can set the sensor's threshold levels as shown above.

The screenshot shows the 'Dual Temperature' configuration interface. The 'Advanced Settings' tab is selected. The 'Advanced Status Text and Color' section is highlighted with a red circle. It includes a list of status thresholds with corresponding color swatches: Low Critical (red), Low Warning (yellow), Normal (green), High Warning (yellow), High Critical (red), and Sensor Error (red). To the right of the list is a large color palette. Other settings visible include Units (Celsius), Rearm (2), Reading Offset (0), Data Collection Type (Average), Display Style (Gauge Style), and Check rate of change (Disable).

Figure 3-44. Advanced Settings Text and Colors screen.

After clicking on the “Advanced Settings” tab, you can change the text and colors for each sensor threshold as shown in the screen above.

The screenshot shows the 'Dual Temperature' configuration interface. The 'Advanced Settings' tab is selected. The 'Check rate of change' section is highlighted with a red circle. It includes settings for: Check rate of change (Enable), Maximum acceptance of change (10%), Period of time (5 minutes), Direction (Both), Status when exceeds limit (High Critical), and Enable Graph (Off). Other settings visible include Units (Celsius), Rearm (2), Reading Offset (0), Data Collection Type (Average), Display Style (Basic Style), and Check rate of change (Disable).

Figure 3-45. Advanced Settings, Check Rate of Change screen.



### Check rate of change

When enabling the “check rate of change” feature for the sensor, you can set the rate in a percentage ranging from 1% to 80% over a period of time ranging from 1 to 20 minutes. You can set the direction to Up, Down, or Both, and you can set the Status when the limit is exceeded to show either High Critical or Low Critical.

You can tie this sensor alert to any notification. Use it with a fuel level sensor to alert you to theft of fuel or leaks in storage tanks.

### Continuous Time Settings and Minimum Time Settings Tabs

The following advanced functions set the time frame in which the system should delay a notification being triggered when a sensor gives a reading that exceeds the thresholds (high warning, normal, etc).

**Continuous Time to Report High Critical:** This helps to eliminate unnecessary messages during minor fluctuations. You can set the amount of time to delay a notification of a status change from high warning to high critical. Enter the time in seconds and press the “Save” button. The amount of time that you can enter is between 0 and 65535 seconds, which equals approximately 18 hours.

**Continuous Time to Report High Warning:** As above, but delays notification for “High Warning.”

**Continuous Time to Report for Normal:** As above, but delays notification for return to “Normal” state.

**Continuous Time to Report for Low Warning:** As above, but delays notification for “Low Warning” state.

**Continuous Time to Report for Low Critical:** As above, but delays notification for “Low Critical” state.

**Continuous Time to Report for Sensor Error:** As above, but delays notification being sent for sensor going into an error state.

**Example:** An airflow sensor or humidity sensor may have temporary drops in readings that are normal operating characteristics; a logical time limit is set to show abnormal conditions.

**Enable Calendar:** If you select this option, the screen shown in Figure 3-46 will be displayed.

Enable Calendar ☒ On ☐ Off Status set to on

All	AM											PM												
	12	1	2	3	4	5	6	7	8	9	10	11	12	1	2	3	4	5	6	7	8	9	10	11
Sunday																								
Monday																								
Tuesday																								
Wednesday																								
Thursday																								
Friday																								
Saturday																								

**Toggle Working Hours**

Report      Do Not Report

To Clear/Set, Click Hour, Day, AM, PM, All.  
 To Clear/Set the Whole Hour, Click a Cell.  
 To Select a Minute, Right Click a Cell; Mouse Over will display minute offset.

Save    Reset

Set Thermostat Online

Figure 3-46. Enable Calendar Status screen.

# Chapter 3: Installation

In this example, we want to monitor an office building between the hours of 7 PM–9 AM Monday–Friday only. You can see in this picture we have selected the “Do Not Report” option for the hours in which we do not want to receive any notifications or have any events logged. You change the status of that time frame (Report/Do Not Report) simply by clicking on the square. This will change it from blue to gray; a second click will return it to blue.

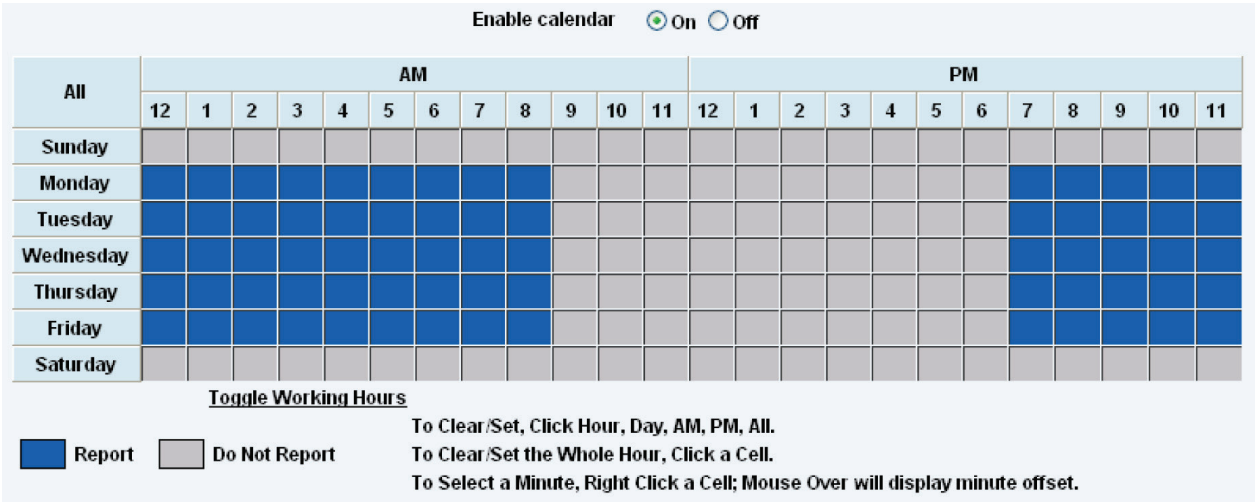


Figure 3-47. Enable Calendar screen.

## 3.7 Using an Internal Mic as a Sound Detection Sensor

- You can use the internal microphone (or an external plugged into the line in jack) as a sound detector.
- This tutorial provides you with the information you need to set up the internal mic as a sound detection sensor.
- To get to the starting point of this tutorial:
- Log into the Web based interface.
  - Click on the Sensors tab.
1. Click “Sound Detector” under the Sensors menu. See Figure 3-48.
  2. Click “Advanced Mode.”
  3. After you click on the Advanced Mode button, you’ll see the advanced options available. (See Figure 3-49.)



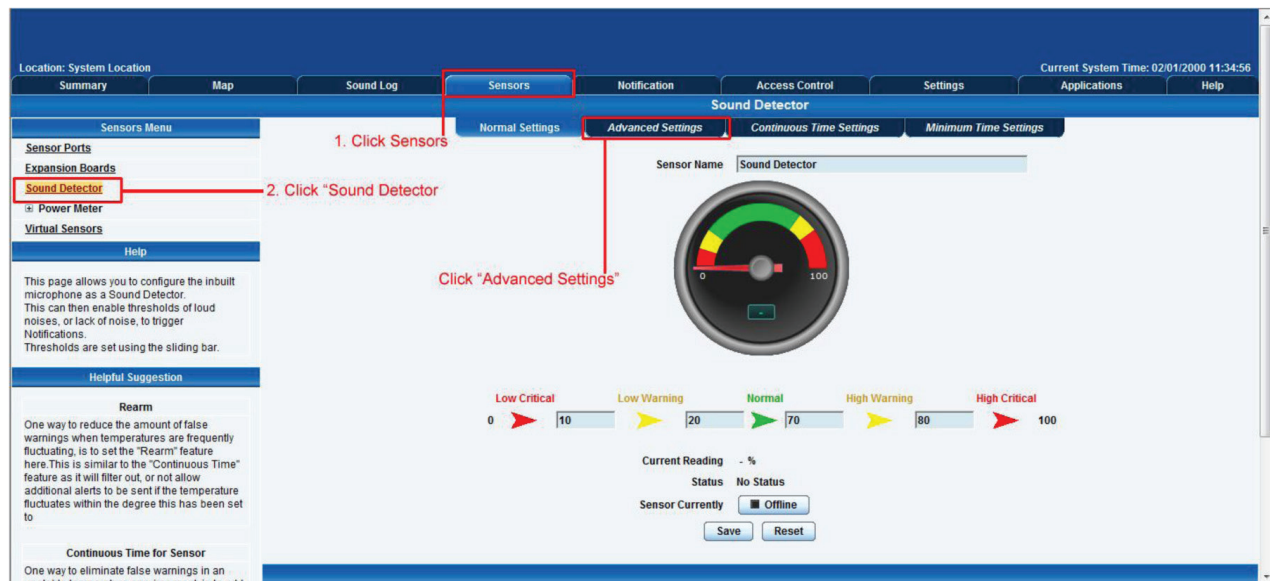


Figure 3-48. Sound Detector tab.

**Recording Source**

**Microphone Boost (+20dB)** ☒ On ☐ Off

**Microphone Sensitivity** ☐ 0 ☐ 20 ☐ 40 ☐ 60 ☒ 80 ☐ 100

**Pulse Length**  Millisecond

**Rearm**  Percent

**Data Collection Type**

**Display Style** ☐ Basic Style ☒ Gauge Style

**Advanced Status Text and Color**

Low Critical	
Low Warning	
Normal	
High Warning	
High Critical	
Sensor Error	

**Enable Graph** ☐ On ☒ Off

**Popup Windows on Sensor Name**

**Sensors URL**

**Open link in** ☒ Current Windows ☐ New Windows

**Enable Calendar** ☐ On ☒ Off

Figure 3-49. Advanced options.

**Recording Source:** Here you can choose either internal or external microphone.

**Microphone Boost (+20 dB):** Boosts the microphone by 20 dB.

**Microphone Sensitivity:** The level of sensitivity that can be set.

For example, if you set the level to 80, the microphone will detect more sound than if the level were set at 20.

**Pulse Length:** This defines the minimum duration of a sound to trigger an alert notification.

**Rearm:** The Rearm parameter prevents the sensor from flickering between two states. For example, if the Warning High threshold for the sound sensor is set to 80 and the sensor temperature varies between 79 and 80, a very large number of e-mails, traps, and events would be logged. The Rearm parameter prevents this by forcing the signal level to drop by the Rearm value before changing the state back to normal. In this example, if Rearm is set to 2, then the sensor would have to drop from 80 down to 77 before the status would change from Warning High back to normal.

**Data Collection Type:** There are three settings for this parameter: lowest, highest, and average. Data will be collected for the lowest, highest, or average sound reading accordingly.

**Advanced Status Text and Color:** Here you can select to change your display text and warning colors.

*NOTE: As with all the other sensors, you can now set up the sound detector to be attached to a notification. Then, when your thresholds are broken, it will trigger a specified type of notification.*

### 3.8 Expansion Ports

The ServSensor has four expansion ports that enable you to connect up to four daisychainable expansion modules. The available expansion modules are an 8-port intelligent sensor board (EME1X8) and an opto-isolated (16) dry-contact expansion module (EME1DC16). In this section, we will go through the basic setup of the 8-port intelligent sensor board. If you need information on specific functions of a particular sensor or expansion board, then please refer to the relevant manual for that product.

1. Plug the expansion board into one of the four ports located on the front panel of the unit. These are numbered E1–E4. See Figure 3-50.



Figure 3-50. Plug expansion boards into these ports.

2. From the summary page, navigate to the “Sensors” tab. Then click “Extended port” as outlined in Figure 3-51.

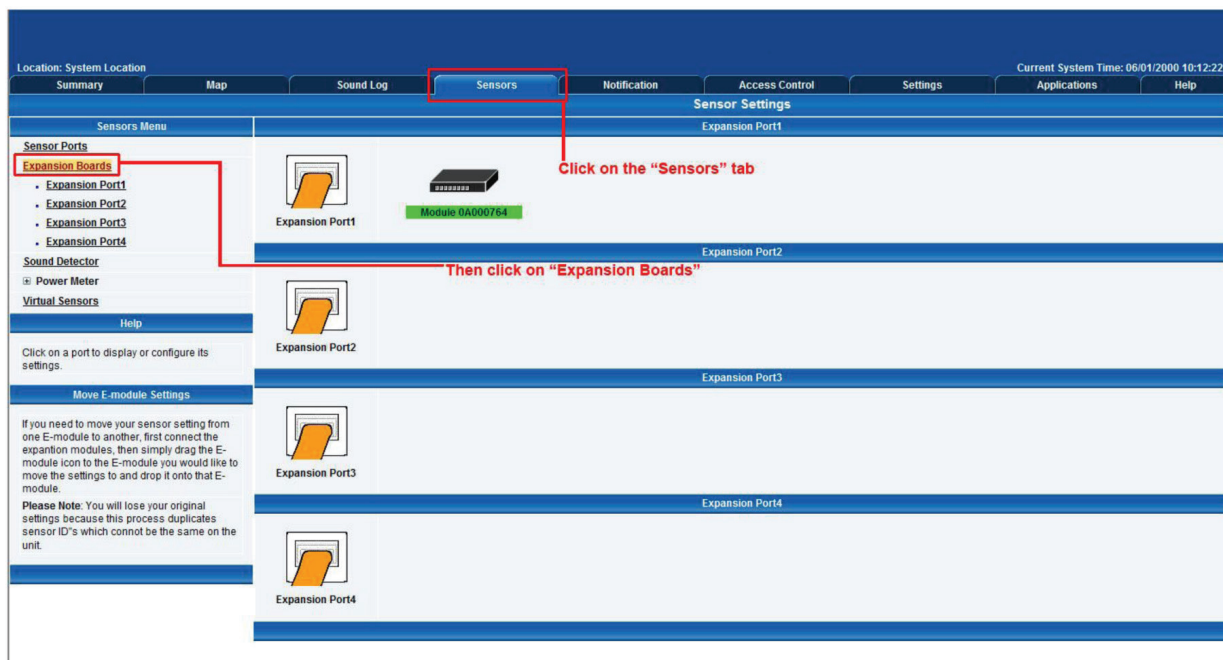


Figure 3-51. Sensors tab, extended port option.

## Chapter 3: Installation

3. A list of all extended ports will be shown. Each port will display any available extension modules, which will be highlighted in green. Click on the module to go to the sensor settings page.

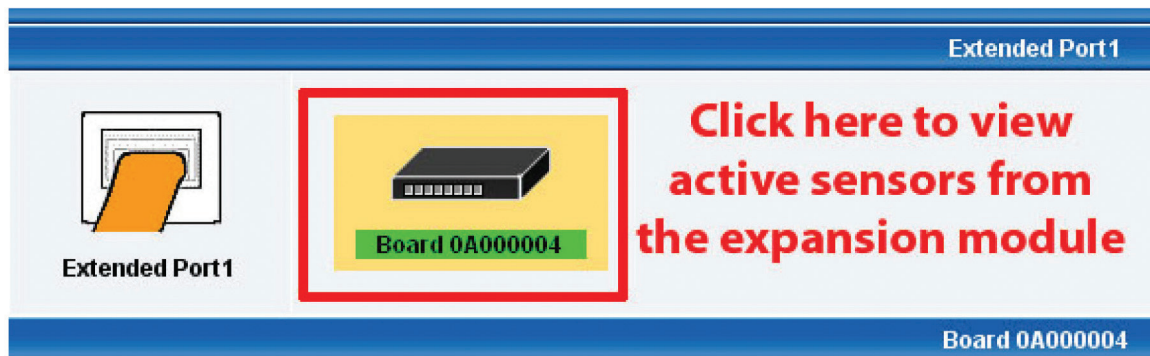


Figure 3-52. Extended Port1 selection.

4. This will bring you to the Extended Port Sensors page (see Figure 3-53).

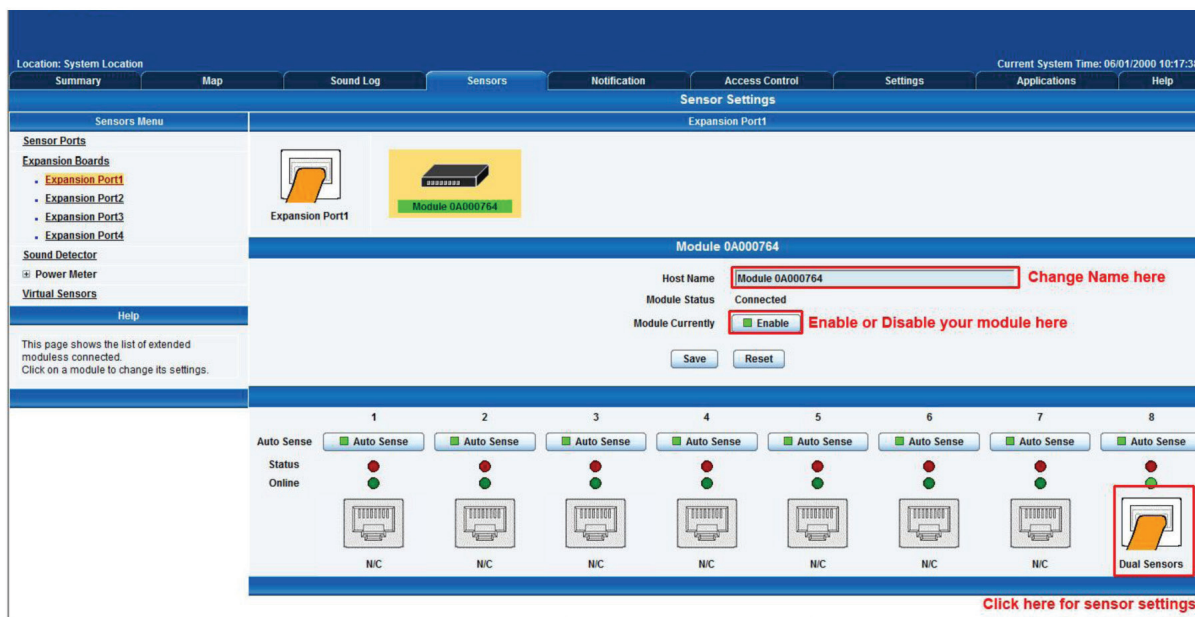


Figure 3-53. Extended Port Sensors page.

5. Once you have clicked on the "Dual sensors" tab, you will be directed to the familiar-looking Notification Thresholds page (see Figure 3-54). From this page, you can carry out various operations as indicated in the sensor settings tutorials.



Figure 3-54. Notification Thresholds page.

## Chapter 4: Notifications

### 4. Notifications

If you set up a notification, you can define the action to take when the sensor gives a reading beyond your set thresholds. This enables you to determine how you will be notified that a sensor's reading has reached the specified parameters (high warning, critical, etc.) described in Chapter 3.

This tutorial provides you with the information you need to set up a notification.

To get to the starting point of this tutorial:

- Login as administrator.
- Click the "Notifications" tab.

#### 4.1 Adding a Notification

1. Click on the "Begin Notification Wizard" tab as shown in Figure 4-1.

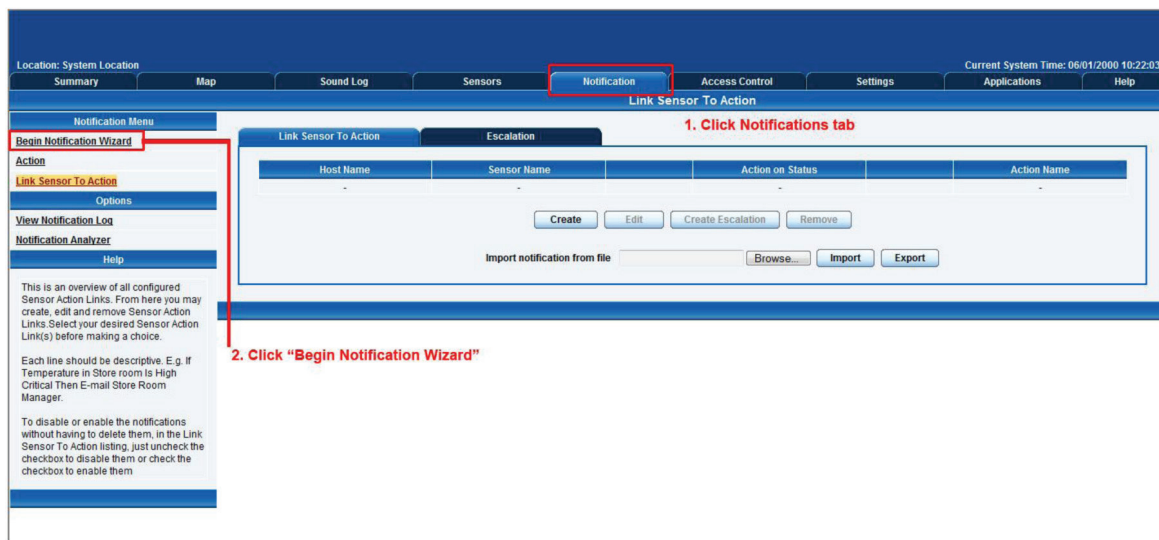


Figure 4-1. Notification Wizard tab.

2. The Notification Wizard page will be displayed as shown in Figure 4-2.



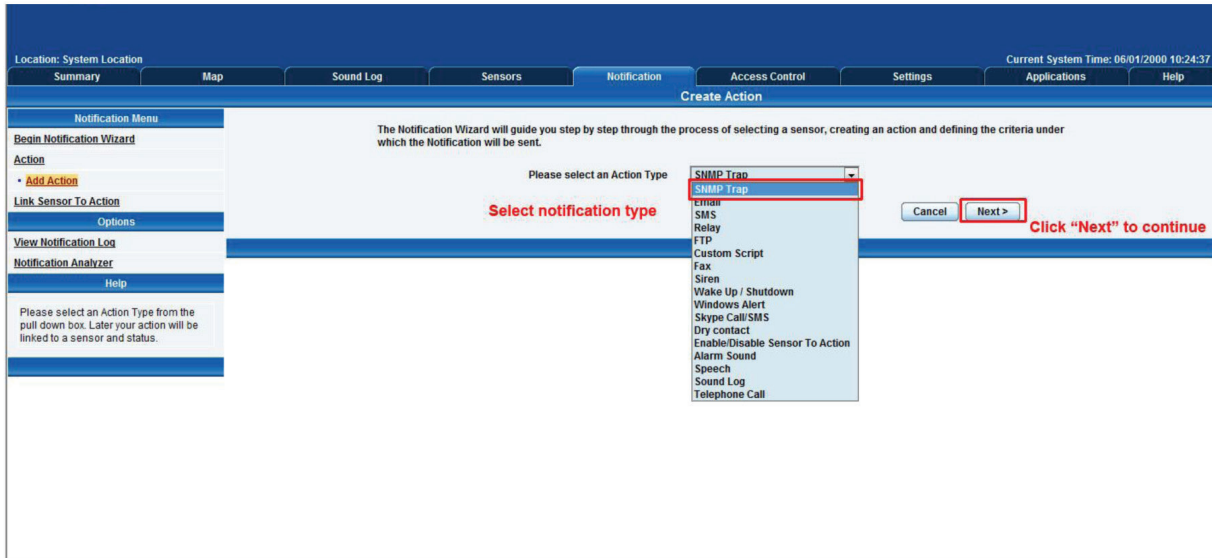


Figure 4-2. Notification Wizard page.

Next, you'll see how to set up a few different ways of notification step by step.

## 4.2 SNMP Trap

If you set up a notification via an SNMP trap, when your sensor reaches a certain threshold, it will send a notification to your SNMP server.

This tutorial provides you with the information you need to set up an SNMP trap.

To get to the tutorial's starting point:

- Log in as administrator.
- Click the "Notifications" tab.
- Choose "Notifications Wizard."
- Choose "SNMP Trap."


1. After selecting to add an SNMP trap, you will need to fill in the following information shown in Figure 4-3.

Figure 4-3. Add an SNMP trap.



## Chapter 4: Notifications

2. Once this information is correct, click the “Add Trap Destination” button. Input another trap or click on “Next.” Enter the parameters shown in Figure 4-4.

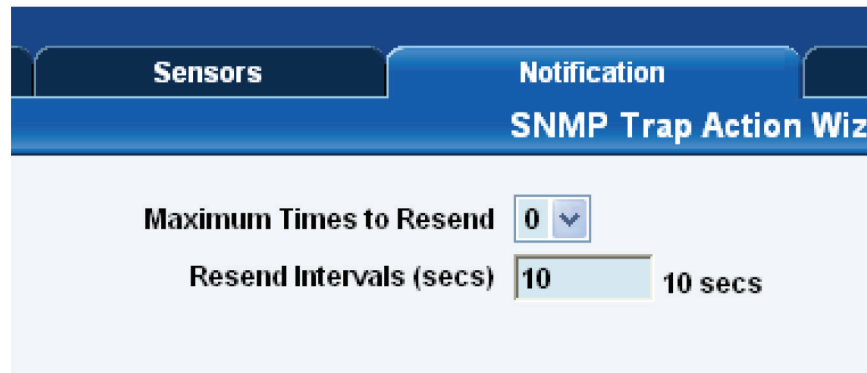


The image shows the 'Notification' tab of the 'SNMP Trap Action Wizard'. It features two input fields: 'Maximum Times to Resend' with a dropdown menu set to '0', and 'Resend Intervals (secs)' with a text input field set to '10' and a label '10 secs'.

Figure 4-4. Notification parameters.

These parameters set the maximum number of times to send the trap notification and the time interval between each notification.

3. After clicking “Next,” you’ll see the screens shown in Figures 4-5 and 4-6.

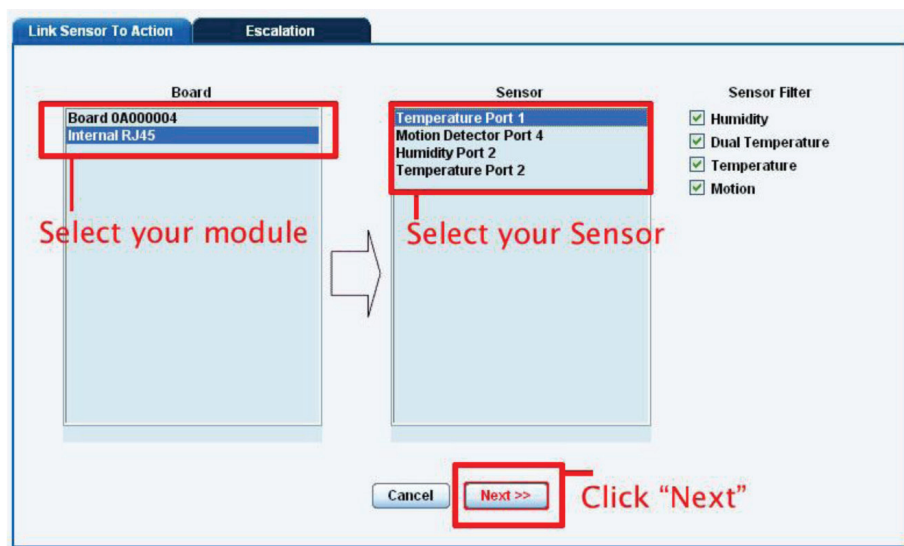

The image shows the 'Parameter Selection' screen #1. It has two tabs: 'Link Sensor To Action' and 'Escalation'. The 'Link Sensor To Action' tab is active. It contains two main sections: 'Board' and 'Sensor'. The 'Board' section has a list box with 'Board 0A000004' and 'Internal RJ45' selected. The 'Sensor' section has a list box with 'Temperature Port 1', 'Motion Detector Port 4', 'Humidity Port 2', and 'Temperature Port 2' selected. To the right of these sections is a 'Sensor Filter' section with four checkboxes: 'Humidity', 'Dual Temperature', 'Temperature', and 'Motion', all of which are checked. Below the list boxes are two buttons: 'Cancel' and 'Next >>'. A red box highlights the 'Next >>' button with the text 'Click "Next"'. Red arrows point from the text 'Select your module' to the 'Board' list box and from 'Select your Sensor' to the 'Sensor' list box.

Figure 4-5. Parameter Selection, screen #1.

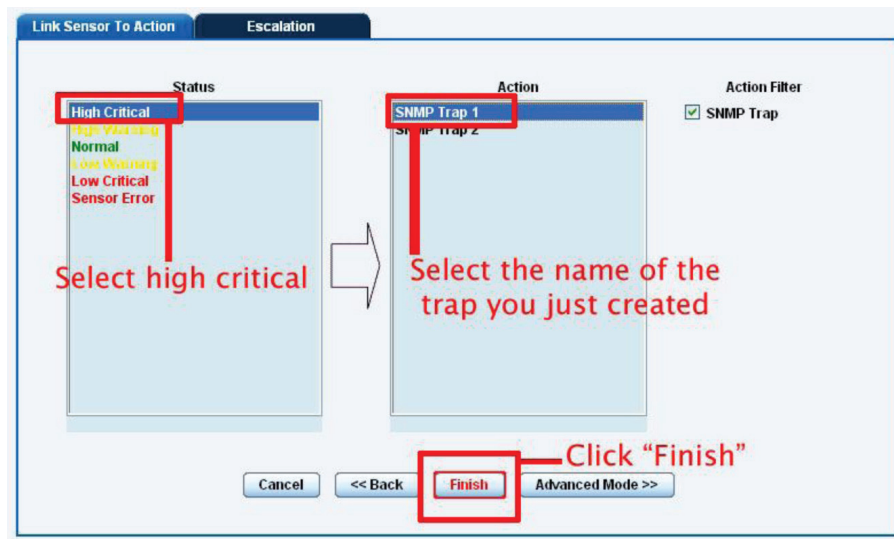


Figure 4-6. Parameter Selection, screen #2.

On these screens, you can select the parameters for when to send the SNMP trap notification. In this example, we selected to bind the SNMP trap to the temperature sensor connected on Port 1. The trap will be sent when the sensor reads a "High Critical" and we bind this to the SNMP trap we just created and named "SNMP Trap 1."

- Once we have created the parameters for the SNMP trap, we need to make it active. To do this, go back to the "Notifications" tab. (It should look like the screen shown in Figure 4-7.) Click "Create."

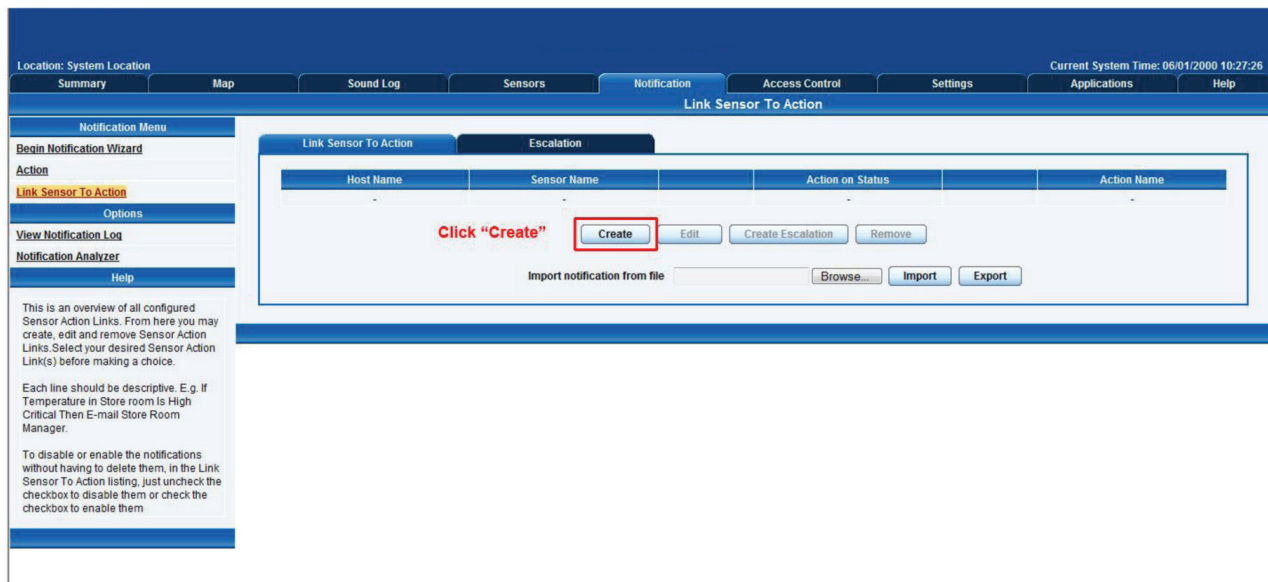


Figure 4-7. Notifications tab.

## Chapter 4: Notifications

5. Select the sensor and SNMP trap parameters (see Figures 4-8 and 4-9). First, click on the board that the sensor is attached to and then select the sensor and click "Next."

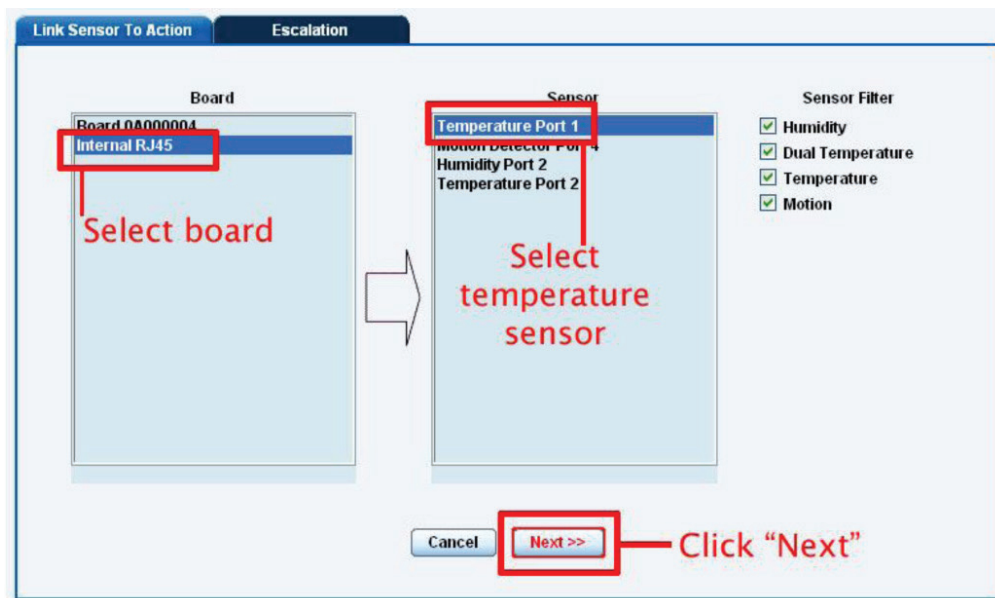


Figure 4-8. Select the sensor.

6. Select the status that you want to issue the notification for, select the action type, then click "Finish."

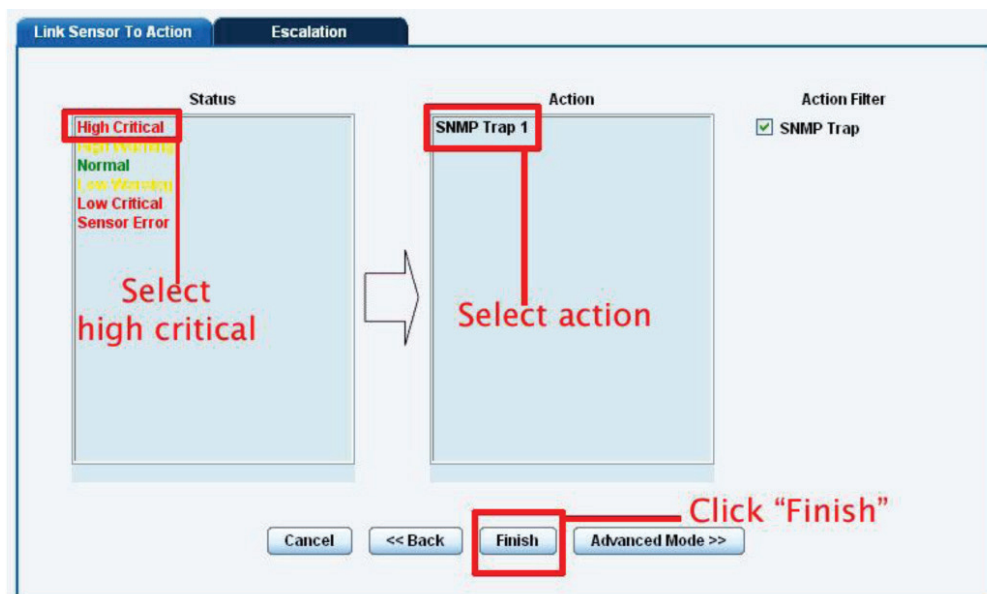


Figure 4-9. Select the SNMP parameters.

7. The SNMP trap has been added to the Notifications page.

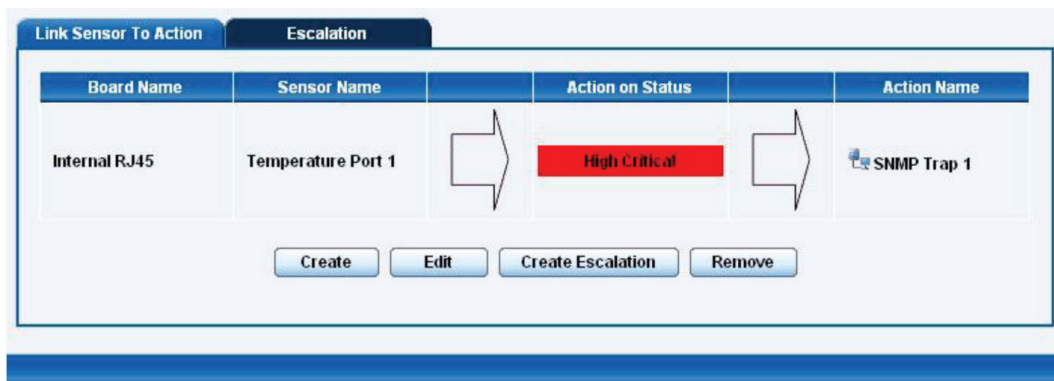


Figure 4-10. SNMP trap added.

*NOTE: To remove this trap and make it inactive, highlight the notification and click "Remove."*

You can repeat this process to set up multiple SNMP traps for different sensors or for multiple SNMP servers, etc.

### 4.3 E-mail

This tutorial provides you with the information needed to set up an e-mail notification.

To get to the starting point of this tutorial:

- Log in as administrator.
- Select the "Notifications" tab.
- Click "Notification Wizard."

1. If you set up an e-mail notification, Figure 4-11 will appear. Click the "Action Name" field and choose a name for your e-mail. Click the "Mail From" and "Mail To" fields and enter the appropriate information, then click "Next."

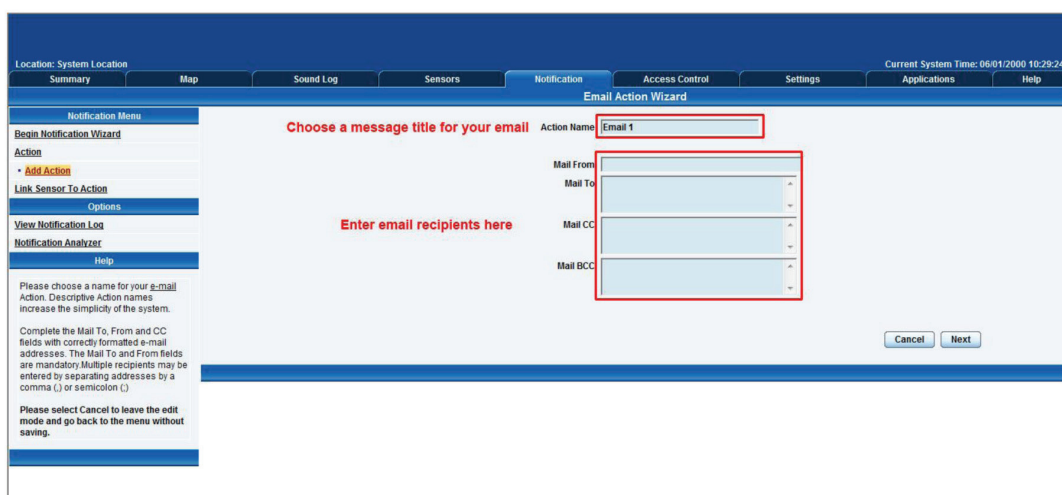


Figure 4-11. E-mail Action Wizard screen.

## Chapter 4: Notifications

2. After clicking “Next,” you will get a page where you can input the e-mail name and message. Click the “Customize” button, and the fields will re-write in a format that will allow for an automated e-mail that will display the sensor information. (See Figure 4-12.)

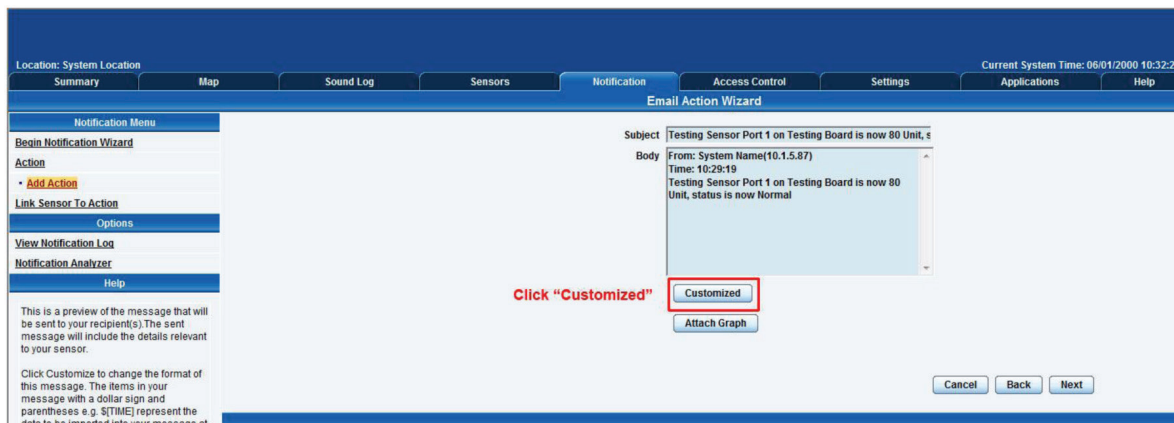


Figure 4-12. Input e-mail name and message.

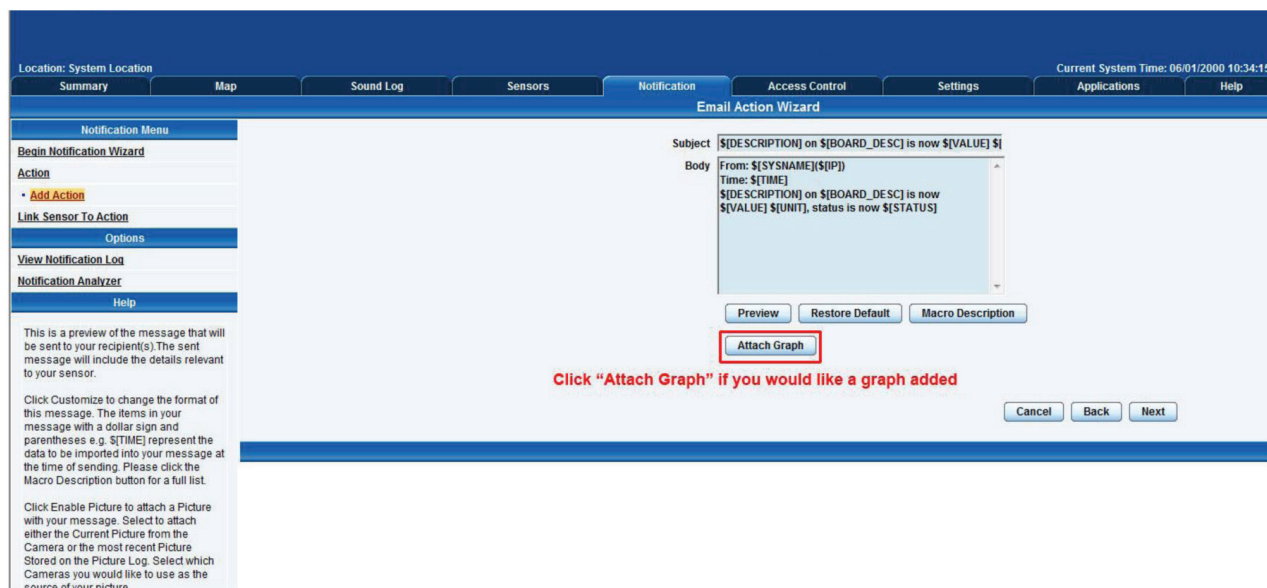


Figure 4-13. Attach graph.

3. Click “Next.”
4. Now you need to input your SMTP server address for your e-mail account. (See Figure 4-14.)

SMTP Server

SMTP Port

SMTP Authentication ☐ Enabled ☒ Disabled

SMTP Server Login name

SMTP Server Password

Timeout  Second(s)

Cancel Back Next

Figure 4-14. Input SMTP server address.

5. Once this is entered, click "Next."
6. Now, as with the SNMP trap, you can select how many times to attempt to resend the e-mail, and the time elapsed between each attempt.
7. Click "Next" after you fill in your parameters. (See Figure 4-15.)

Maximum Times to Resend

Resend Intervals (secs)  10 secs

Cancel Back Next

Figure 4-15. Select frequency to resend e-mail attempts.

8. Now link the e-mail you just created to the temperature sensor on Port 1. Select the board the sensor is attached to, then select the sensor and click "Next." (See Figure 4-16.)

Link Sensor To Action Escalation

Board

Board 0A000004

Internal RJ45

Select board

Sensor

Temperature Port 1

Motion Detector Port 4

Humidity Port 2

Temperature Port 2

Select temperature

Sensor Filter

☒ Humidity

☒ Dual Temperature

☒ Temperature

☒ Motion

Cancel Next >> Click "Next"

Figure 4-16. Select sensor.

## Chapter 4: Notifications

9. Select the status you want to issue the alert for and then select the action type. (See Figure 4-17.)

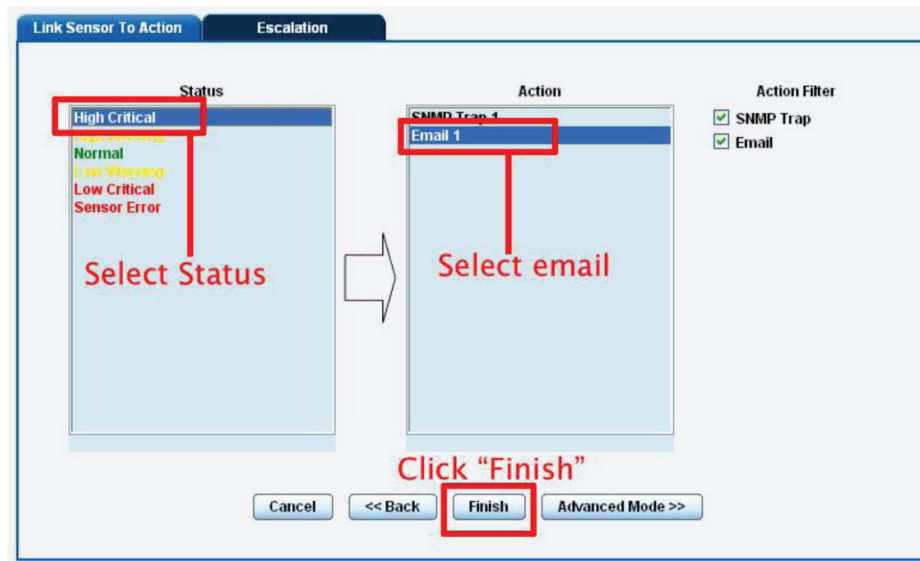


Figure 4-17. Select status and action type.

10. Click "Finish." You will now be taken back to screen shown in Figure 4-18.

11. Click on "Create."

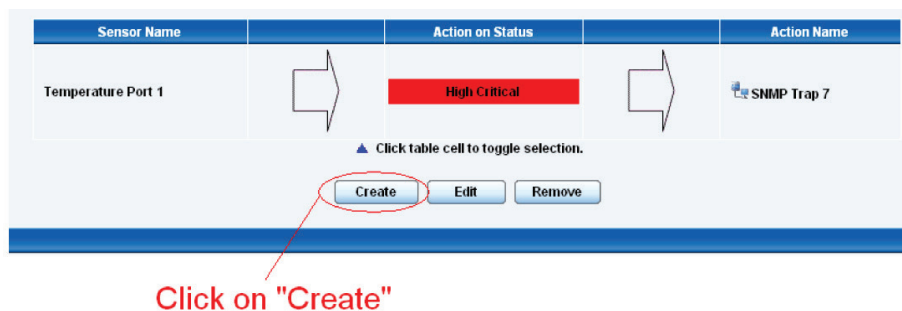


Figure 4-18. Create notification link

12. Create the notification link as before. Then click "Next."



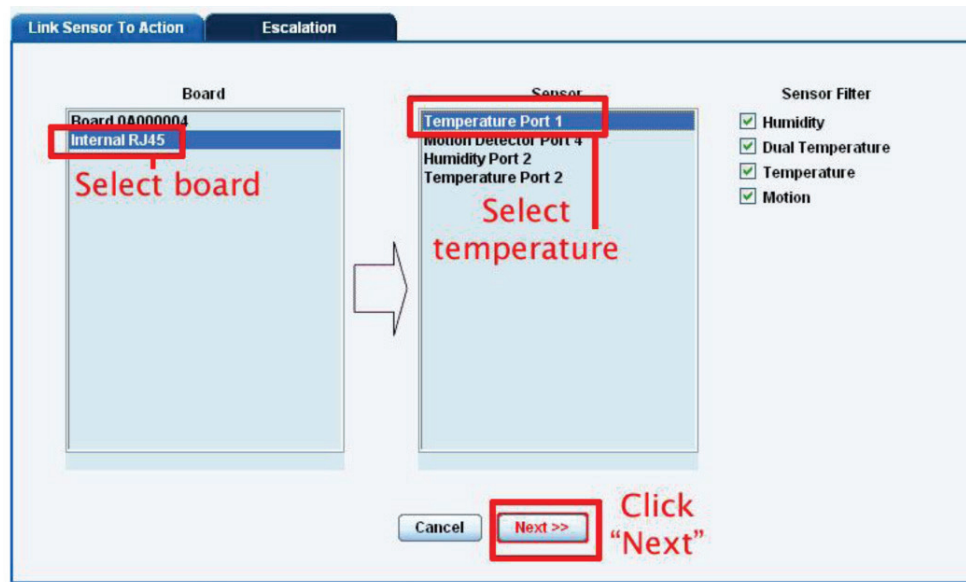


Figure 4-19. Create notification tab: select board, select temperature.

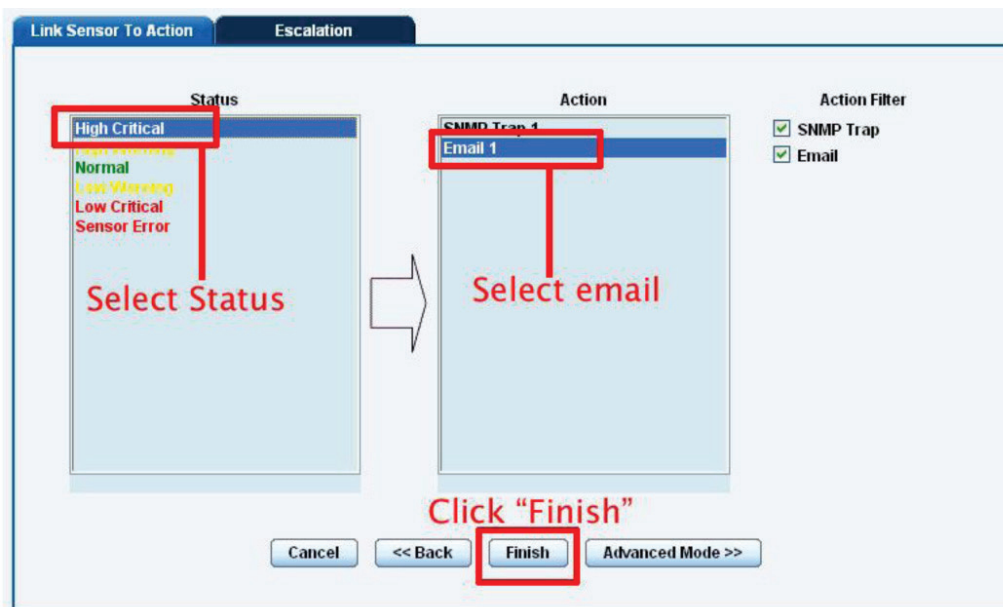





Figure 4-20. Create notification tab: select status, select e-mail.

14. You will now be back at the main notification page. You should now see listed our two notifications, the SNMP trap and the e-mail. (See Figure 4-20.)

As you can see from this page, an SNMP trap is set up to give us notification of a "High Critical," and an e-mail notification that will activate on a "High Warning."

Sensor Name		Action on Status		Action Name
Temperature Port 1		High Critical		SNMP Trap 7
Temperature Port 1		High Warning		Tutorial E-mail

▲ Click table cell to toggle selection.

Figure 4-21. SNMP Trap and E-mail Notifications screen.

### 4.4 SMS Notification

Set up a notification so that you will be sent an SMS message. This message can be sent via a GSM/GPRS mobile phone connected via a Bluetooth connection or the USB port.

This tutorial provides you with the information you need to set up a SMS notification.

To get to the starting point of this tutorial:

- Log in as administrator.
  - Select the "Notifications" tab.
  - Click "Notification Wizard."
1. From the list of notification types, select SMS and click "Next." You will then be presented with the screen shown in Figure 4-22. Select the "Action Name" field and enter a notification name. Then select the "Phone Number" field and enter the phone number you want to send the notification to. Click "Next."
  2. You can now either add multiple numbers, delete phone numbers, "Cancel" this action, or click "Next." In this case, we will click "Next." (See Figure 4-23.)



Figure 4-22. SMS Action Wizard, screen #1.

Figure 4-23. SMTP Action Wizard, screen #2.

3. Now we will set up the message that will be sent to the phone. You will see the screen shown in Figure 4-24. Click the “Customized” button to add a macro to your notification.

Figure 4-24. Customize Macro screen.

*NOTE: A macro is a script that returns specific data collected by the unit. In our example, the macro will tell the notification to contain the “description” (sensor name), the value (current sensor reading), and the status (high/low warning, etc.). These macros are common to all sensor notifications.*

4. You will now see that the SMS message has changed its format to include the Macro script. (See Figure 4-25.) Click “Next.”

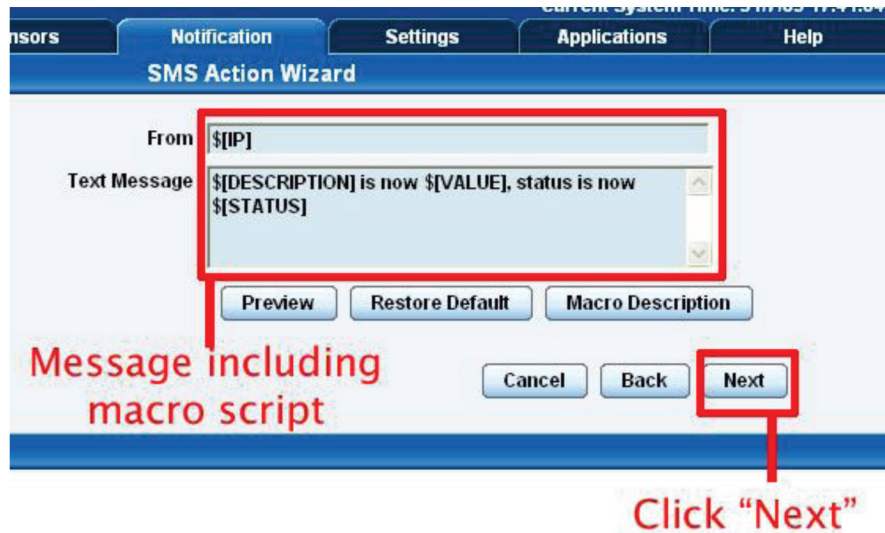


Figure 4-25. Macro script message.

5. Next, we will set up the type of connection. This will depend on the type of modem you are connecting. For the purpose of this tutorial, we will assume you are connecting a GSM/GPRS enabled modem to the serial port. Select COM1 from the list. (See Figure 4-26.)
6. Choose the port that the modem is connected to.



Figure 4-26. Choose the Connection Type You Wish to Use screen.

7. You will now be able to select the number of times you want the SMS to be resent and the interval between sending them. (See Figure 4-27.)
8. Select the number of times you want to resend this notification and the interval (in seconds). Click "Next."

Current System Time: 3/17/09 11:11 AM

Sensors Notification Settings Applications Help

**SMS Action Wizard**

Maximum Times to Resend: 0  
Resend Intervals (secs): 10

Click "Next"

Select number of times to resend and intervals

Cancel Back Next

Figure 4-27. Select number of times to resend and intervals.

9. Select the sensor that you want to bind this notification to.

10. Choose the board and sensor, then click "Next."

Link Sensor To Action Escalation

Board

- Board 0A000004
- Internal RJ45

Sensor

- Temperature Port 1
- Motion Detector Port 4
- Humidity Port 2
- Temperature Port 2

Sensor Filter

- ☒ Humidity
- ☒ Dual Temperature
- ☒ Temperature
- ☒ Motion

Cancel Next >>

Figure 4-28. Choose board and sensor.

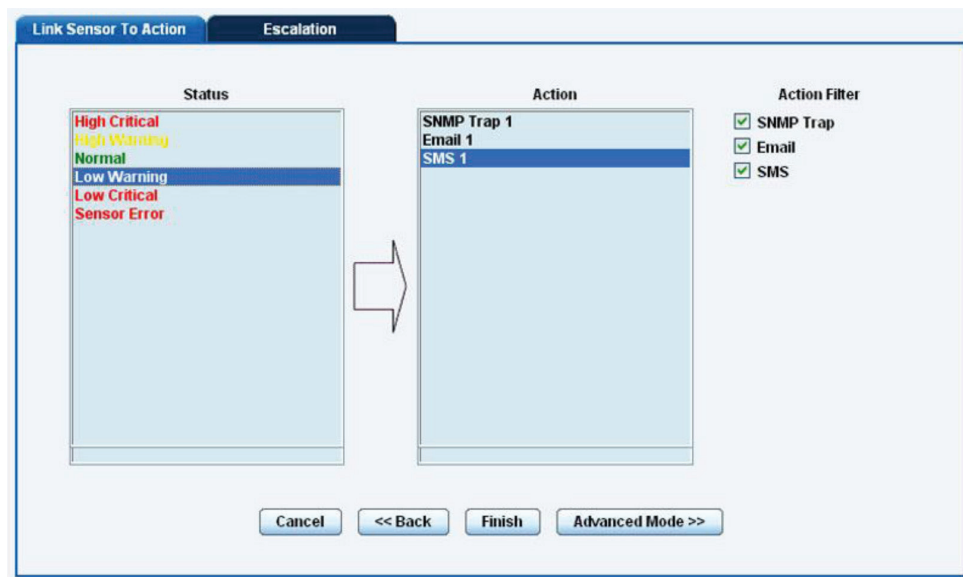


Figure 4-29. Link sensor to action tab.

11. This time we will use this notification for a low warning. Then select the notification name we assigned, in this case we chose "SMS 1." Click "Finish" to finalize this. (See Figure 4-29.)
12. Now we will add the SMS notification to our active list. This is the same process as for the others—simply click on "Create" and then select the appropriate parameters. Follow Steps A–F below and on the next page.
  1. Select the board the sensor is connected to.
  2. Select the sensor.
  3. Click "Next."

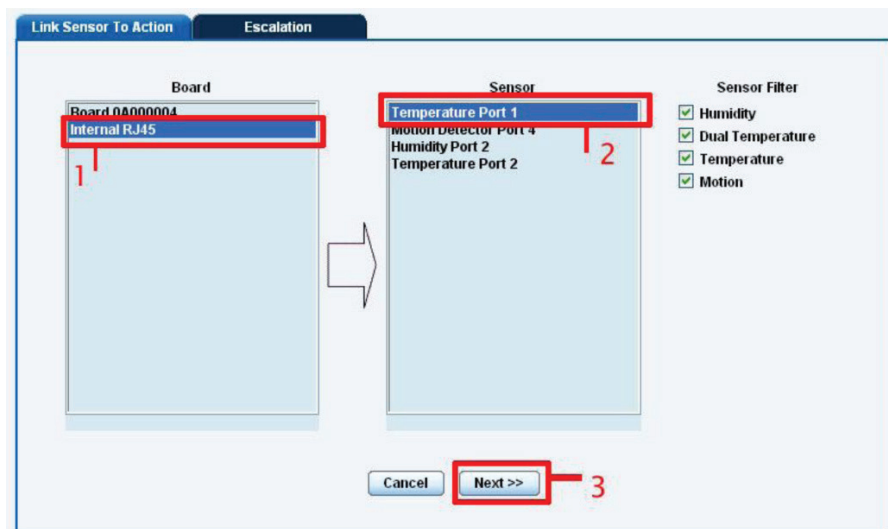


Figure 4-30. Steps 1-3.

- 4. Select the status you want to issue the alert for.
- 5. Select the action type.
- 6. Click "Finish."

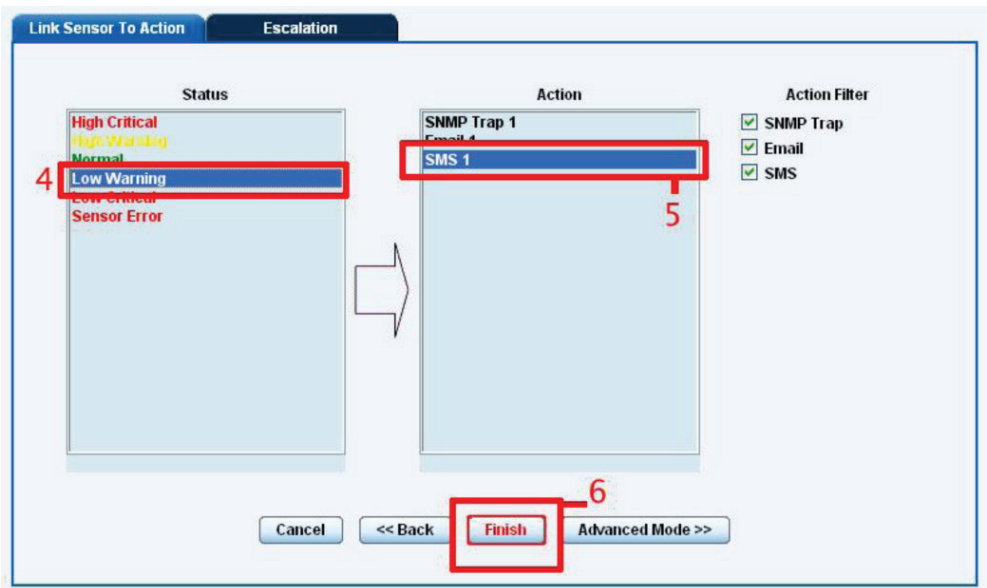


Figure 4-31. Steps 4–6.

- 13. You will now be back at the main notification page (Figure 4-32). The page should display three types of notifications: the SNMP trap, e-mail, and SMS.

Sensor Name		Action on Status		Action Name
Temperature Port 1		High Critical		SNMP Trap 7
Temperature Port 1		High Warning		Tutorial E-mail
Temperature Port 1		Low Warning		Tutorial SMS notification

▲ Click table cell to toggle selection.

Create Edit Remove

Figure 4-32. Main notification page.

For the purposes of this tutorial, we will not cover the setup of every type of notification. However, with this information you should be able to follow the procedure for the other types of notifications easily, as they all follow a similar format. If you have questions, contact Black Box Technical Support at 724-746-5500 or [info@blackbox.com](mailto:info@blackbox.com).



### 5. Mapping

The mapping feature allows instant visual feedback about a sensor's position and status. It is a useful monitoring tool for a setup with several sensors in different positions.

This tutorial provides you with the information needed to set up the mapping feature.

To get to the starting point of this tutorial:

- Log in as administrator.
- Click the "Map" tab.

#### 5.1 Adding a Map

1. First, we need to add a picture file to be used as the map. This can be a blueprint of your office, a 3D picture of your office/site being monitored, or a photo of the wiring closet you are monitoring.

*NOTE: The maximum map file size is 512 KB.*

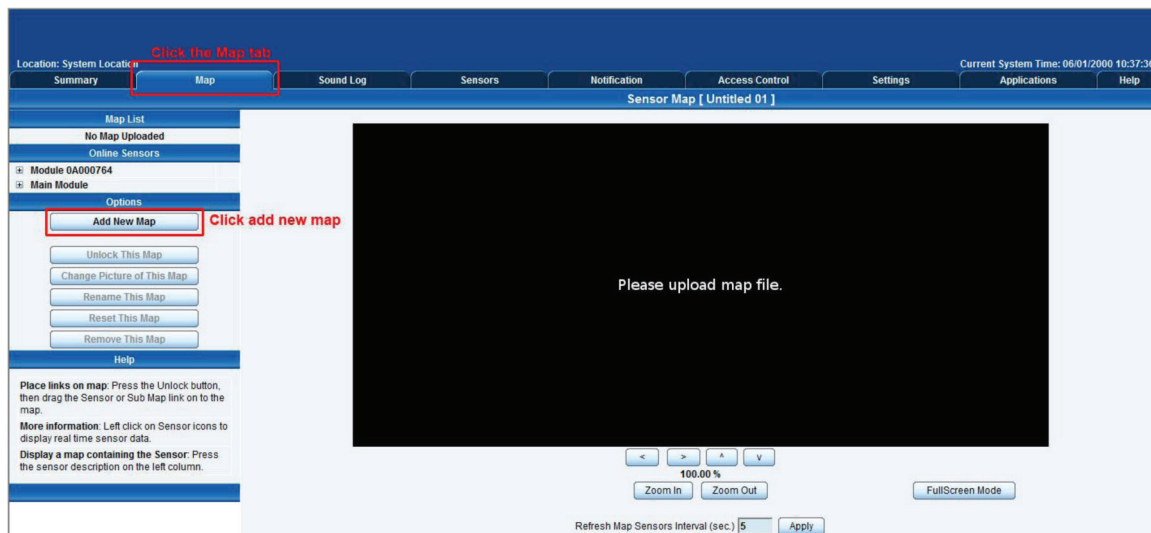


Figure 5-1. Click on the "Map" tab.

2. Browse to the file on your hard drive that you want to use.



Figure 5-2. Browse to selected file.

3. In this tutorial, we are going to use a 3D map of a town center we are monitoring.

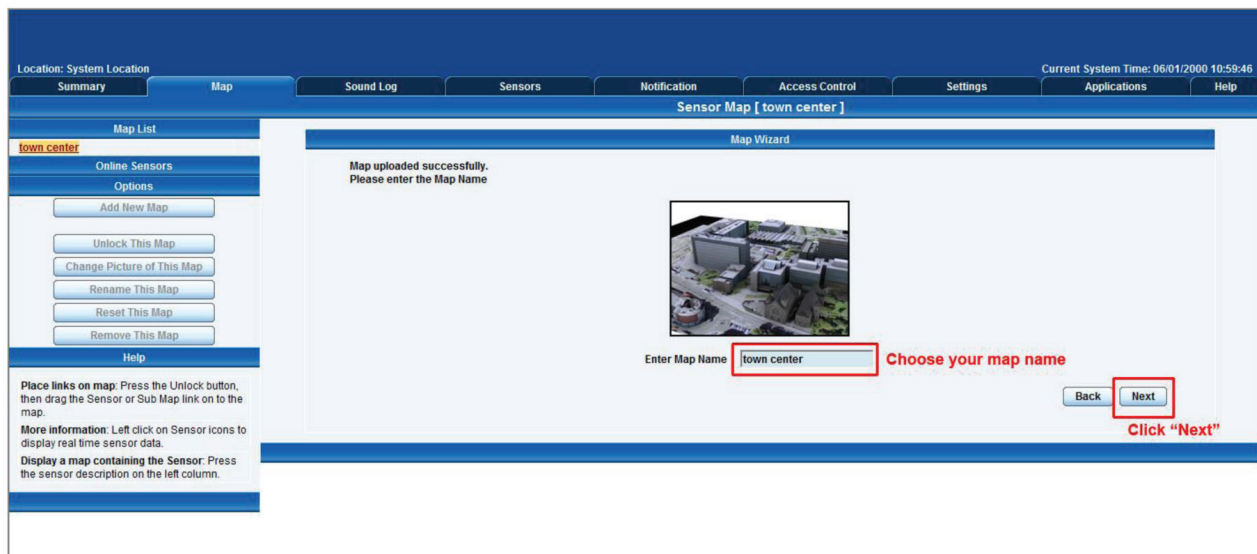


Figure 5-3. Enter map name.

4. Choose to have the map as a top-level map.



Figure 5-4. Enter map level.

5. You will now have the option to finish or to add sensors to your map. For this tutorial, click "Next."



Figure 5-5. "Finish" or "Next."

6. You will now be taken to the map page where it will display your map. To add sensors, click "Next."

## Chapter 5: Mapping

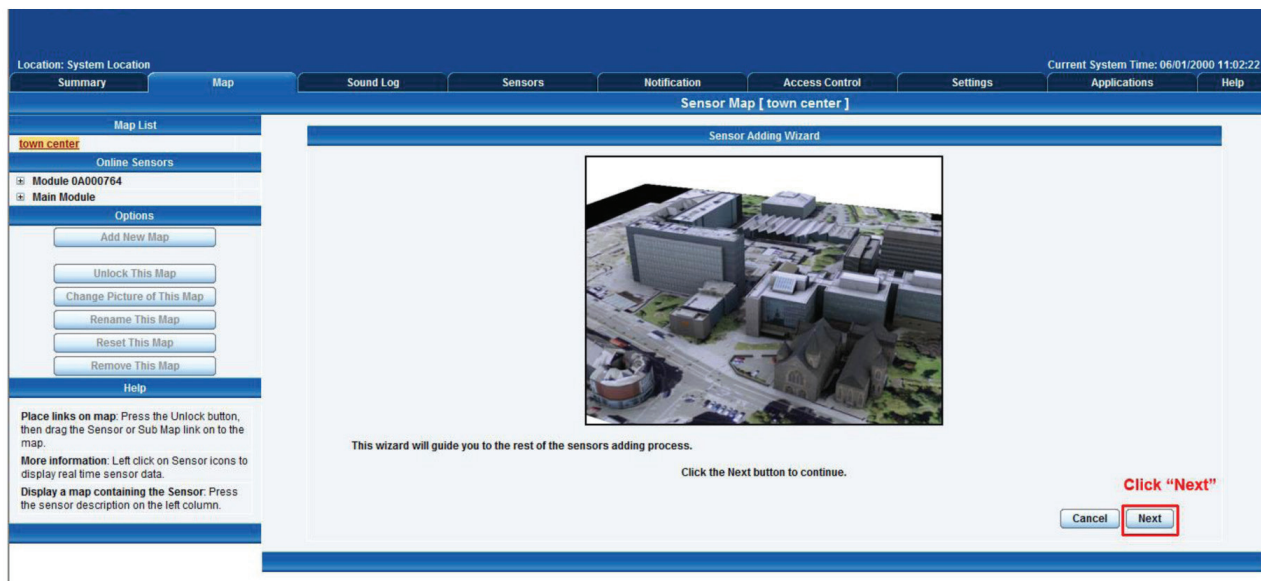


Figure 5-6. Sensor map.

7. After clicking "Next," click the "Unlock" button. This enables you to add sensors to the map.

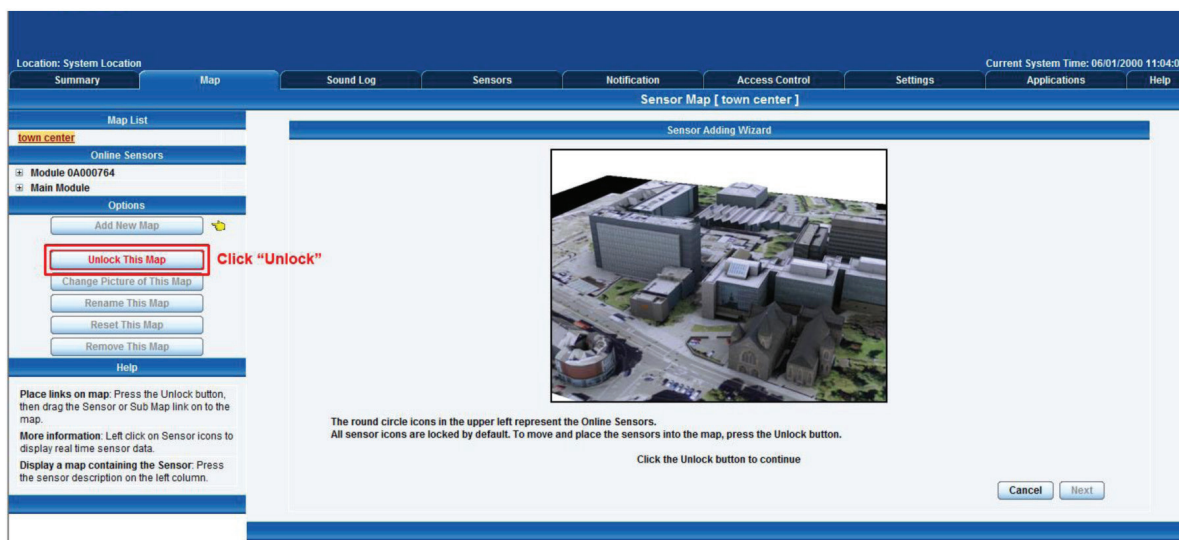


Figure 5-7. Add sensors to map.

8. You can now drag sensor icons and position them on the map.

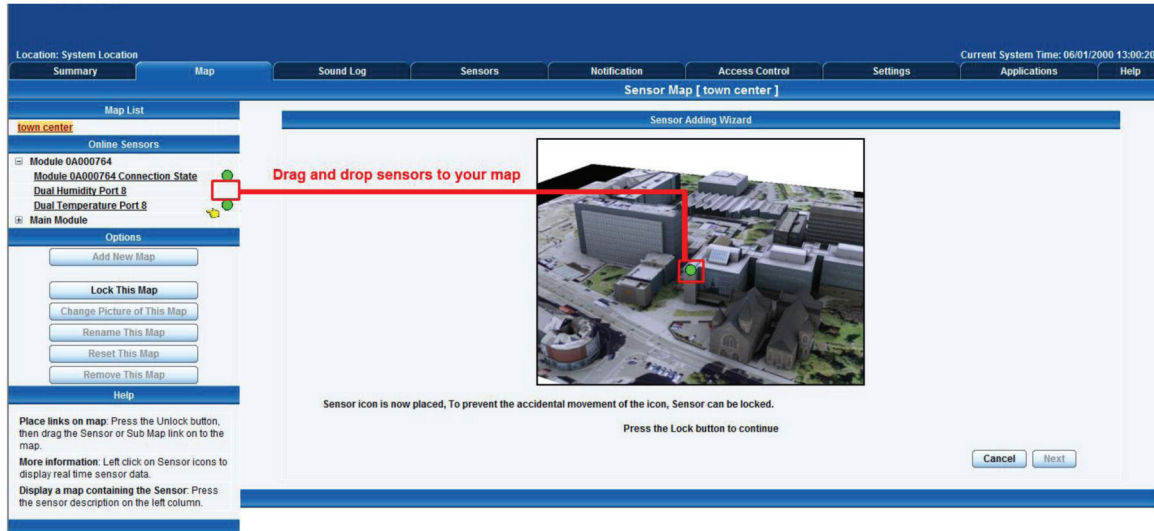


Figure 5-8. Position sensor icons on map.

9. After you have positioned the sensors in the correct location of your map, click "Lock."

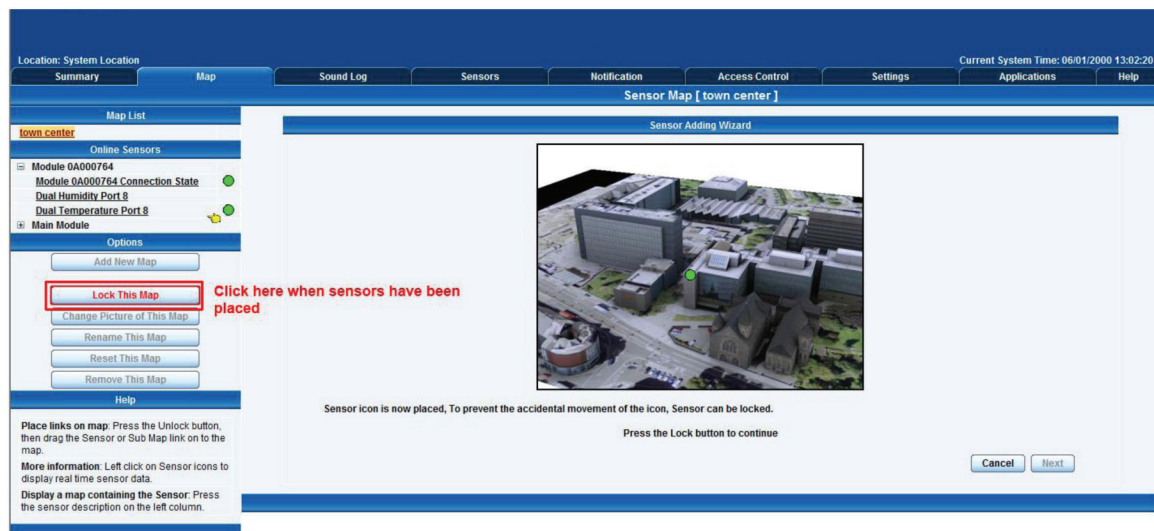


Figure 5-9. Click "Lock."

10. Finally you click on the "Finish" button to save your changes.

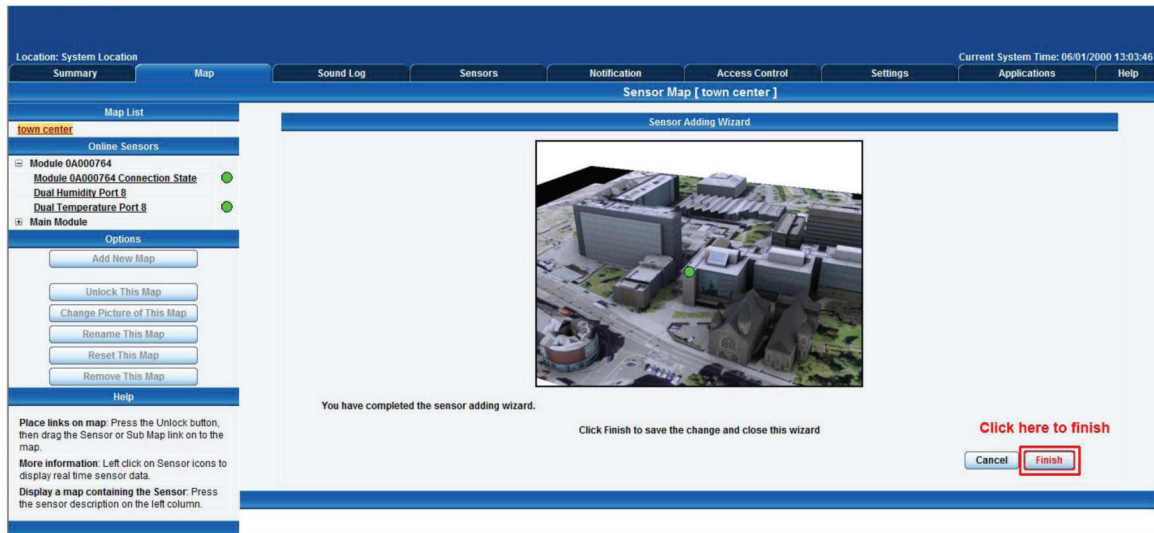


Figure 5-10. Save changes.

### 5.2 Monitoring via the Map Interface

Now we are going to look at how to monitor the sensor status and use the map interface.

1. To see further information about a sensor, you can click on its icon. First, you must click on the “Unlock Icons” button.

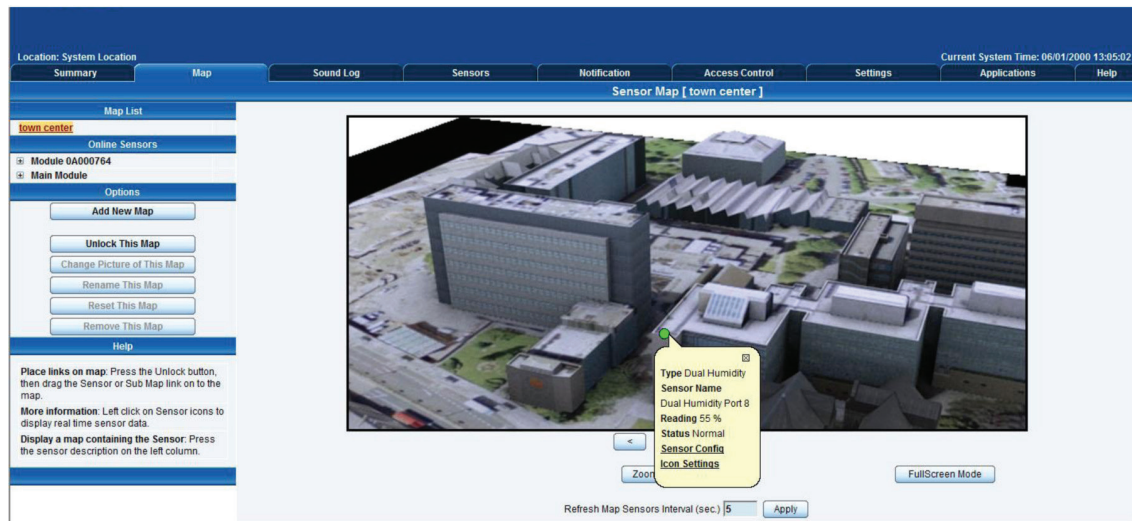


Figure 5-11. Using the map interface.

If you connect other sensors, these too can be dragged and positioned on the map.



## 6. Filters

### 6.1 Sensor Filters

1. The ServSensor comes equipped with the option to filter your sensor information that is displayed within the summary page. To enter the filter menu, select "Sensor Filters" from the drop-down tab on the left side of the page.



Figure 6-1. Select sensor filters.

2. Once you click the tab, you will be able to select your filter results by altering various fields of information contained within the sensor filter window.

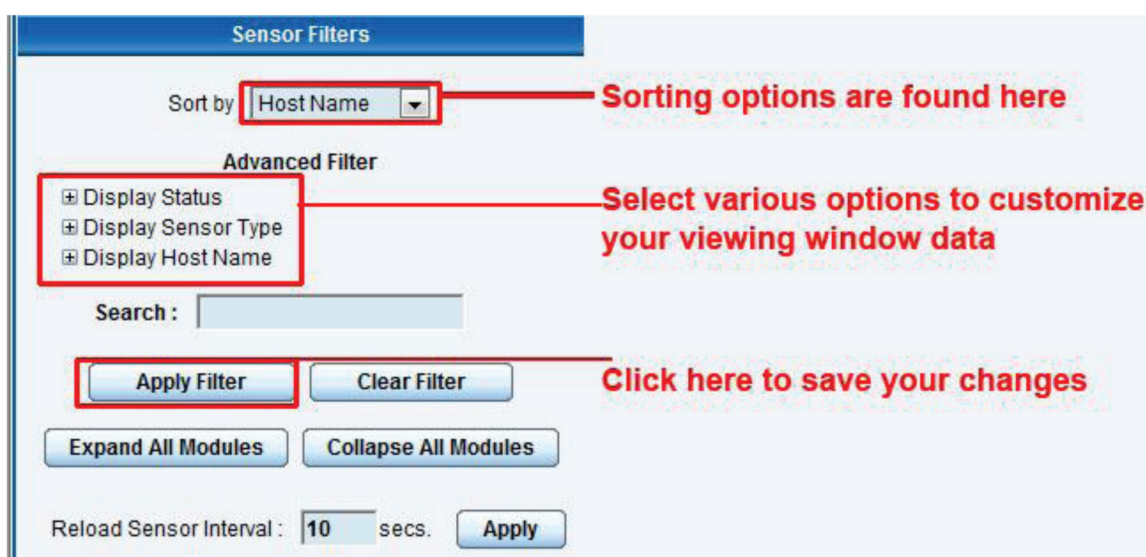


Figure 6-2. Add information fields.

## Chapter 6: Filters

3. You can alter the page reload interval by using these options.



Figure 6-3. Alter the page reload interval.

4. Once you have selected your preferred filter options, your new settings will be displayed in the “Sensor Information” window found on the Summary page.



Figure 6-4. Summary page.

### 6.2 Syslog Filters

Syslog filters enable you to customize your syslog window. To begin, select the “Syslog Filters” tab found on the summary page.

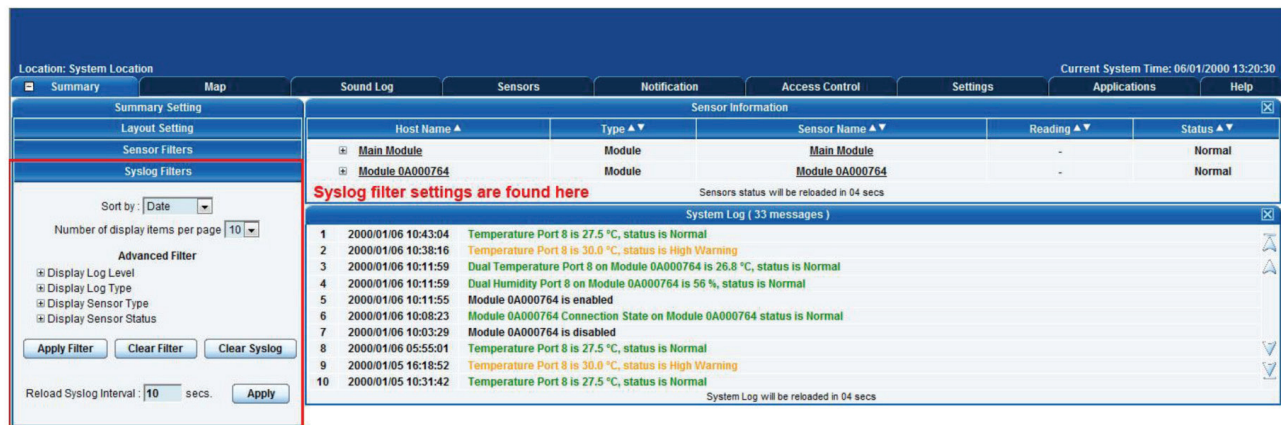


Figure 6-5. Syslog Filters tab.



Once you click the tab, you will be able to select your filter results by altering various fields of information contained within the syslog filter window.

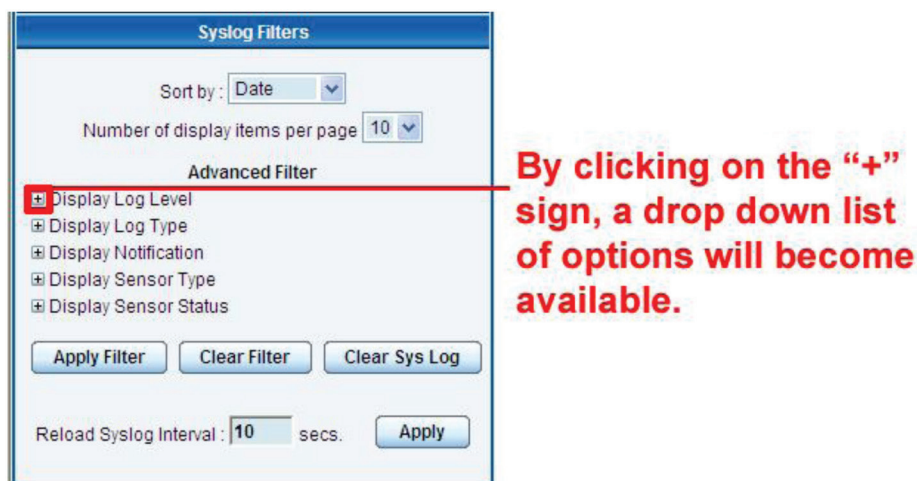


Figure 6-6. Drop-down menu.

By checking and unchecking various boxes within the Syslog filter window, you can customize your displayed results contained within the syslog filter.

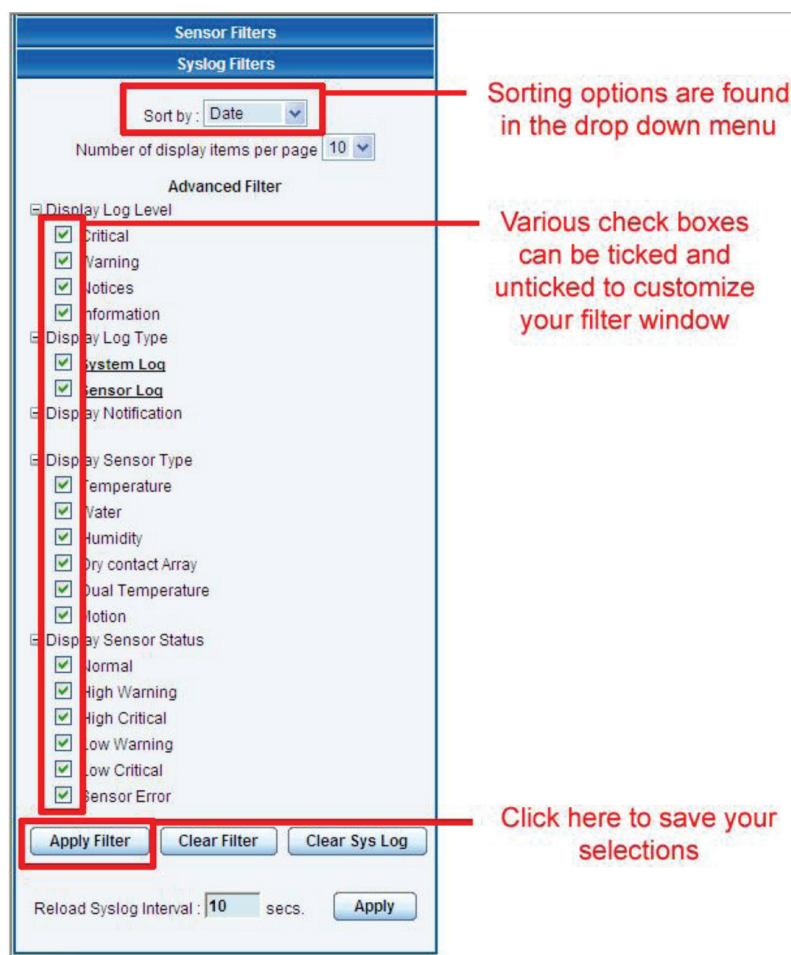


Figure 6-7. Customize syslog filter results display.

# Chapter 6: Filters

You can alter your reload interval by using the options shown below.



Figure 6-8. Change reload interval.

Once you have selected your preferred filter options, your new settings will be displayed in the “System log Information” window found on the Summary page.

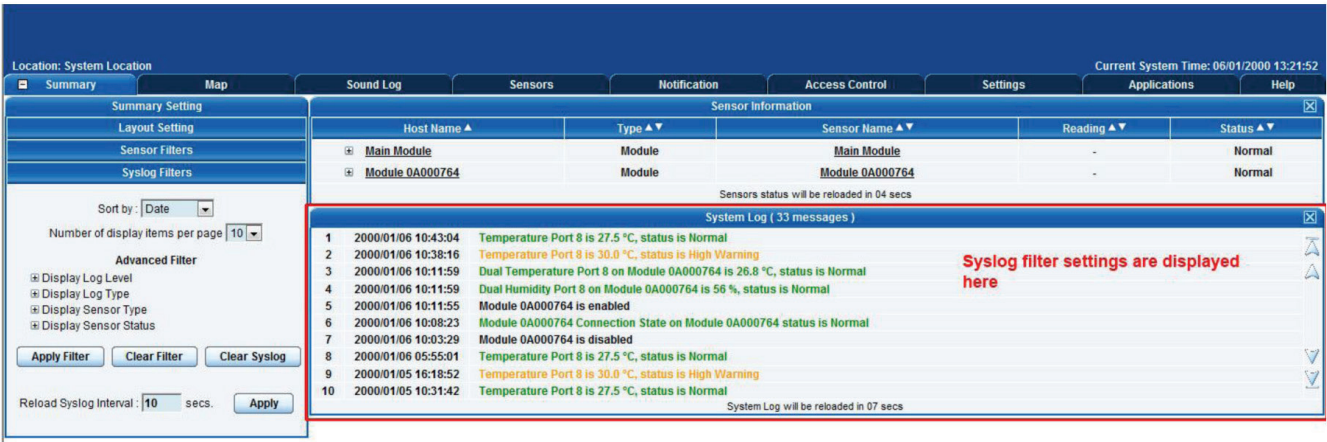


Figure 6-9. Saved syslog filters display.

### 7. Making the ServSensor Visible on the Internet

The setup we have just created will enable you to access your ServSensor V4E Lite on a local area network (LAN), monitor via the Web based interface, or with SNMP traps.

But, what if you want to be able to remotely access your unit from anywhere in the world? This is possible; however, the following steps are only a guide. Your exact setup and configuration will often depend on your network equipment. You are going to need access to your router, if you are using one, and know whether your IP address is static or dynamic.

1. Suppose your ServSensor is connected to a router on your network, and the following IP addresses are assigned:

Your unit's IP address is the default 192.168.0.100.

Your computer's IP address is 192.168.0.200

Your router's IP address is 192.168.0.300

2. To find out your router's external IP address, go to [www.whatsmyip.com](http://www.whatsmyip.com)

Suppose your router's external IP address is 278.67.04.09

3. You now need to set up port forwarding on your router. This varies depending on your router's model. Generally, you need to point your browser to your router's IP address (in this case 192.168.0.300). This will then enable you to log into your router's administration interface. You can find how to go about doing this for your router on [www.portforward.com](http://www.portforward.com)

For an example of how to do this for a commonly used router, follow this link :-[http://www.portforward.com/english/routers/port\\_forwarding/Linksys/WRT54G/HTTP.htm](http://www.portforward.com/english/routers/port_forwarding/Linksys/WRT54G/HTTP.htm)

You need to set up your router's HTTP forwarding to Port 80. This will then mean when you access your router using the external IP address, you will be forwarded to your unit's internal IP address.

4. To test this, open your Web browser, and go to your external IP address (in our example 278.67.04.09). If you're using a dynamic IP address, check it again before doing this because it may have changed since the start of this tutorial.

5. To make this easier, you could use a Dynamic Name Server (DNS). This means that you no longer need to remember IP addresses or use [www.whatsmyip.com](http://www.whatsmyip.com) to find out your IP address. You will instead register a domain name (for example ServSensorHub.homeip.com). This will then automatically point to your router's external IP address (e.g. 278.67.04.09). This will require you to register the domain name and open an account with a DNS service provider. We recommend [www.dyndns.com](http://www.dyndns.com) because it allows you to register up to five free domain names.

6. If you have set up everything correctly, you will now be able to access your unit from anywhere in the world simply by pointing your Web browser to your DNS address.

8. SEC to SEC SNMP Trap Receive

8.1 Introduction

The SNMP Trap Receiver is a feature that is included in the 80 Virtual Sensors in the ServSensor’s web interface. This feature allows you to receive an SNMP trap from another device such as a sensor or another SEC unit. This can also be used to turn on and off other sensors, trigger a relay, send alerts from the ServSensor unit and perform other actions.

This manual describes an example configuration using two SEC units: one will be the SNMP Trap Sender (A) and the other will be the SNMP Trap Receiver (B).

On the sender unit (A) there is a sensor configured: a temperature sensor.

The receiver unit (B) will be configured to listen for SNMP Traps from (A) unit’s temperature sensor using virtual sensors.

SNMP Traps are sent from (A) when the sensor status or its reading value changes.

8.2 SNMP Trap Sender (A) SEC (10.1.1.225) configuration

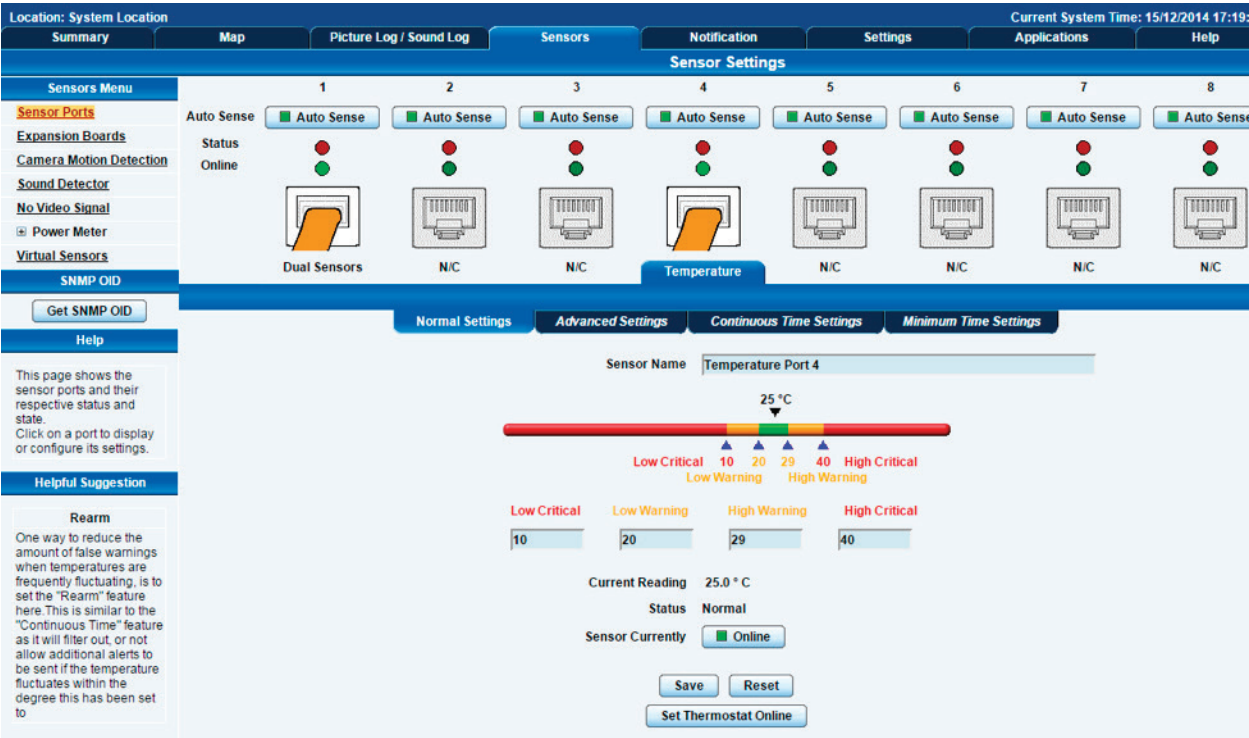


Figure 8-1.

First, make sure that the sensors are working properly and the readings are as desired. We will use the Temperature Sensor in our example.

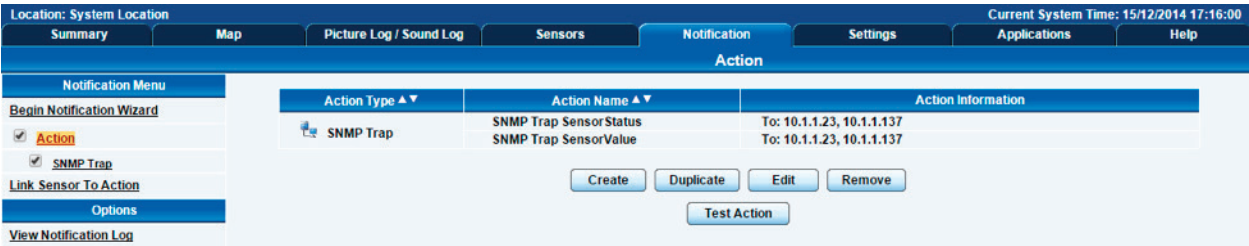


Figure 8-2.

Go to Notification / Action and click on the Create button to create SNMP Trap actions.

Figure 8-3.

Configure the SNMP Trap action:

- Give the SNMP Trap a name to easily identify it, in our example it's for sending Sensor Status traps.
- Select the Trap Version (v1 is the default).
- Specify the SNMP Trap sending port, if it's different from the default.
- Add the target (B) unit's IP address in the Destination Address field, and specify the Community if it's different from the default "public." You'll need to click the Add Trap Destination to add the IP address to the list. Add IPs one-by-one in the same way if multiple addresses are required.

*NOTE: We've also added our PC's IP address (10.1.1.23) to the list, to test the generated SNMP Traps. More on this later.*

- Click Next when you've finished adding the target IPs.

Figure 8-4.

## Chapter 8: SEC to SEC SNMP Trap Receive

*NOTE: We recommend that you choose the CustomType Traps from the list as the SNMP Trap Type, as it will always have the same "specific" number: 1000.*

- Because this SNMP Trap will be only used for sending Sensor Status events, select that from the list and unselect all others.

*NOTE: You can also select multiple values to have a single SNMP Trap for sending them.*


- Click Next to continue.



The screenshot shows the 'SNMP Trap Action Wizard' interface. At the top, there's a navigation bar with tabs: Summary, Map, Picture Log / Sound Log, Sensors, Notification (selected), Settings, Applications, and Help. Below the navigation bar, the 'Notification Menu' is visible on the left, with options like 'Begin Notification Wizard', 'Action', 'Edit Action', 'Link Sensor To Action', and 'Options'. The main area displays 'Maximum Times to Resend' set to 0 and 'Resend Intervals (secs)' set to 10. At the bottom right, there are 'Cancel', 'Back', and 'Finish' buttons.

Figure 8-5.

You may change the resend times and the interval between resending the SNMP Trap. Click on Finish to complete the SNMP Trap action's configuration.

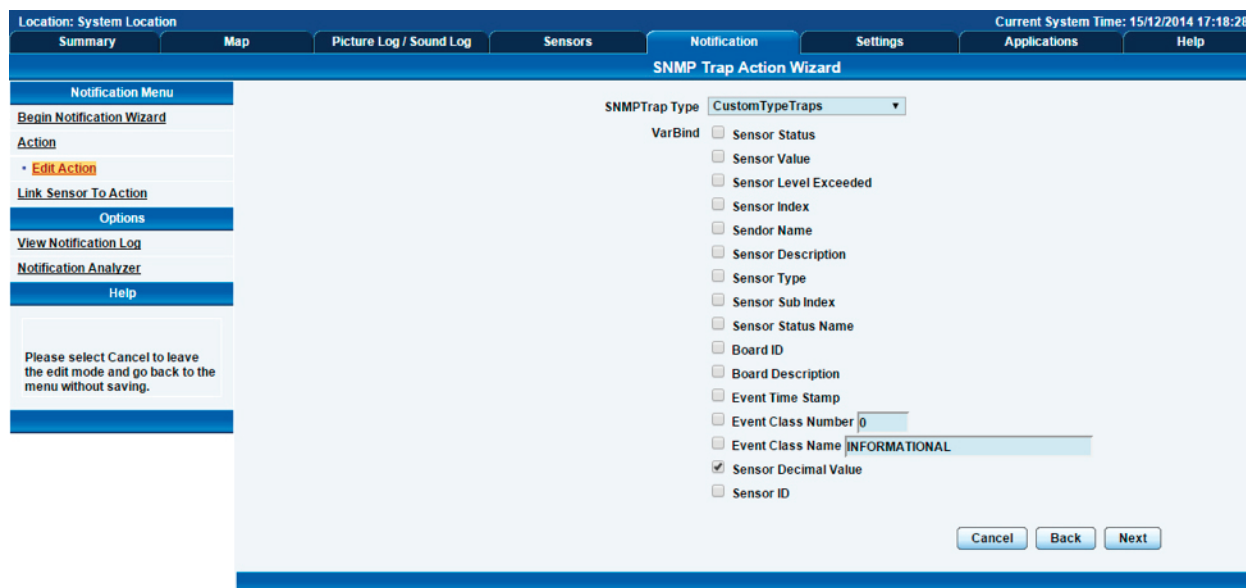

The screenshot shows the 'SNMP Trap Action Wizard' interface in the 'Notification' tab. The 'SNMPTrap Type' is set to 'CustomTypeTraps'. Under 'VarBind', several options are listed with checkboxes: Sensor Status, Sensor Value, Sensor Level Exceeded, Sensor Index, Sensor Name, Sensor Description, Sensor Type, Sensor Sub Index, Sensor Status Name, Board ID, Board Description, Event Time Stamp, Event Class Number (set to 0), Event Class Name (set to INFORMATIONAL), Sensor Decimal Value (checked), and Sensor ID. At the bottom right, there are 'Cancel', 'Back', and 'Next' buttons.

Figure 8-6.

As an example, we also configured a separate SNMP Trap action for the temperature sensor's value.

The configuration of the action is exactly the same as for the previous action (sensor status), the only difference is the Trap Type: here we choose the Sensor Decimal Value to send it to the target unit (B).



Location: System Location      Current System Time: 15/12/2014 17:14:41

Summary    Map    Picture Log / Sound Log    Sensors    **Notification**    Settings    Applications    Help

**Link Sensor To Action**

**Notification Menu**

- Begin Notification Wizard
- Action
- Link Sensor To Action**
- Options
- View Notification Log
- Notification Analyzer
- Help

This is an overview of all configured Sensor Action Links. From here you may create, edit and remove Sensor Action Links. Select your desired Sensor Action Link(s) before making a choice.

Each line should be descriptive. E.g. If Temperature in Store room Is High Critical Then E-mail Store Room Manager.

To disable or enable the notifications without having to delete them, in the Link Sensor To Action listing, just uncheck the checkbox to disable them or check the checkbox to enable them

Host Name	Sensor Name	Action on Status	Action Name
<input checked="" type="checkbox"/> Main Module	Temperature Port 4	<div>High Critical</div> <div>High Warning</div> <div>Normal</div> <div>Low Warning</div> <div>Low Critical</div> <div>Sensor Error</div>	SNMP Trap SensorStatus
<input checked="" type="checkbox"/> Main Module	Temperature Port 4	<div>High Critical</div> <div>High Warning</div> <div>Normal</div> <div>Low Warning</div> <div>Low Critical</div> <div>Sensor Error</div>	SNMP Trap SensorValue
<input checked="" type="checkbox"/> Main Module	Dual Humidity Port 1	<div>High Critical</div> <div>High Warning</div> <div>Normal</div> <div>Low Warning</div> <div>Low Critical</div> <div>Sensor Error</div>	SNMP Trap SensorStatus
<input checked="" type="checkbox"/> Main Module	Dual Humidity Port 1	<div>High Critical</div> <div>High Warning</div> <div>Normal</div> <div>Low Warning</div> <div>Low Critical</div> <div>Sensor Error</div>	SNMP Trap SensorValue

Create    Edit    Create Escalation    Remove

Import notification from file    Choose File    No file chosen    Import    Export

Figure 8-7.

After the SNMP Trap actions are made, you need to link the sensors to the SNMP Trap actions.

Go to Notification / Link Sensor To Action and click on the Create button.

As an example, here's our configuration for the Temperature Sensor Status SNMP Trap notification, which will send a Trap upon each status change of the sensor:



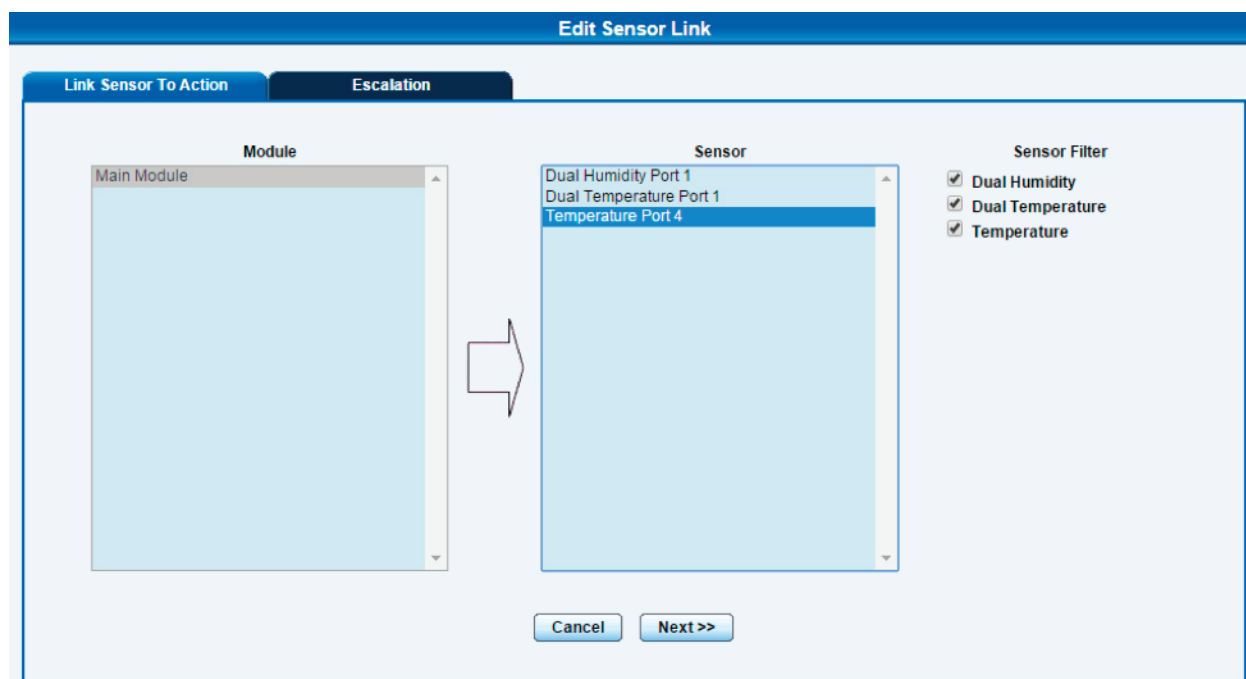


Figure 8-8.

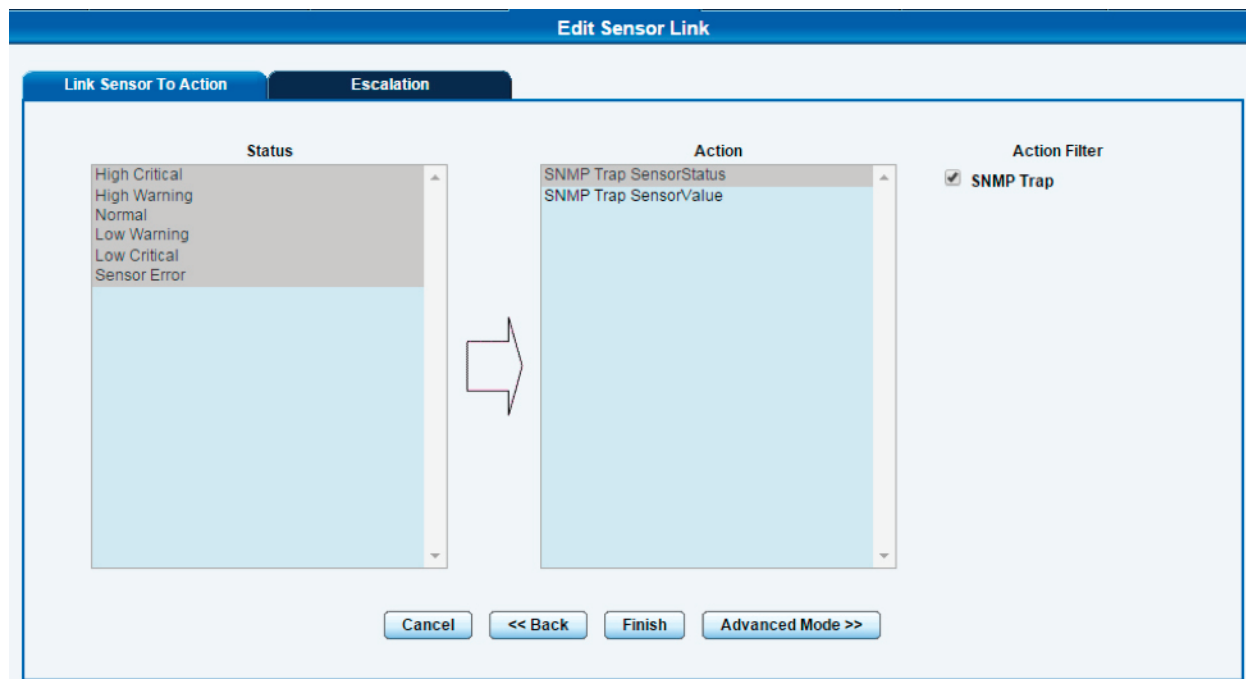


Figure 8-9.

You may select the Sensor Status as desired, for example, if you only want to send SNMP Trap when the sensor status is High Critical and Low Critical, only select those here.

For creating the Temperature Sensor Value SNMP Trap, the configuration is the same; just select that action in the last step.

*NOTE: You'll need to create notification rules for each sensor that you want to send an SNMP Trap about.*

System Log ( 2000 messages )		
1	2014/12/14 08:50:32	Trap ok: Sent to 10.1.1.137
2	2014/12/14 08:50:32	Trap ok: Sent to 10.1.1.23
3	2014/12/14 08:50:32	Trap ok: Sent to 10.1.1.137
4	2014/12/14 08:50:32	Trap ok: Sent to 10.1.1.23
5	2014/12/14 08:50:32	Temperature Port 4 is 29.0 °C, status is High Warning
6	2014/12/14 08:50:31	Trap ok: Sent to 10.1.1.137
7	2014/12/14 08:50:31	Trap ok: Sent to 10.1.1.23
8	2014/12/14 08:50:31	Trap ok: Sent to 10.1.1.137
9	2014/12/14 08:50:31	Trap ok: Sent to 10.1.1.23
10	2014/12/14 08:50:31	Temperature Port 4 is 28.5 °C, status is Normal

System Log will be reloaded in 03 secs

Figure 8-10.

To verify that the SNMP Trap sending is working, you can check the System Log entries and the SNMP Trap log on the sender unit (A):

Location: System Location

Summary
Map
Picture Log / Sound Log
Sensors
Notification

View Notification Log

Notification Menu

View last log for SNMP Trap

Begin Notification Wizard

Action

Link Sensor To Action

Options

View Notification Log

Notification Analyzer

Help

This page displays a log of all recently complete notifications

Select an Action Type to view Notifications related to that type.

trap.log

2014/12/22 09:20:20 : begin send trap to 10.1.1.23  
2014/12/22 09:20:20 : begin send trap process  
2014/12/22 09:20:20 : trap send to 10.1.1.23 ok  
2014/12/22 09:20:20 : begin send trap to 10.1.1.137  
2014/12/22 09:20:20 : begin send trap process  
2014/12/22 09:20:20 : trap send to 10.1.1.137 ok  
2014/12/22 09:20:20 : begin send trap to 10.1.1.23  
2014/12/22 09:20:20 : begin send trap process  
2014/12/22 09:20:20 : trap send to 10.1.1.23 ok  
2014/12/22 09:20:20 : begin send trap to 10.1.1.137  
2014/12/22 09:20:20 : begin send trap process  
2014/12/22 09:20:20 : trap send to 10.1.1.137 ok

Figure 8-11.

Under Notification / View Notification Log, select SNMP Trap log from the drop-down menu.

8.3 Getting OIDs for the SNMP Traps

Before setting up the SNMP Trap receiver on the target unit (B), you'll need to get the correct sensor OIDs from the sender unit (A).

Use an MIB Browser application, such as iReasoning MIB Browser. We'll show you the steps using this program.

First, you must load the MIB file (downloadable from blackbox.com). Then specify the sender unit's IP (A) in the Address field (in our example, it's 10.1.1.225).

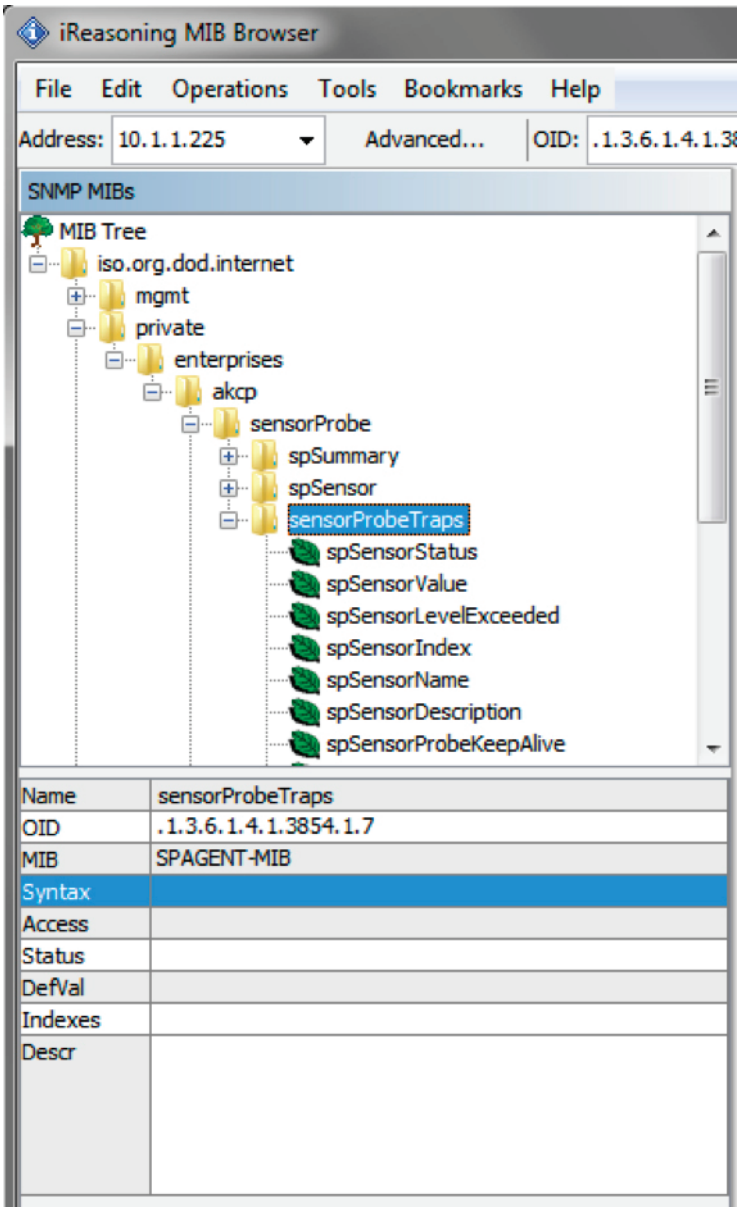


Figure 8-12.

Expand the MIB Tree until you reach the ServSensor's Traps section, as in the picture.

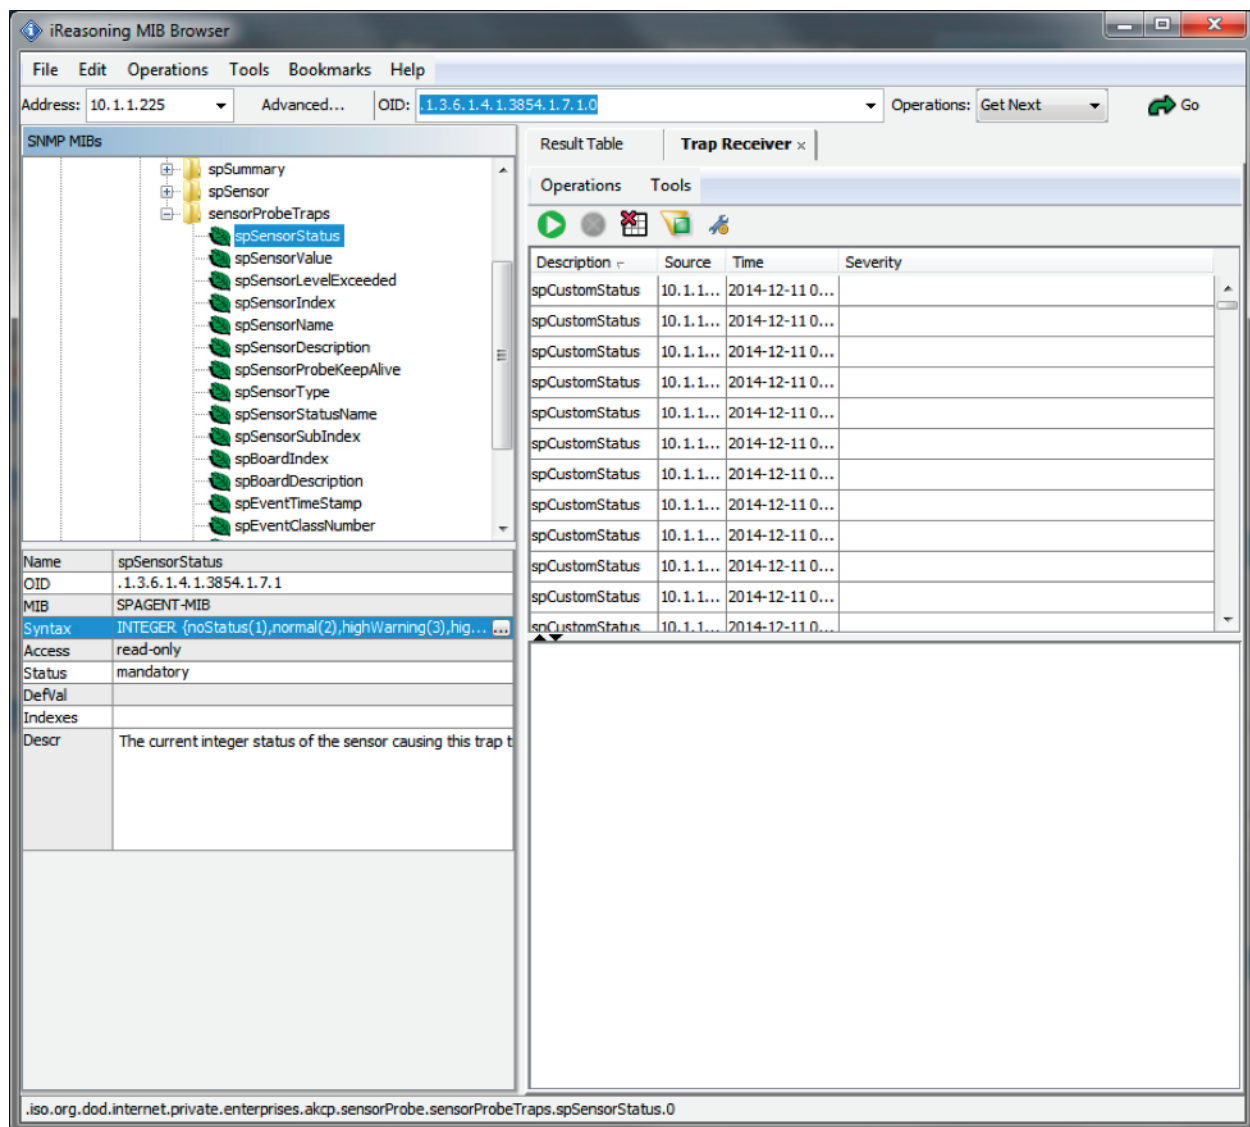


Figure 8-13.

Next, choose the OID value that you need to get the SNMP Trap from the sender unit (A).

In our example, we choose spSensorStatus to get Status SNMP Traps.

For the spSensorStatus it will be .1.3.6.1.4.1.3854.1.7.1.0

Copy the OID from the top of the window (OID: field), next to where you typed the sender (A) unit's IP.

*NOTE: For the Syntax field, these values will be needed to configure the virtual sensor on the target unit (B). For the spSensorStatus OID, these are valid:*

INTEGER {noStatus(1), normal(2), highWarning(3), highCritical(4), lowWarning(5), lowCritical(6), sensorError(7), turnOn(8), turnOff(9)}

## Chapter 8: SEC to SEC SNMP Trap Receive

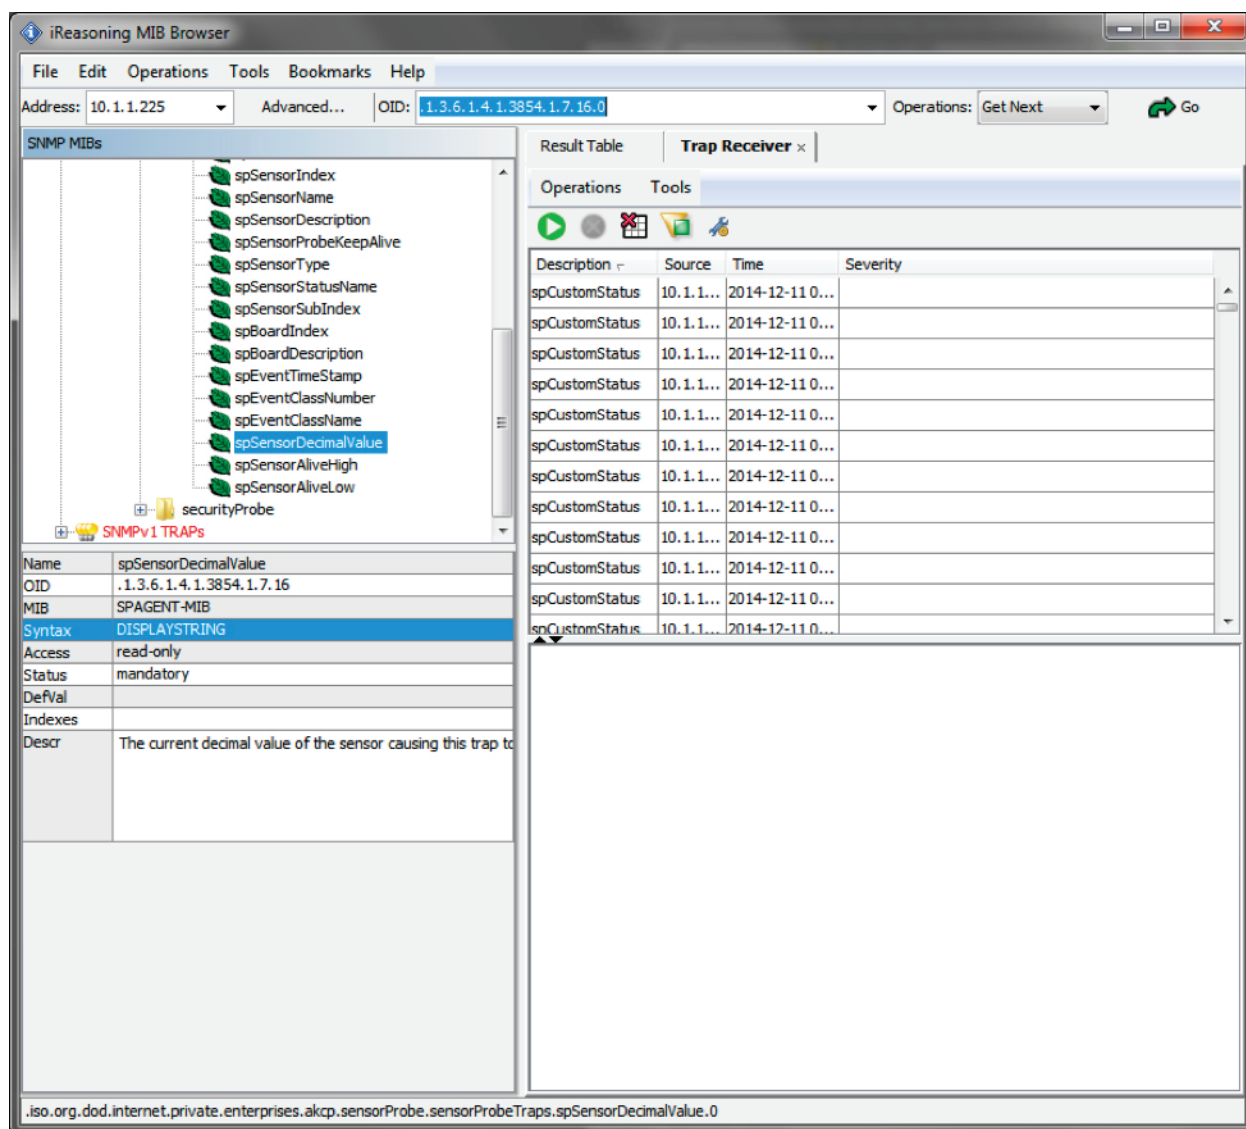


Figure 8-14.

We also set up SNMP Trap for the Temperature sensor's Value reading, so we will also need the spSensorDecimalValue OID from the MIB browser.

The OID for spSensorDecimalValue will always be: 1.3.6.1.4.1.3854.1.7.16.0

Similar to the spSensorStatus OID, you need to copy the OID from the top of the window (OID: field), next to where you typed the sender (A) unit's IP.

If you need other OIDs, note them similarly.

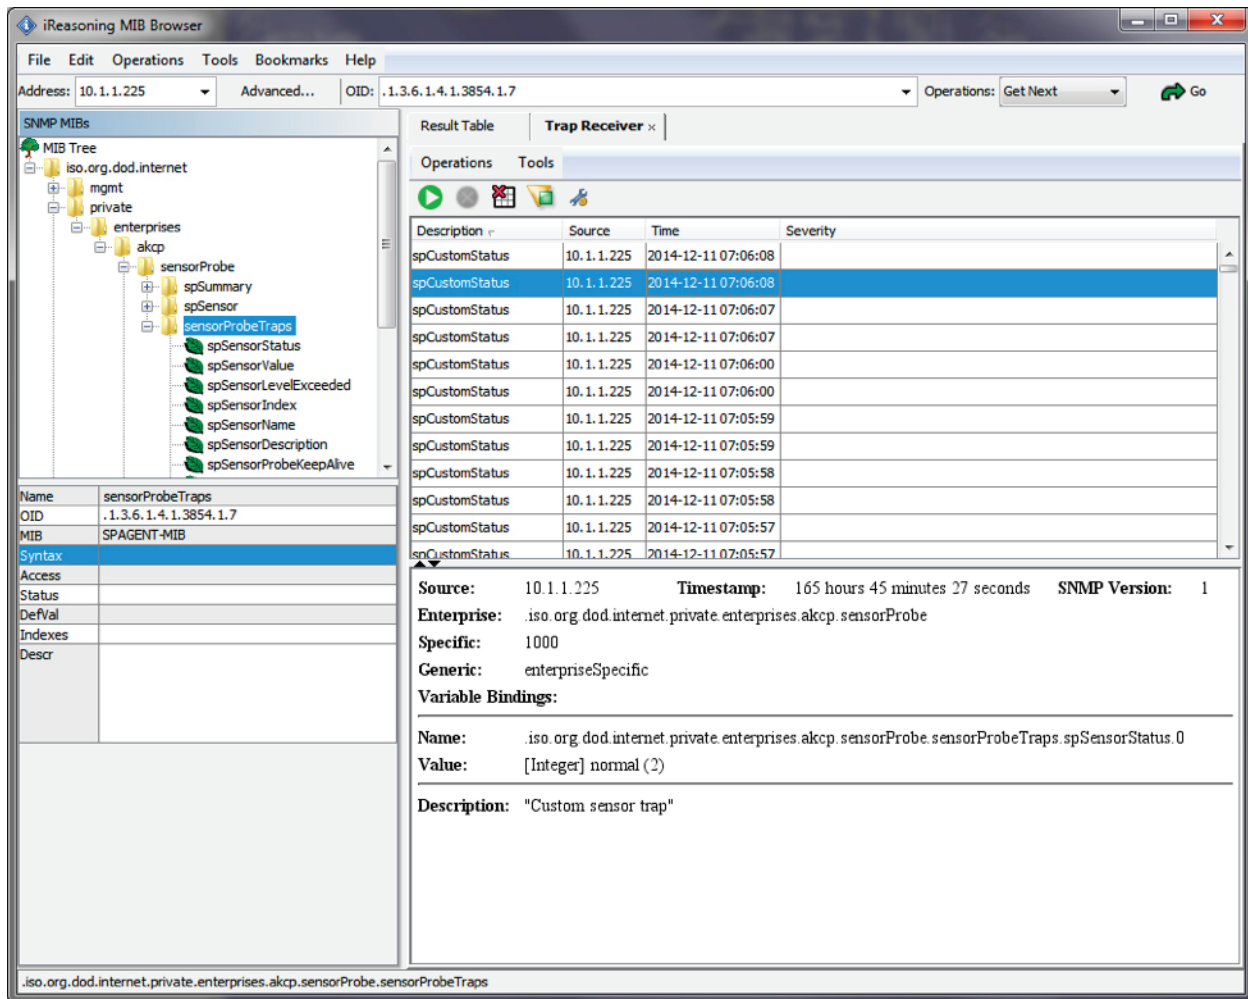


Figure 8-15.

You may also test the SNMP Trap action using iReasoning MIB Browser.

Use the Trap Receiver from Tools / Trap Receiver.

The Trap Receiver will start automatically, and display the results on the right side of the window.

Use the Test Action button on the sender unit (A) WEB UI to initiate an SNMP Trap:



Figure 8-16.

*NOTE: You must specify your PC's IP address in the configuration of the SNMP Trap action, otherwise, you won't see the Trap.*



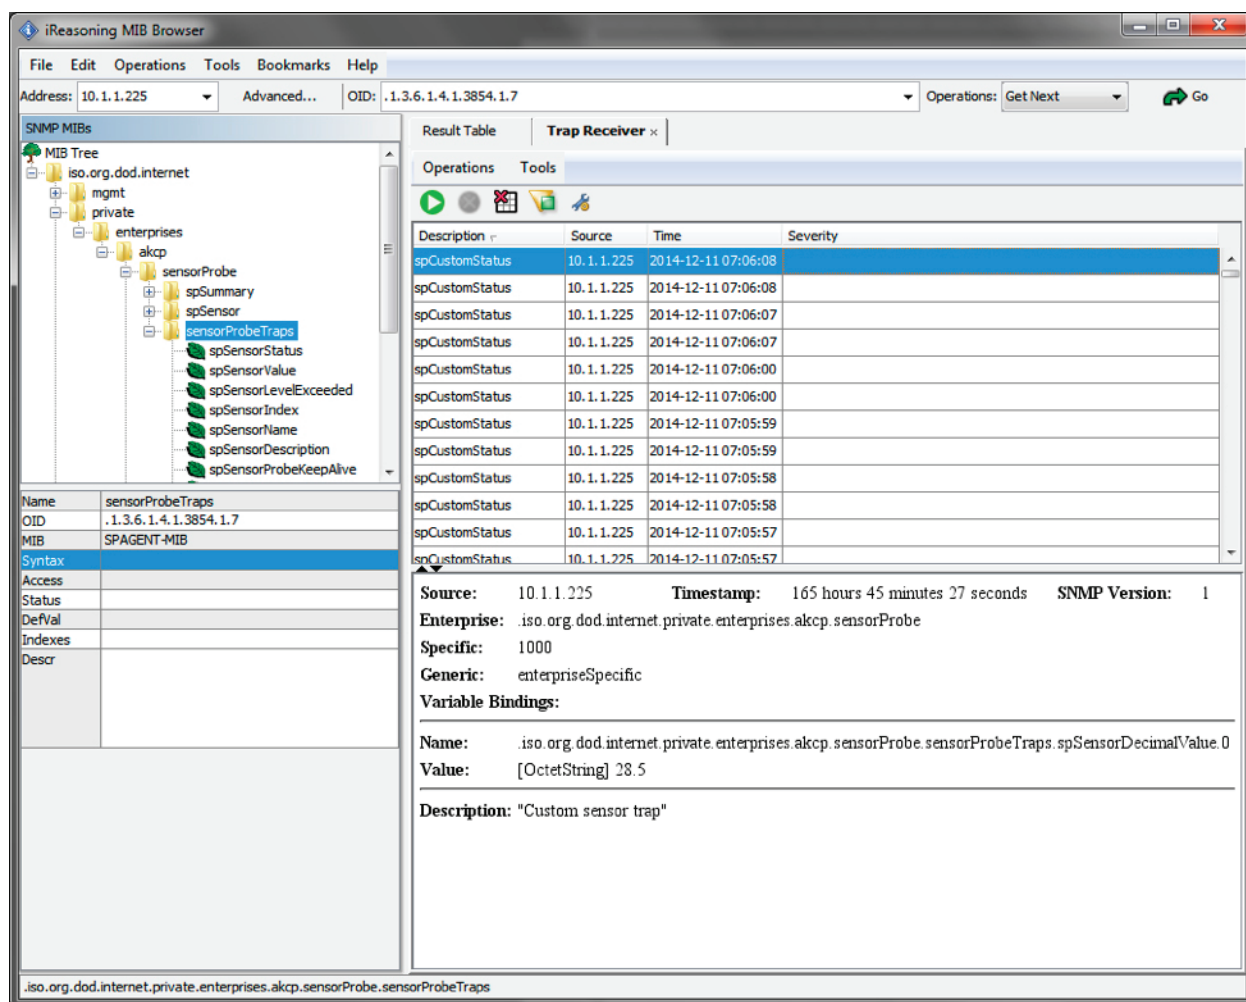


Figure 8-17.

Here is an example result window for the `spSensorDecimalValue` (and in the previous picture, the `spSensorStatus` was shown).



## 8.4 SNMP Trap Receiver (B) SEC (10.1.1.137) Configuration

Location: System Location      Current System Time: 17/12/2014 16:09:08

Summary   Map   Picture Log / Sound Log   Sensors   Notification   **Settings**   Applications   Help

**SNMP Traps**

**Setup**

- General
  - System Date and Time
  - Guest Page
  - Guest Page Video
- Enable Cameras
  - Camera Names
  - Image Size
  - PTZ Controller
- Connectivity
  - Ethernet Network
  - Modbus
  - SNMP**
    - SNMP Traps**
    - Bluetooth
    - Dial-In Modem
    - Dial-Out Modem
    - OpenVPN Client

Enable Version of SNMP Traps Receiver

☒ V1   ☒ V2c   ☒ V3

SNMP Trap port: 162   Available Port

SNMPv1 Community: public

SNMPv3 User Name: myuser

SNMPv3 engineID: 0x800000001020304

Security Level: Authentication & Encryption

Authentication Protocol: SHA

Authentication Protocol Pass Phrase: \*\*\*\*\*

Confirm Authentication Protocol Pass Phrase: \*\*\*\*\*

Privacy Protocol: AES

Privacy Protocol Pass Phrase: \*\*\*\*\*

Confirm Privacy Protocol Pass Phrase: \*\*\*\*\*

Save   Reset

Figure 8-18.

Go to Settings / Connectivity / SNMP Traps page, and ensure the SNMP Traps Receiver versions are enabled as shown above. You may change the SNMP community, SNMP v3 settings, and the SNMP port if you wish.

*NOTE: The SNMP Trap receiver is turned on by default.*

Location: System Location      Current System Time: 17/12/2014 16:03:43

Summary   Map   Picture Log / Sound Log   **Sensors**   Notification   Settings   Applications   Help

**Virtual Sensors**

**Sensors Menu**

- Sensor Ports
- Expansion Boards
- Sound Detector
- No Video Signal
- Power Meter
  - Add Meter
  - Graph
- Virtual Sensors**

This page shows the Remote Sensor ports. The Remote Sensors are virtual sensors that can run SNMP get commands, Ping IP addresses, run Custom Scripts, integrate MODBUS, and more.

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40
41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60
61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80

Figure 8-19.

# Chapter 8: SEC to SEC SNMP Trap Receive

Open the Sensors / Virtual Sensors page to begin configuring the virtual sensors.

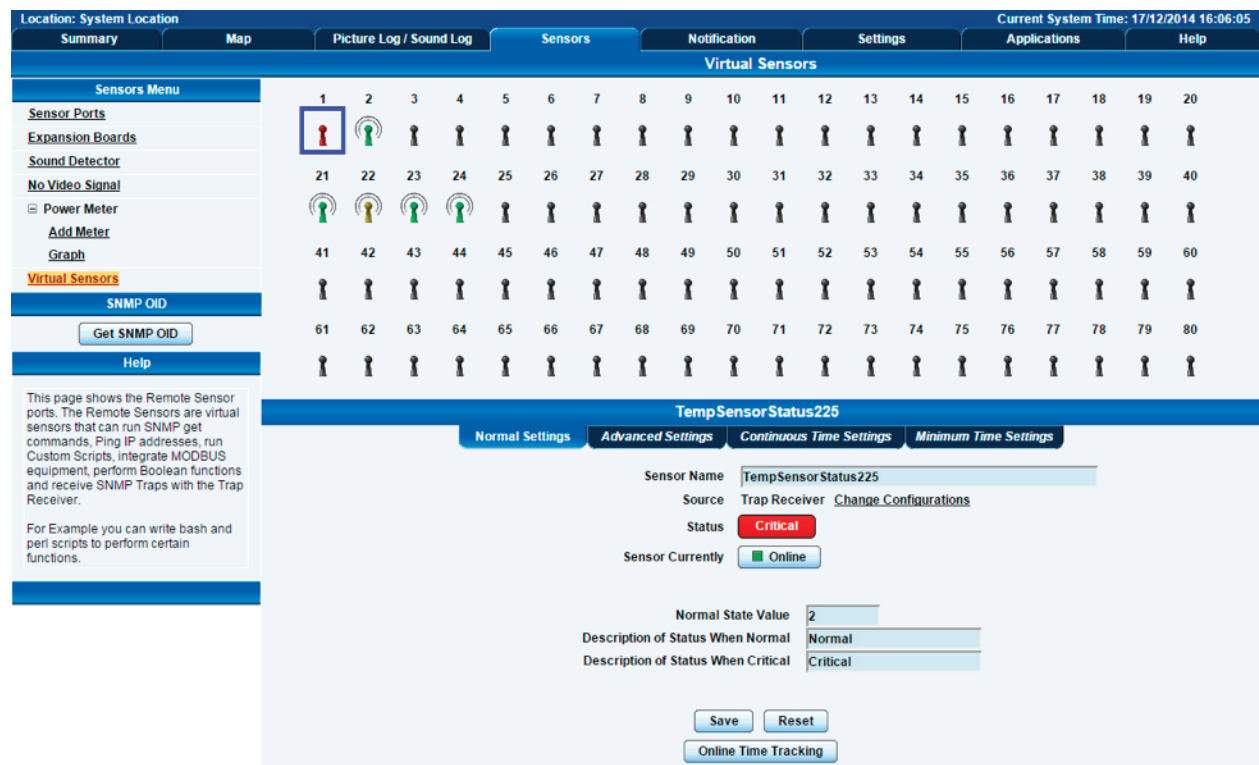


Figure 8-20.

In our first example, here is the configured SNMP Trap receiver virtual sensor on the target SEC (B). It shows the status of the Temperature Sensor on the source SEC (A).

To set up the SensorStatus SNMP Trap receiver, follow these steps:



Figure 8-21.

Choose an unconfigured virtual sensor, click on the Configuration button, then select the Source as Trap Receiver.

The screenshot shows a configuration window titled "TempSensorStatus225". It contains a table of settings for an SNMP Trap Receiver. The settings are as follows:

SNMPTrap Receiver setting	
IP Address	10.1.1.225
OID	.1.3.6.1.4.1.3854.1.7.1.0
Specific (0 for Trap version 3)	1000
Sensor Style	Switch ▼
Normal State Value	2
Description of Status When Normal	Normal
Description of Status When Critical	Critical

At the bottom right of the window are three buttons: "Cancel", "Back", and "Finish".

Figure 8-22.

Configure the following:

- IP: the source SEC unit's IP (A)
- OID: the sensor's OID value that you wish to get the SNMP Trap about; in our example it's spSensorStatus, to get the correct OID you have to use an MIB Browser as mentioned before.
- Specific: except for SNMP Trap v3, it will be always 1000 if you configured the SNMP Trap sender action using the custom settings on the source SEC (A) as recommended earlier; otherwise, you'll have to use a Trap Receiver first, to get the correct "specific" value from an SNMP Trap packet sent to your PC.
- Sensor style: Switch or Analog, depending on the sensor; for the Sensor Status it's Switch.
- Normal State Value: the virtual sensor will display "normal" when this status is received in the SNMP Trap packet. Unless you need another value, the default is 2 (see all other values earlier, as mentioned at the MIB browser section).
- Description for statuses: as desired.

Click Finish when you've completed the configuration.

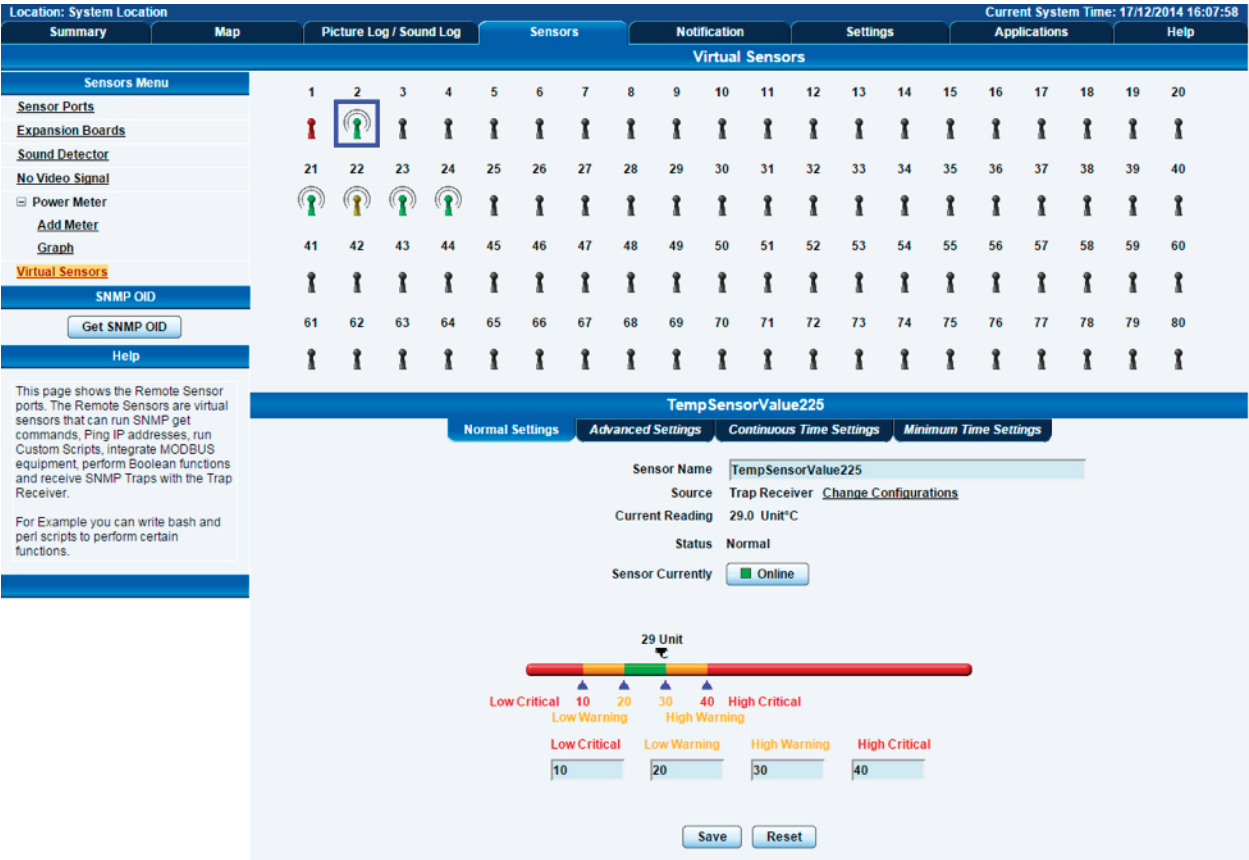


Figure 8-23.

Second example: the configured SNMP Trap receiver virtual sensor on the target SEC (B) from the Temperature Sensor’s decimal value on the source SEC (A).

To set up the SensorValue receiver, follow these steps:

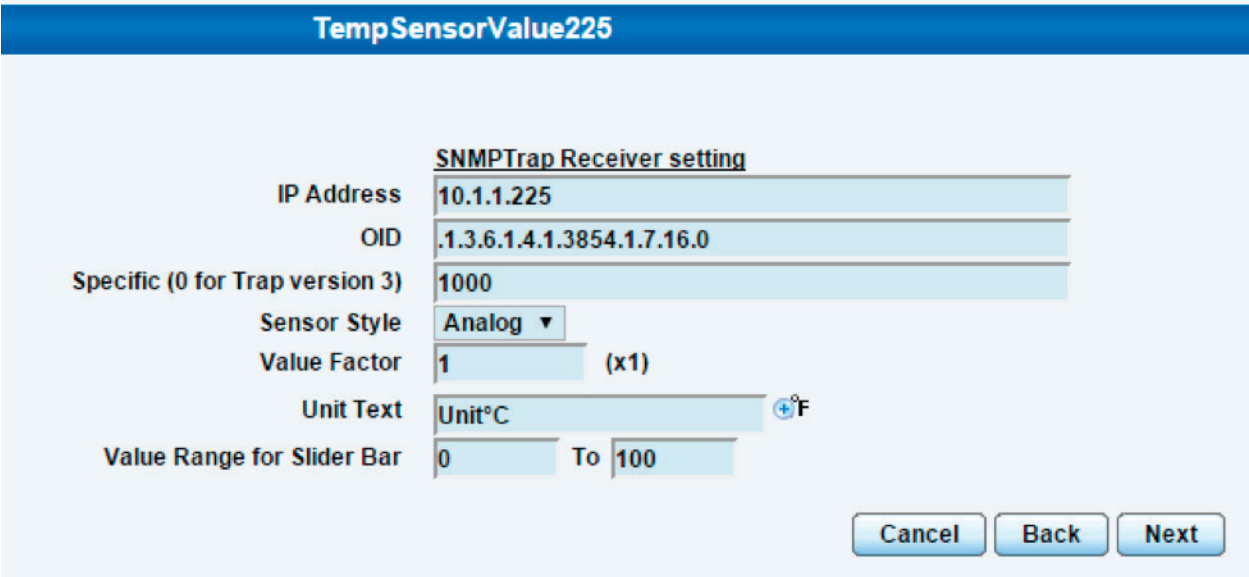


Figure 8-24.

Select Trap Receiver as in the previous configuration, and then fill out the values:

- IP address of the source SEC (A)
- OID: the sensor's OID value that you wish to get the SNMP Trap about; in this example it's spSensorDecimalValue, to get the correct OID you have to use an MIB Browser as mentioned before.
- Specific: except for SNMP Trap v3, it will always be 1000 if you configured the SNMP Trap sender action using the custom settings on the source SEC (A) as recommended earlier; otherwise, you'll have to use a Trap Receiver first, to get the correct "specific" value from an SNMP Trap packet sent to your PC.
- Sensor style: Switch or Analog, depending on the sensor; for the Sensor Value it's Analog.
- Value factor: if you wish to multiply the reading, specify here.
- Unit Text: the unit of the sensor reading; it could be anything, it's not limited to the built-in units.
- Value Range: the range scale where the sensor readings will be interpreted.

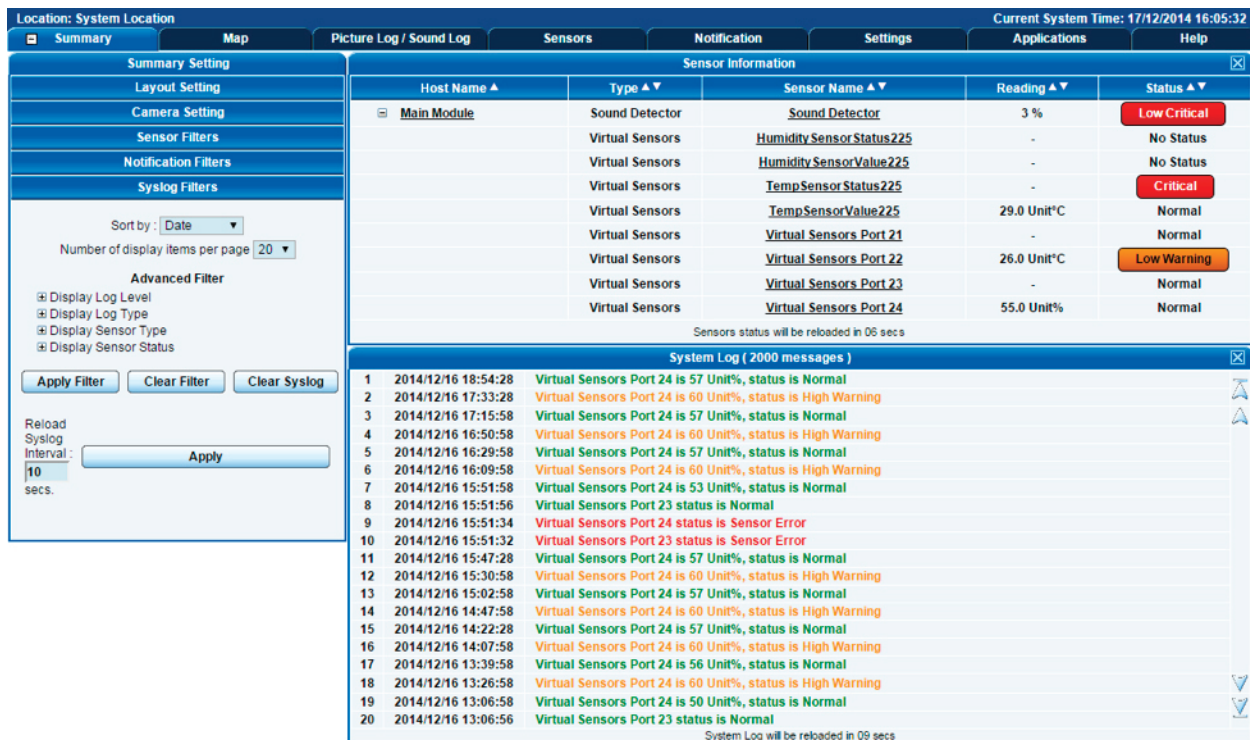


Figure 8-25.

An overview of the Summary page on the target SEC unit (B), showing the virtual sensors and the recorded System Log messages for virtual sensor status changes by SNMP Traps coming from the source SEC unit (A).

*NOTE: There will be no SNMP Trap events recorded in this unit's SNMP Trap log. These are only logged in the source unit (A).*

After configuring the virtual sensors properly, you can create custom actions on the target SEC (B) depending on the statuses of the virtual sensors, just like you would with any other type of sensors.

Contact Black Box Technical Support at 877-877-2269 or info@blackbox.com if you have any further technical questions or problems.

### 9. SNMP Trap Receiver Controlling IO-digital8 Relay

What is the SNMP trap and IO-digital8?

The SNMP Trap Receiver is a feature that is included in the 80 Virtual Sensors in the ServSensor's web interface. This feature allows you to receive an SNMP trap from another device. This can be used to trigger a relay, as this manual will describe. This can also be used to turn on and off other sensors, send alerts from the ServSensor unit and perform other actions.

The IO-digital8 is an 8-port dry contact sensor that uses a single RJ-45 sensor port on the ServSensor. Each of the 8 ports can be configured as an input or an output up to 5 VDC and can sink 20 mA.

#### 1. Enable SNMP Trap Receiver.

Location: Bangkok

Summary Map Picture Log / Sound Log Sensors Notification Settings

Setup

General

System Date and Time

Guest Page

Guest Page Video

Enable Cameras

Camera Names

Image Size & Quality

PTZ Controller

Connectivity

Ethernet Network

Wifi Network

Modbus

SNMP

SNMPTraps

Bluetooth

Dial-In Modem

Dial-Out Modem

Serial to Network Proxy

Enable Version of SNMP Traps Receiver

SNMP Trap port

SNMPv1 Community

SNMPv3 User Name

SNMPv3 engineID

Security Level

Authentication Protocol

Authentication Protocol Pass Phrase

Confirm Authentication Protocol Pass Phrase

Privacy Protocol

Privacy Protocol Pass Phrase

Confirm Privacy Protocol Pass Phrase

Save Reset

Figure 9-1.

First, open the ServSensor's web interface, login as Admin and navigate to the Settings page >> Connectivity >> SNMP Traps page.

Make sure the SNMP Traps Receiver versions are enabled as shown above.



## 2. Set up the Trap Receiver in 80 virtual sensors.

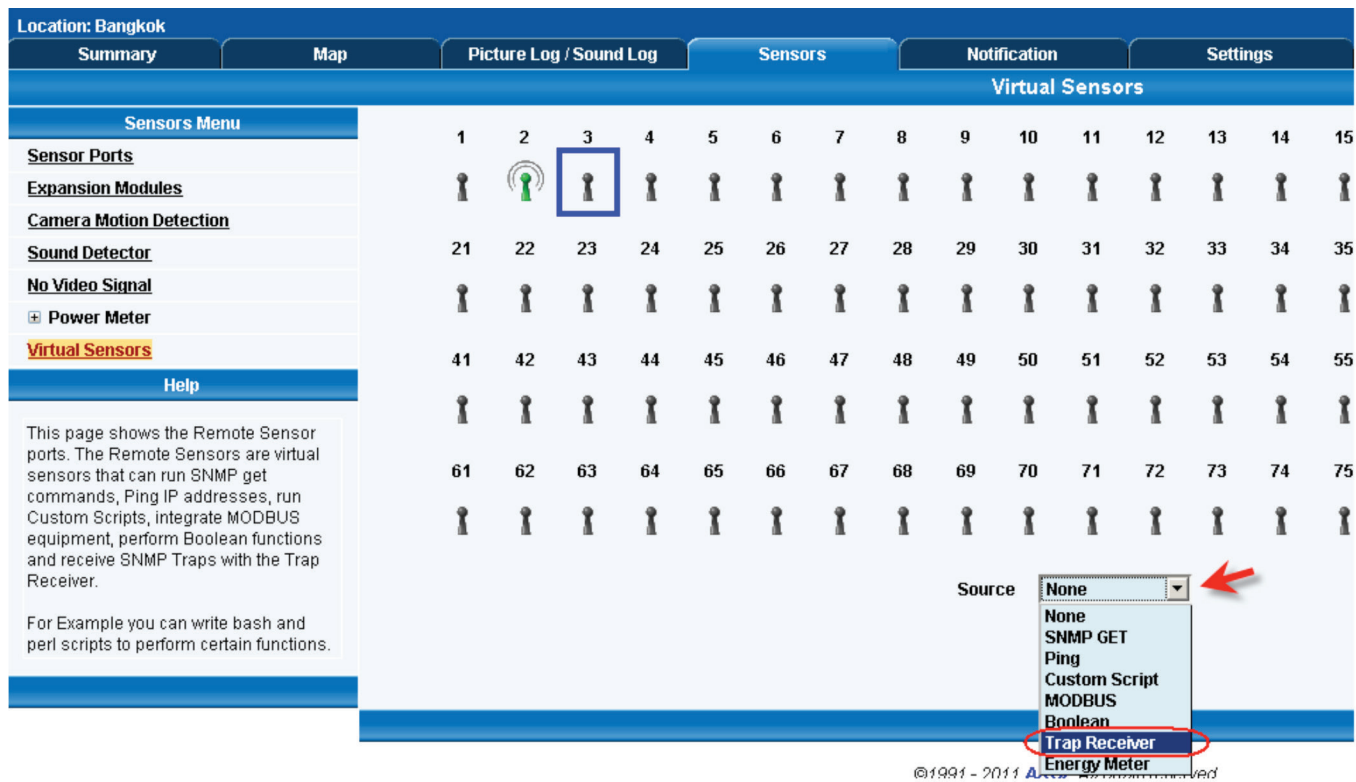


Figure 9-2.

Next navigate to the Sensors page >> Virtual Sensors, then click on the virtual sensor number you wish to setup for the trap receiver, click on the "Configure" button, and choose the "Trap Receiver" from the drop-down menu as shown above.

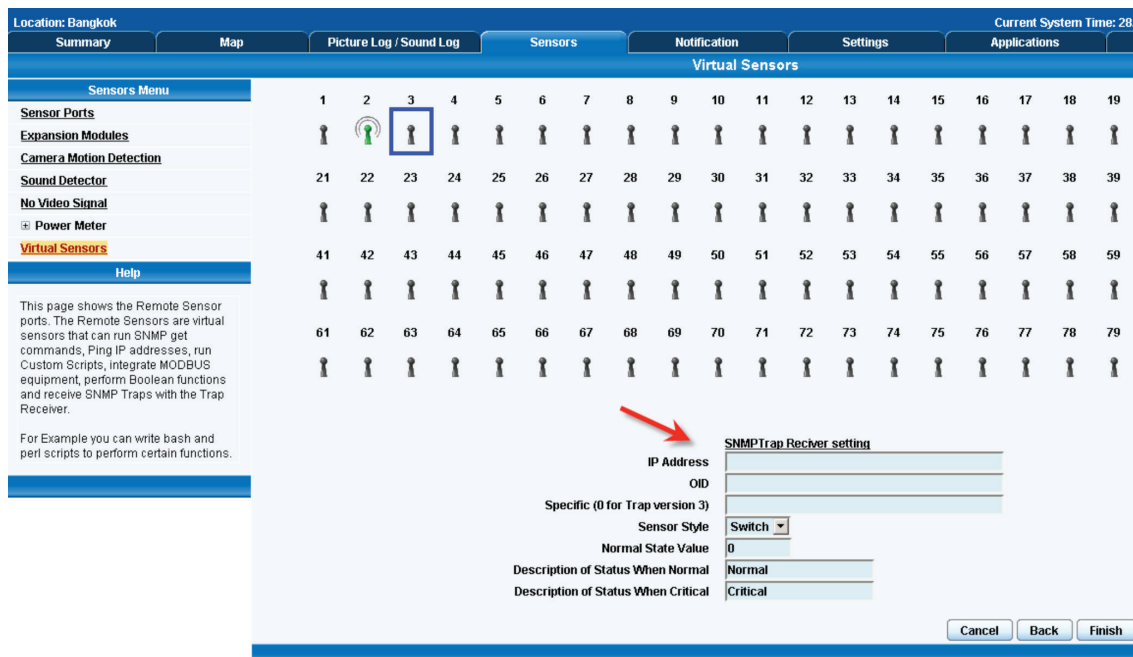


Figure 9-3.



## Chapter 9: SNMP Trap Receiver Controlling IO-digital8 Relay

Enter your SNMP trap information, including the units IP address, the OID of the sensor, the Specific number, etc., and click the finish button.

*NOTE: The "Specific" you can view from a trap receiver program such as mibbrowser of Ireasoning (it has the trap receiver in the Tools menu).*

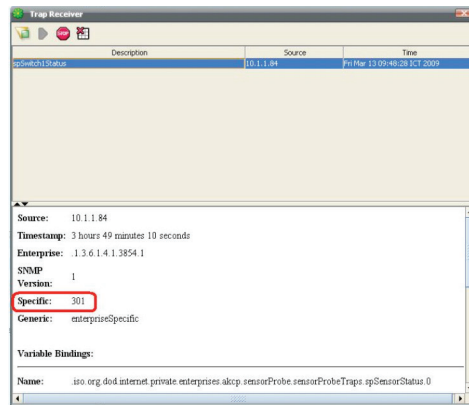


Figure 9-4.

You can check this by opening the trap receiver program and sending the trap to the PC. This specific value will be up to the setting of the ServSensor Trap Type OID, the sensor type and sensor port.

You can change the ServSensor Hub Trap Type by using this snmp command here:

```
snmpset -m all -v1 -c <community> <IPaddress> .1.3.6.1.4.1.3854.1.2.2.1.60.0 i <traptype>
```

When

specificTypeTrap(1),

generalTypeTrap(2),

bothTypeTraps(3),

statusTypeTraps(4)

## 3. Setup the IO-digital8 relay.

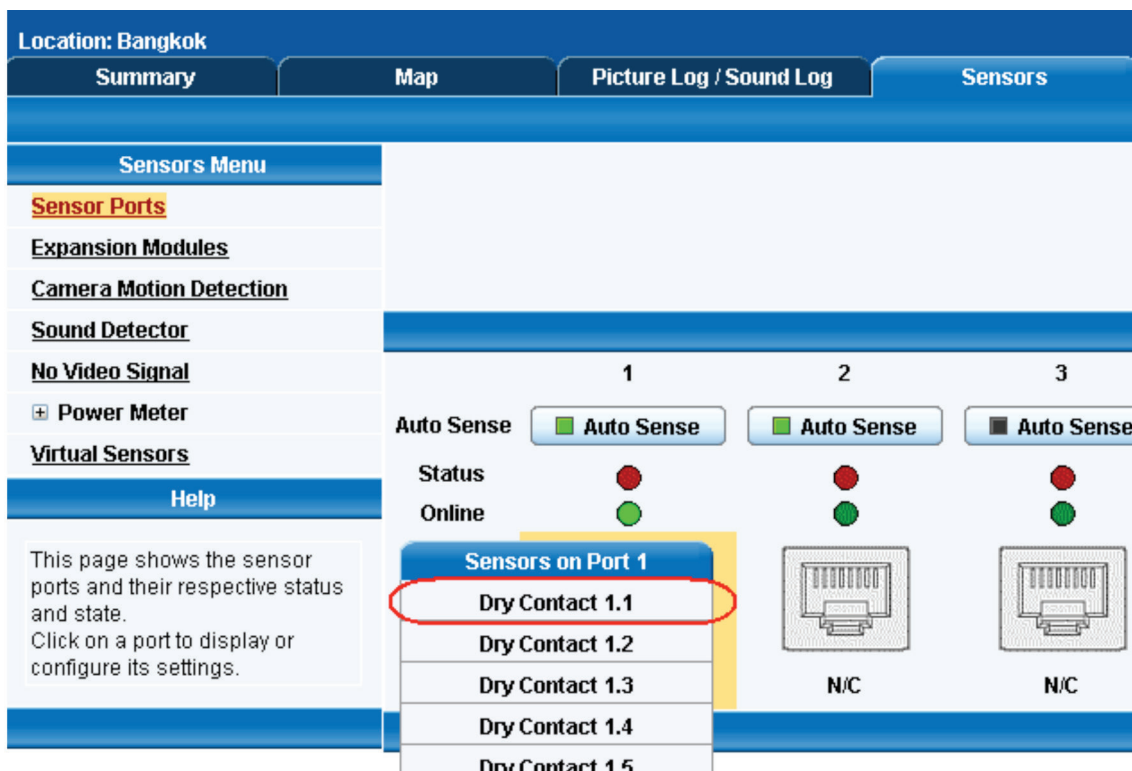


Figure 9-5.

Navigate to the Sensors page >> Sensors page and click on the IO-digital8 relay you will be linking to your Trap Receiver Virtual Sensor.

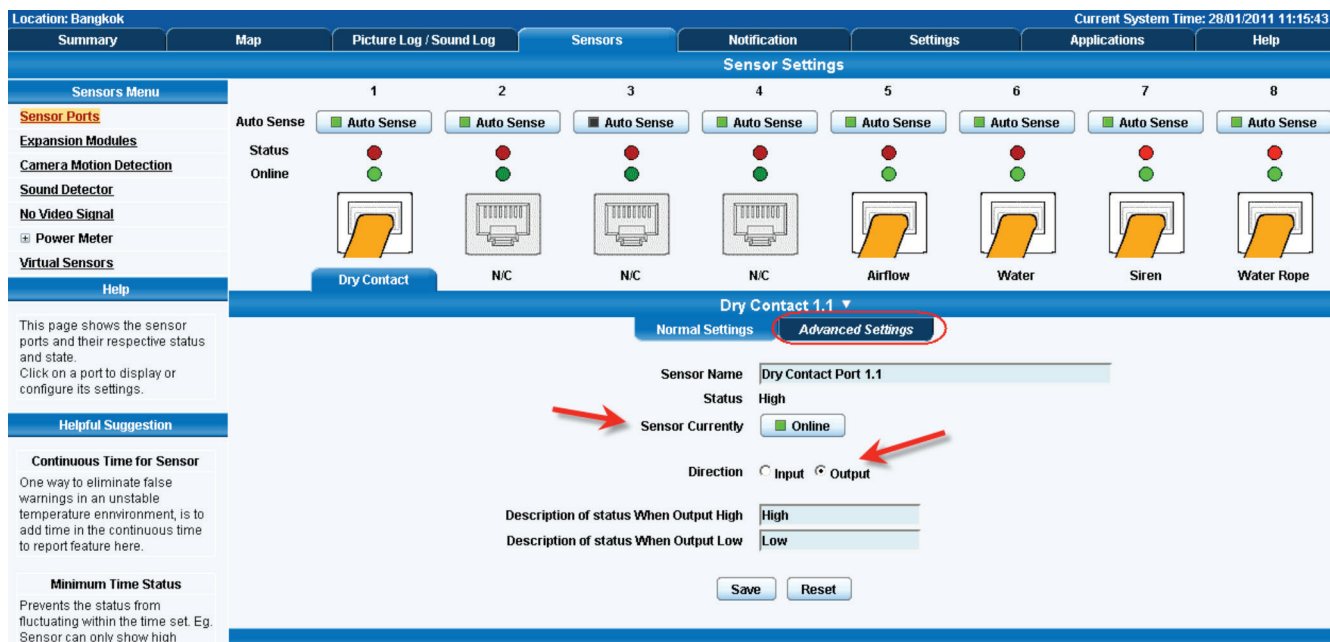


Figure 9-6.

## Chapter 9: SNMP Trap Receiver Controlling IO-digital8 Relay

First, enable the relay by turning it "Online," then configure the direction, whether it will be an input or output, then click on the Advanced Settings tab.

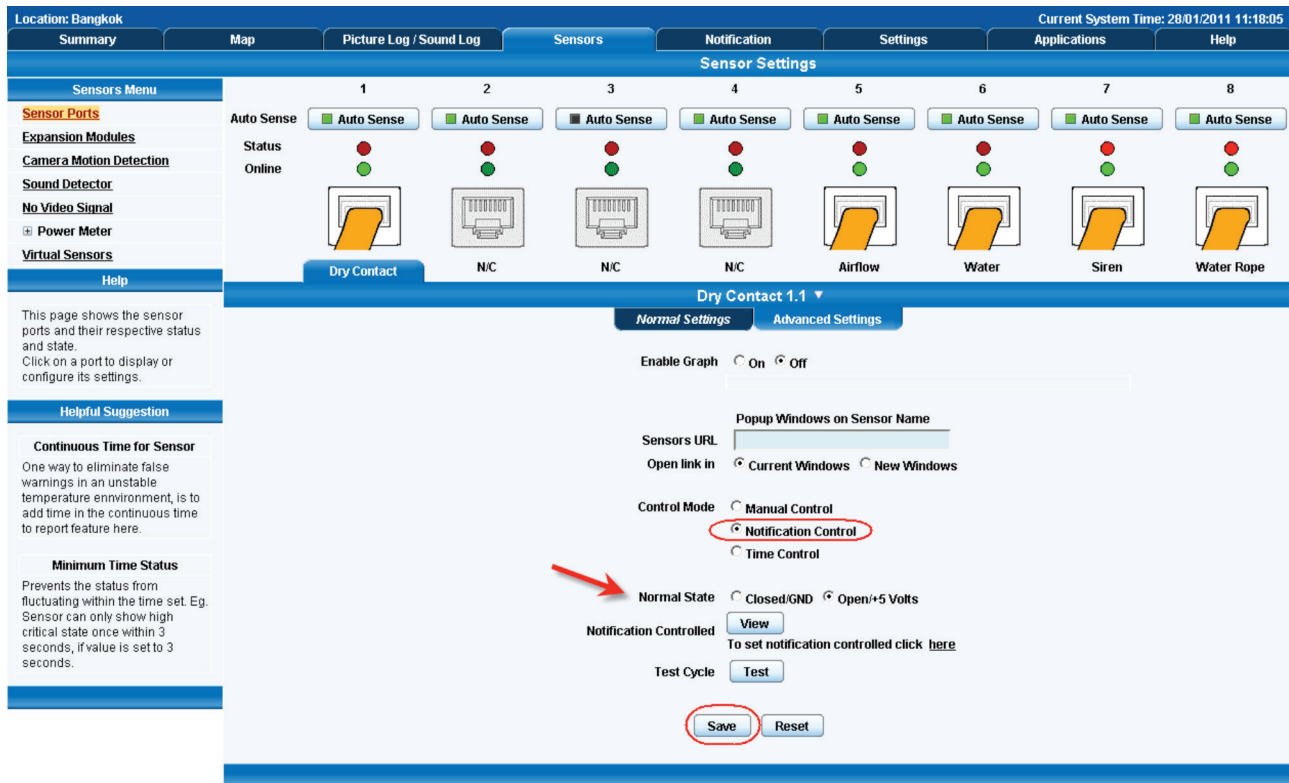


Figure 9-7.

Set the relay's "Control Mode" to Notification Control and set the Normal State to which the relay will be in, either Closed/GND or Open+5 Volts, and click the "Save" button.

### 4. Setup the Dry Contact Action.

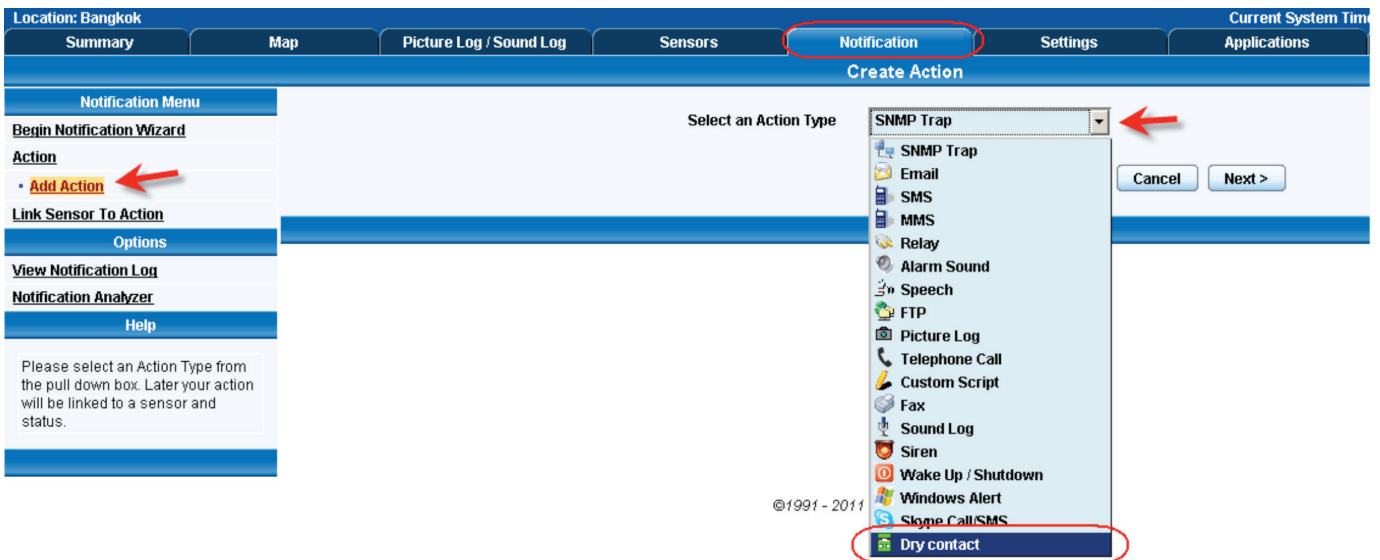


Figure 9-8.

Now we will setup the dry contact action that will control the relay. First Navigate to the Notifications page >> Add Action >> Select the Dry Contact from the Action Type drop down list as shown above, then click the "Next" button.

Location: Bangkok

Summary Map Picture Log / Sound Log Sensors Notification Settings Applications

Current System Time: 28/01/2017

Dry contact Action Wizard

Notification Menu

Begin Notification Wizard

Action

• Add Action

Link Sensor To Action

Options

View Notification Log

Notification Analyzer

Help

Please choose a name for your Drycontact Action. Descriptive Action names increase the simplicity of the system.

Select the port your dry contact is connected to and whether your Action should Turn the dry contact On or Off.

Please select Cancel to leave the edit mode and go back to the menu without saving. Press Finish to Save your Action

Action Name: Dry contact 2

Controls the Dry contact on Module: Internal RJ45

Port: Dry Contact Port 1.1

Action: Dry Contact Port 1.1

Note: Dry Contact Port 1.4 (Not a Notification Control mode). Dry Contact Port 1.5 (Not a Notification Control mode). Dry Contact Port 1.6 (Not a Notification Control mode). Dry Contact Port 1.7 (Not a Notification Control mode). Dry Contact Port 1.8 (Not a Notification Control mode).

Cancel Finish

Figure 9-9.

Name the relay action, then select the port that we set up earlier from the Port drop-down list.

Location: Bangkok

Summary Map Picture Log / Sound Log Sensors Notification Settings Applications

Current System Time: 28/01/2017

Dry contact Action Wizard

Notification Menu

Begin Notification Wizard

Action

• Add Action

Link Sensor To Action

Options

View Notification Log

Notification Analyzer

Help

Please choose a name for your Drycontact Action. Descriptive Action names increase the simplicity of the system.

Select the port your dry contact is connected to and whether your Action should Turn the dry contact On or Off.

Please select Cancel to leave the edit mode and go back to the menu without saving. Press Finish to Save your Action

Action Name: Dry contact 2

Controls the Dry contact on Module: Internal RJ45

Port: Dry Contact Port 1.1

Action: Turn Low Till Sensor Normal

Note: Cycle the Dry contact to notification control mode. Turn Low Until Acknowledge Turn High Until Acknowledge

Cancel Finish

Figure 9-10.

## Chapter 9: SNMP Trap Receiver Controlling IO-digital8 Relay

Now select the Action for which you require the relay to perform when it will be triggered by the Trap Receiver Virtual Sensor and click the “Finish” button.

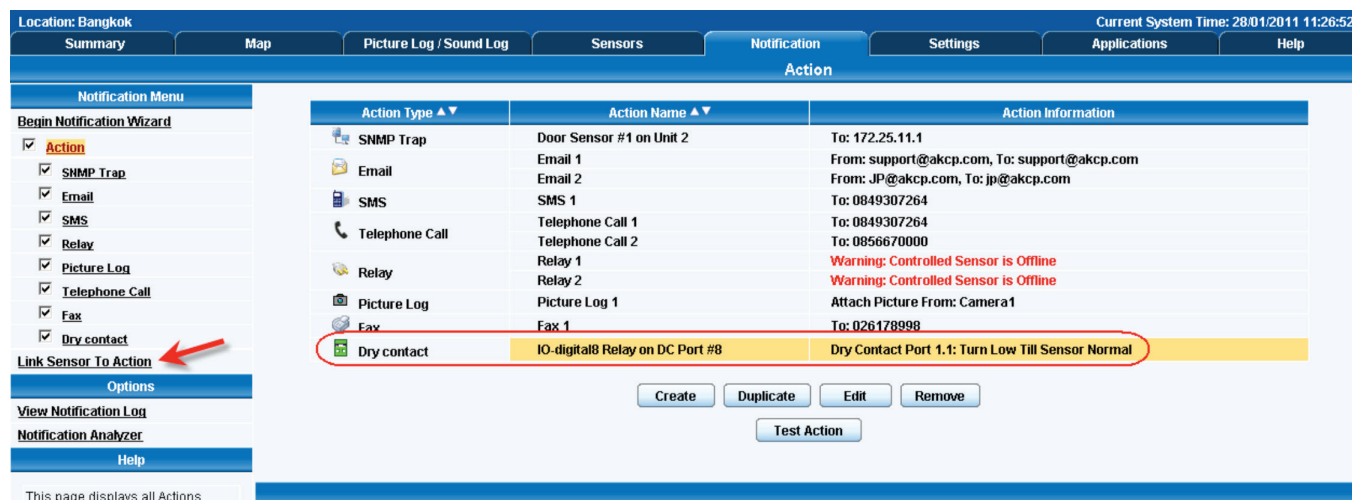


Figure 9-11.

The new action appears in the actions listing. Click on the Link Sensor To Action link.

5. Link the Trap Receiver to the Dry Contact Action.

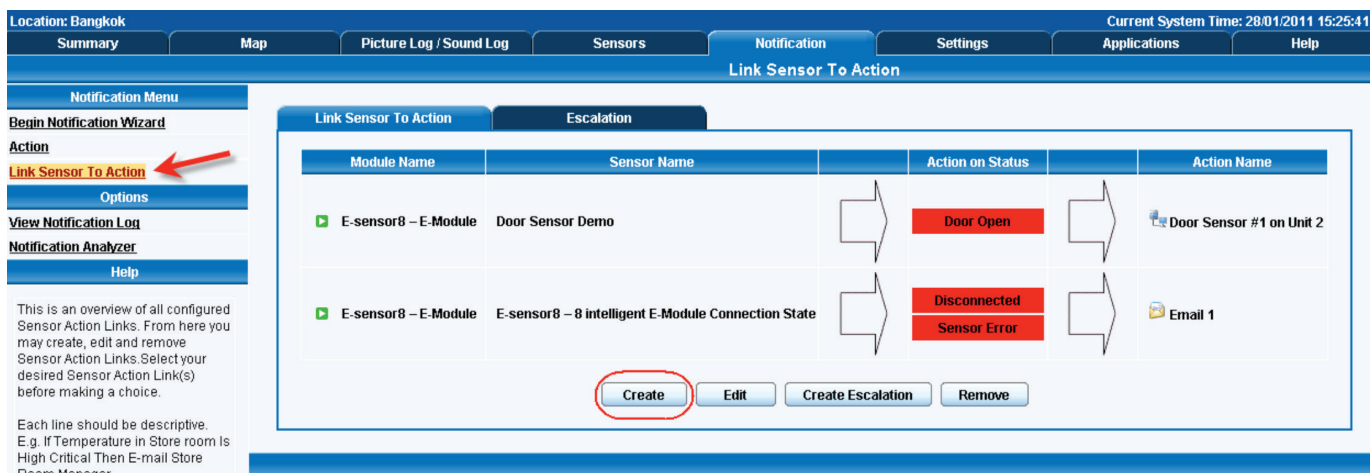


Figure 9-12.

After clicking on the “Link Sensor To Action” link, click on the “Create” button.

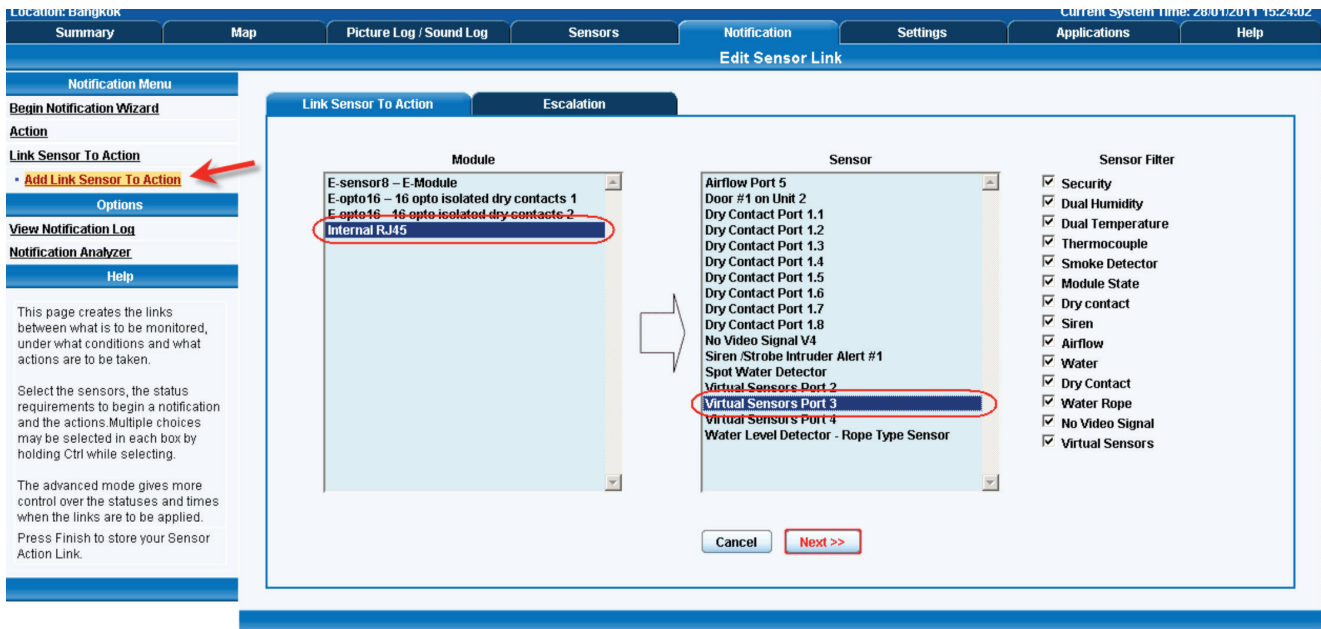


Figure 9-13.

Now click on the Internal RJ-45 in the Module list, then the Virtual Sensor that we setup for the Trap Receiver, and click on the “Next” button.

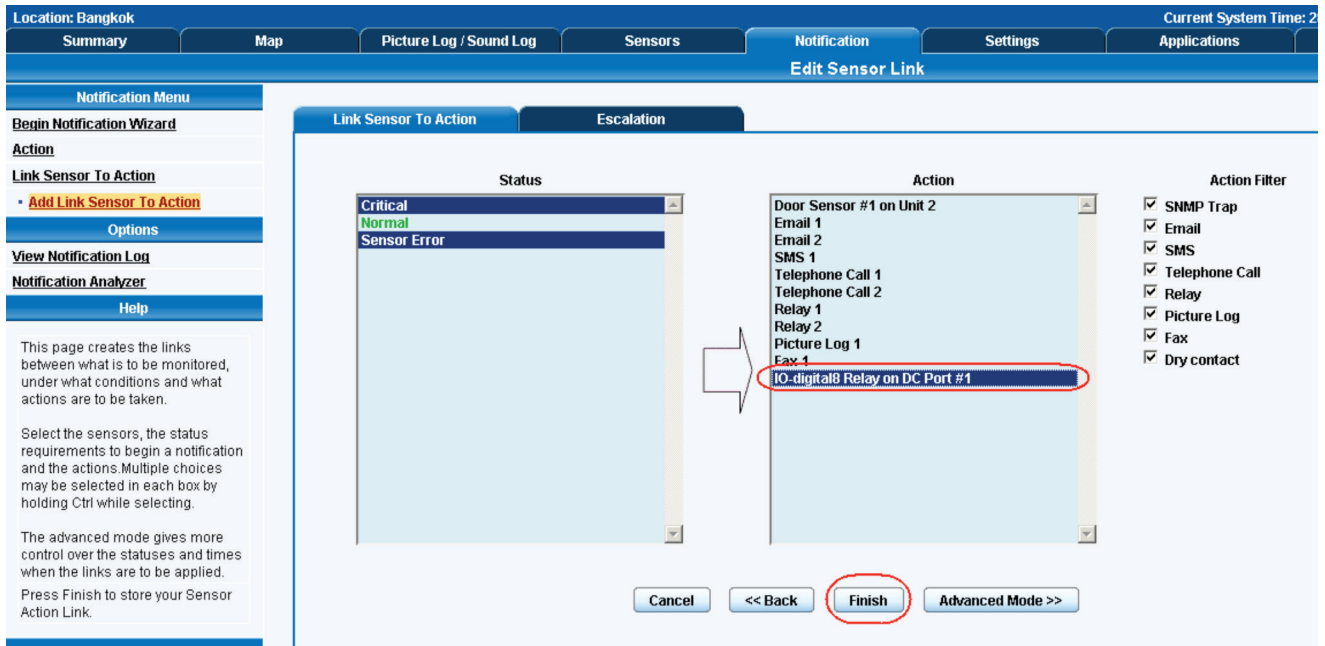


Figure 9-14.



## Chapter 9: SNMP Trap Receiver Controlling IO-digital8 Relay

Select the Status that the Virtual Sensor will be in to activate the relay. Then select the Dry Contact relay action that we previously created from the Action listing. Finally, click the “Finish” button.

The screenshot shows a web application interface for configuring sensor actions. The top navigation bar includes tabs for Summary, Map, Picture Log / Sound Log, Sensors, Notification (selected), Settings, Applications, and Help. The current system time is 28/01/2011 15:30:44. The main content area is titled 'Link Sensor To Action' and contains a table with the following data:

Module Name	Sensor Name	Action on Status	Action Name
E-sensor8 – E-Module	Door Sensor Demo	Door Open	Door Sensor #1 on Unit 2
E-sensor8 – E-Module	E-sensor8 – 8 intelligent E-Module Connection State	Disconnected Sensor Error	Email 1
Internal RJ45	Virtual Sensors Port 3	Critical Sensor Error	IO-digital8 Relay on DC Port #1

Below the table are buttons for 'Create', 'Edit', 'Create Escalation', and 'Remove'. A red box highlights the third row, indicating the configuration for the Virtual Sensor.

Figure 9-15.

The Trap Receiver Virtual Sensor is now linked to the IO-digital8 dry contact relay.

## 10. Frequently Asked Questions (FAQs)

**Question:** I cannot see the temperature sensor displayed on summary page.

**Answer:** After logging in for the first time with the temperature sensor connected, you may need to do the following.

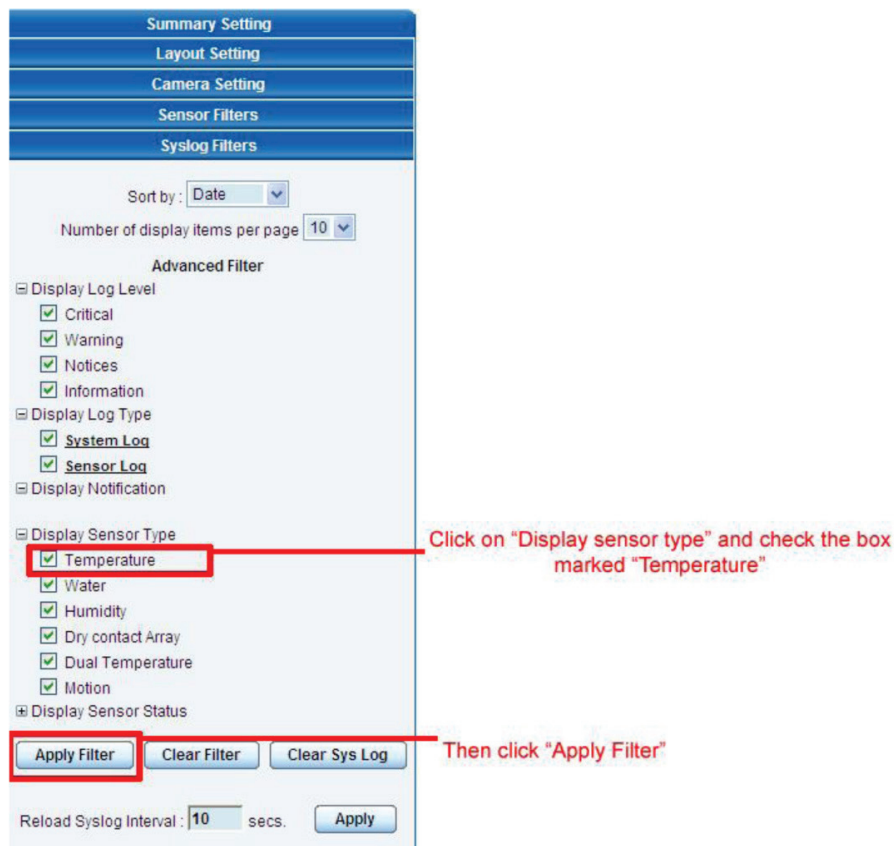


Figure 10-1. Select sensor to display.

Next, click on “Apply Filter.” The temperature sensor should then be displayed in the list of connected sensors.

**Question:** I cannot access my unit’s Web interface.

If you’re having issues with network connectivity, first make sure that the link100 LED is lit on the front display of the unit. If this is not lit, then no network connection is present.

**Answer:**

1. If connected directly to a PC, make sure you’re using a good quality crossover cable.
2. Make sure you’re using a standard CAT5 Ethernet cable to connect to your network.

**Question:** What do my LED lights mean?

**Answer:** The following diagrams show what the various LED displays mean.

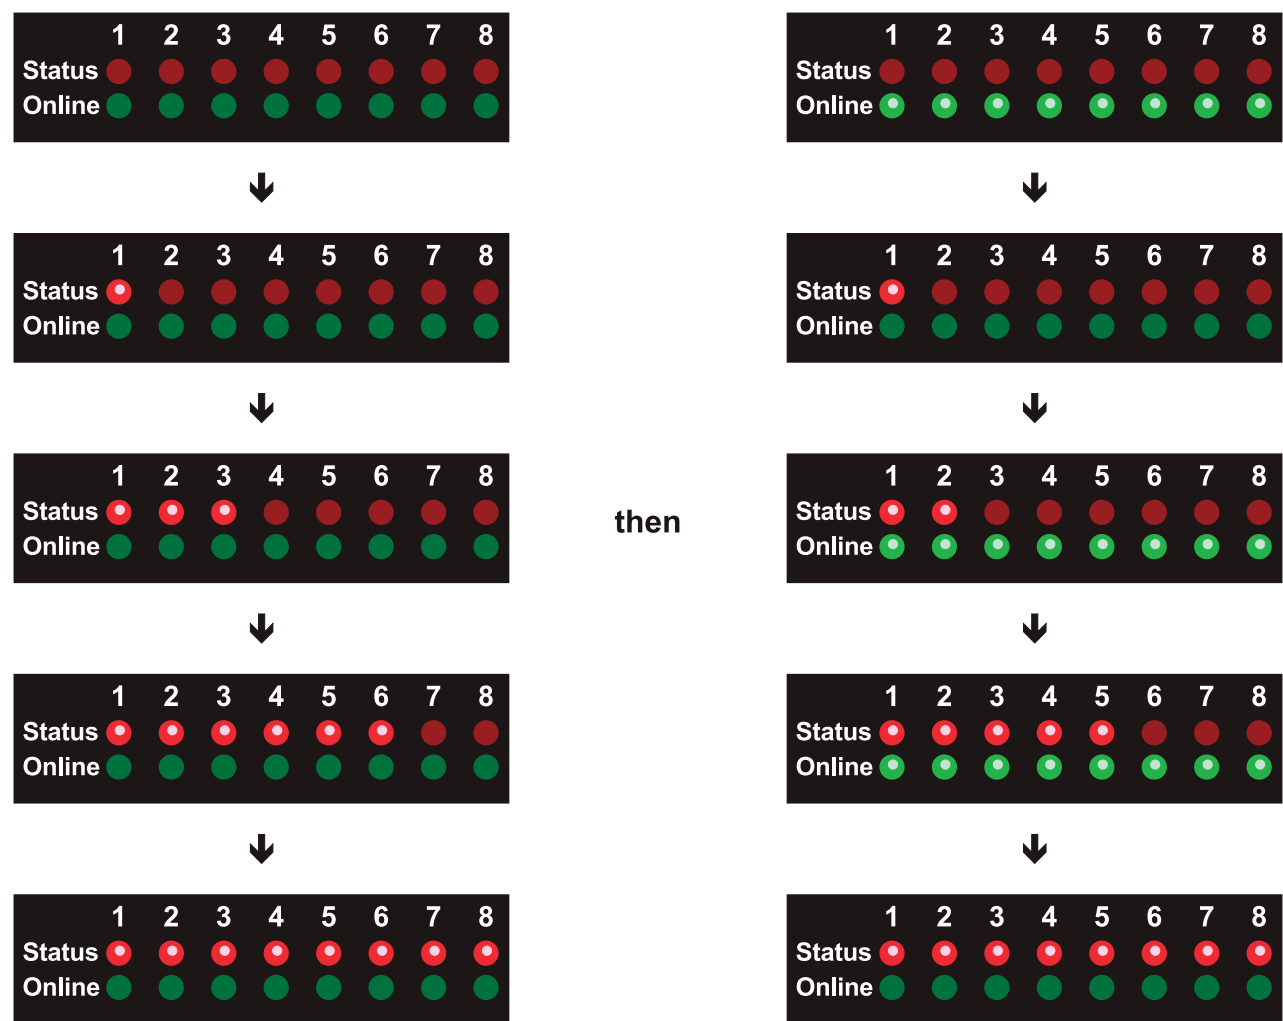


Figure 10-2. LED patterns in Normal mode.

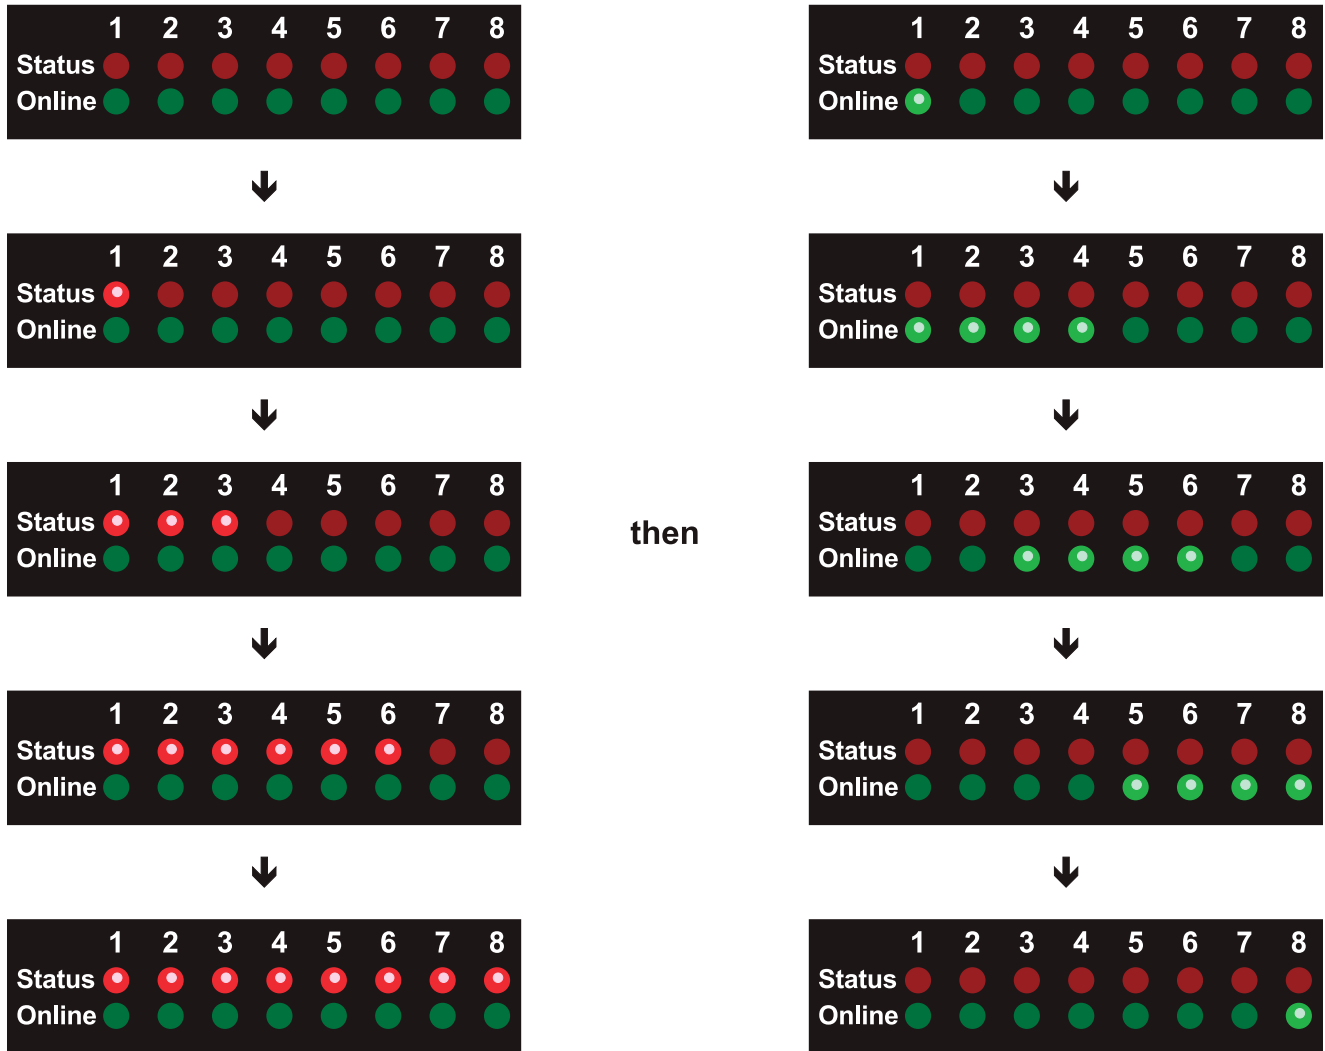


Figure 10-3. LED patterns in Safe mode.

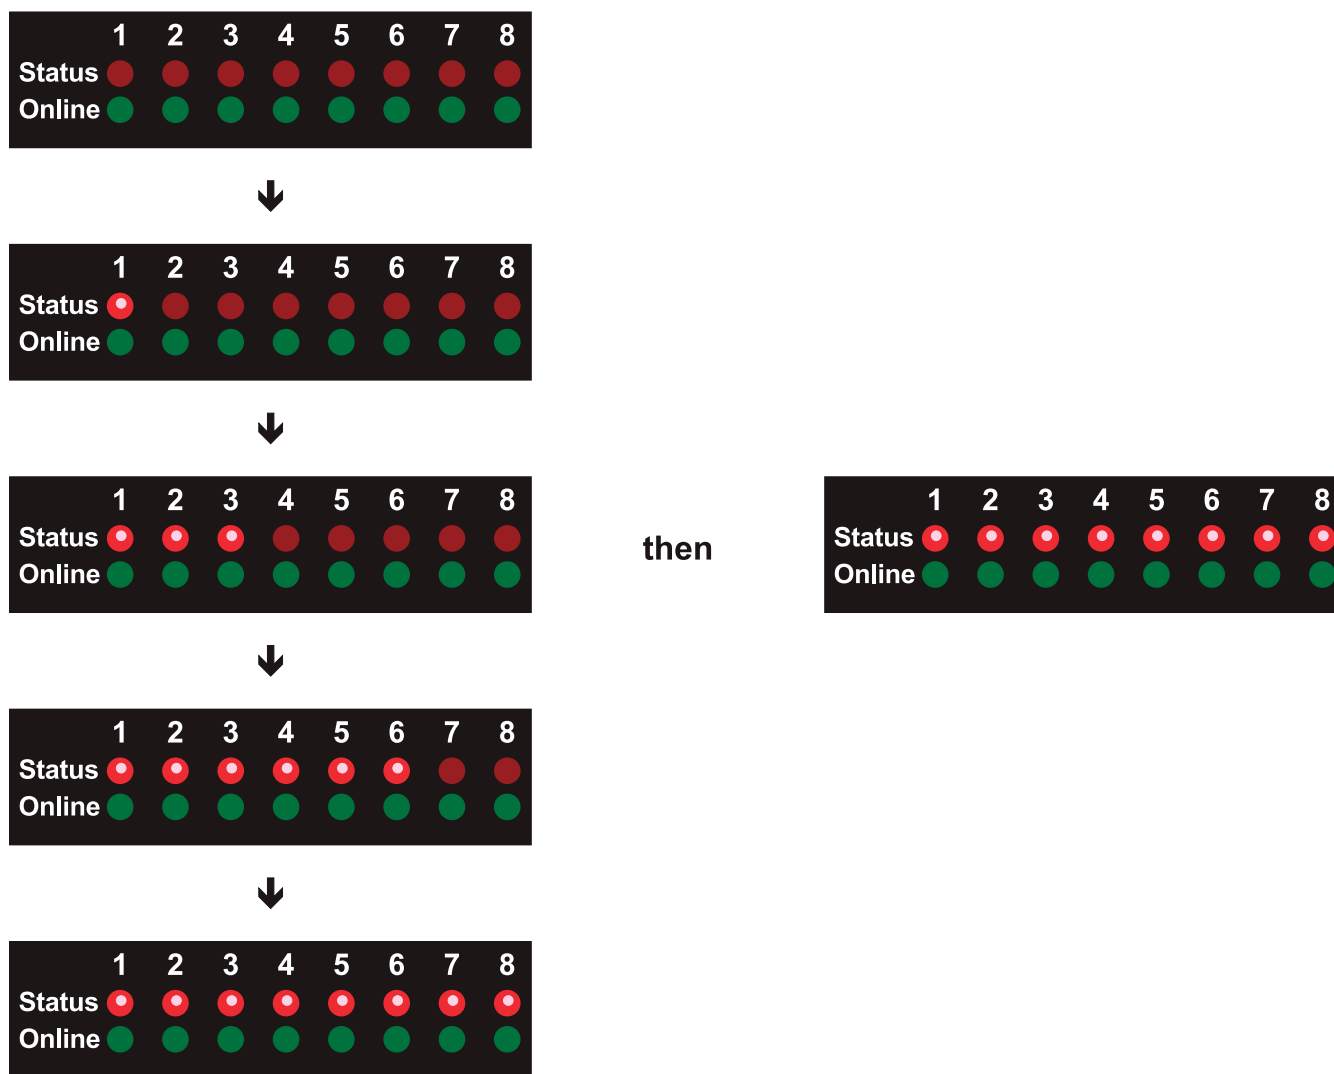


Figure 10-4. LED patterns in Recovery mode.

LEDs run clockwise after the power is connected.

From left to right, each LED indicates:

1st LED: U-Boot init

2nd LED: Kernel loaded with good CRC

3rd LED: Board init

4th LED: Serial port

5th LED: Ethernet

6th LED: NOR Flash

7th LED: NAND Flash

8th LED: Root file-system mounted. Starting initialization process

After the root file-system is mounted, all green LEDs will be flashing, and red LEDs light increasingly from left to right. The onboard Web server can be accessed during this time and shows a splash screen with boot details. After the boot process is finished, the LEDs show the status of the online sensors.

**Question:** I forgot my unit's IP address.

**Answer:** If you forget the IP address of your unit, you can simply press the reset button on the back of the unit. This will then announce the IP address through the unit's internal speaker.

**Question:** I forgot the password for my unit.

**Answer:** Hold down the reset button for seven seconds. This will turn off the use password feature for the Web-based interface. This will remain turned off until you hold the button down for a further seven seconds, or the unit announces "Now turning off password checking."

*NOTE: This will turn off the password checking for accessing the Web interface only; you still have to enter the password when you access the system via Telnet.*

**Question:** Can I use DHCP to assign my unit's IP address?

**Answer:** Yes, you can use DHCP to assign the IP address. The unit ships with this disabled. To turn it on, you need to log into the Web interface and navigate to the Ethernet settings via the "Security" tab, "Ethernet Network," and then click on the "Yes" button for "Use DHCP."

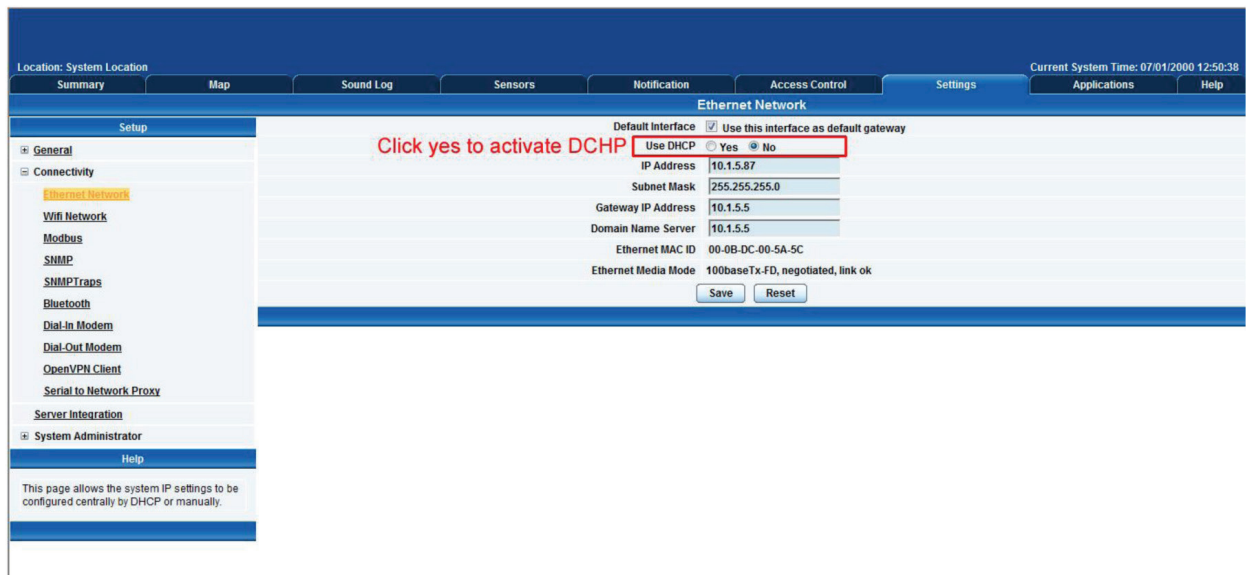


Figure 10-5. Activate DHCP.

*NOTE: If the unit has a static IP address assigned, it will no longer send out DHCP requests. If you later want to turn DHCP back on, you can do that using the Web-based interface.*

**Question:** How do I set up my routing table?

**Answer:** To set up the routing table, open a DOS window (start, run type command press enter) and at the command prompt, then enter: >route add 192.168.0.100.10.1.1.20

Where 10.1.1.20 is the IP address of the Ethernet interface on the PC that the unit is plugged into with the crossover cable.



## Chapter 10: Frequently Asked Questions (FAQ)

Now ping\* 192.168.0.100 to see if the connection was successful.

**Question:** How can I change my administrator password?

**Answer:** If you want to make your unit more secure and change the administrator password from the default (public) to your own choice, follow these steps:

1. Log into your unit using the default password.
2. Click the “Settings” tab.

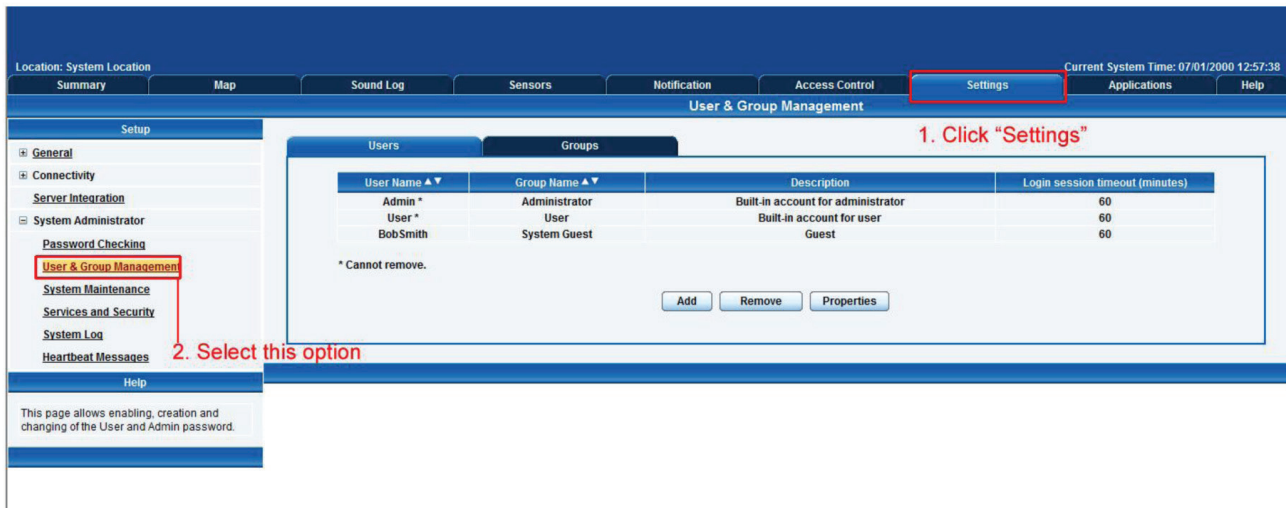


Figure 10-6. Select change password option.

3. Change the password.

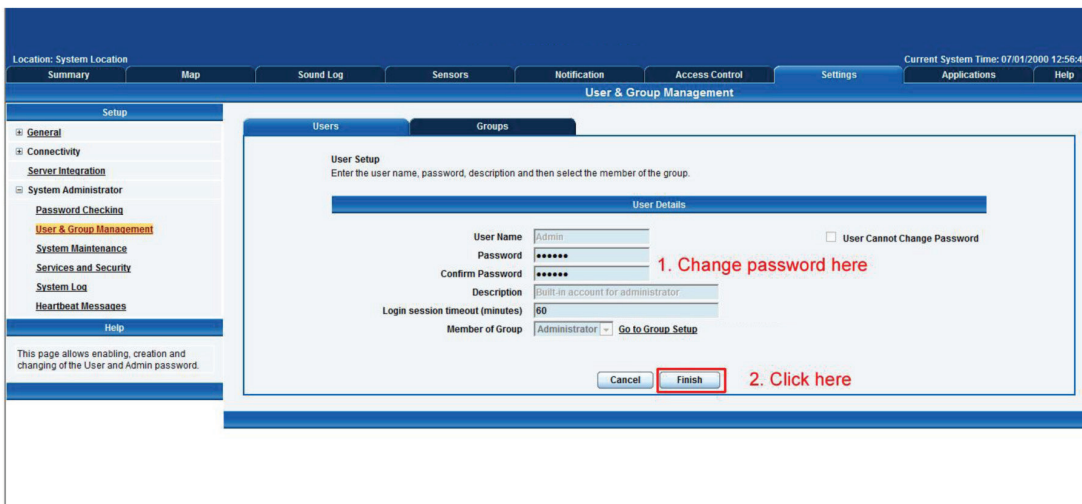


Figure 10-7. Change user and/or admin passwords.

**Question:** What function do the different types of notifications provide?

**Answer:** The notifications are used to notify you when a sensor reading has hit a certain preset “critical” threshold. There are many ways you can be notified. They are as follows:

**SNMP Trap:** This form of notification sends out a signal to your SNMP server.

**E-Mail:** This sends a notification via e-mail.

**SMS:** This sends an SMS message to your mobile phone.

**MMS:** This will send you a multimedia message to your mobile phone. This can include an image captured from one of the ServSensor Hub's cameras.

**Relay:** The relay is used as a switch, for example, it could switch on an air-conditioning unit if the temperature reading of a temperature sensor reaches a certain threshold.

**Alarm sound:** This notification will sound an alarm.

**Speech:** Creates a text-to-speech notification.

**Telephone call:** Will call you and play a prerecorded message or a text-to-speech message.

**Custom script:** Allows you to load a custom script that runs on a sensor reading a preset parameter.

**Fax:** Will send a fax to you with a notification message.

**Sound log:** Creates a log of sound captured with the internal/external microphone.

**Siren and strobe:** Will activate a siren and strobe light.

**Wake up/shut down:** This will send a signal to wake up or shut down a server.

If you require any assistance in setting these up, contact Black Box Technical Support at [info@blackbox.com](mailto:info@blackbox.com).

**Question:** Can I connect my unit via Wi-Fi?

**Answer:** Yes, you can connect the unit via Wi-Fi. Simply plug a USB dongle into the USB port on the rear of the unit. You then need to configure your connection type and encryption key, etc. Do this from the Web-based interface in the "Settings" tab and the connectivity option.


Wifi Network	
Wireless Adapter	<input checked="" type="radio"/> On <input type="radio"/> Off
Default Interface	<input type="checkbox"/> Use this interface as default gateway
Use DHCP	<input type="radio"/> Yes <input checked="" type="radio"/> No
IP Address	<input type="text" value="192.168.0.10"/>
Subnet Mask	<input type="text" value="255.255.255.0"/>
Gateway IP Address	<input type="text" value="10.1.1.205"/>
Domain Name Server	<input type="text" value="10.1.1.2"/>
Wireless Mode	<input checked="" type="radio"/> Infrastructure (Access point) <input type="radio"/> Ad-hoc ch <input type="text" value="1"/>
Wireless SSID	<input type="text"/>
Encryption Mode	<input checked="" type="radio"/> Disabled <input type="radio"/> 64bit WEP
Link Status	Not connected
Signal Strength	0% 
<input type="button" value="Save"/> <input type="button" value="Reset"/>	

Figure 10-8. Win Network screen.

## Chapter 10: Frequently Asked Questions (FAQ)

---

**Question:** What is the Heartbeat message?

**Answer:** This setting is to have the ServSensor notify you that it is still running. You can be notified by either traps or by e-mail:

**Alive Trap settings:** Send Keep Alive Traps (Default Off): Select on if you want the system to send Alive Traps.

**Destination:** Enter the IP address of the server to send traps to.

**Community:** SNMP community string.

**Resend Interval (mins):** The period of time between each keep-alive trap. Values range from 1 to 65535 minutes.

**Question:** What is the network sniffer?

**Answer:** The network sniffer application can be used to capture network packets running to and from the ServSensor Hub, and all the network traffic. You can then import the captured file into TCP dump for details of these network packets. The network trace will help in debugging any network problems; for example, if e-mail cannot be sent.

**Question:** Can I use the camera for a videoconferencing call?

**Answer:** Yes, it is possible to use the camera and the integrated microphone to make a videoconferencing call. You need the software called "OpenPhone" running on your computer. This is included on the CD-ROM that came with your unit. (Look for OpenPhone.exe). Next follow these steps:

1. Initiate connection from OpenPhone (PC) to ServSensor.
  - a. Open the program by double clicking "openphone.exe"
  - b. Click the "Make Call" button, enter the IP address of the ServSensor Hub Linux/ServSensor V4E Hub to initiate a call in the "Address" field. Then, click "OK."
  - c. The unit will automatically respond to a call and establish the connection. You will then see the video and hear sound from the unit.
2. Initiate connection from a ServSensor to OpenPhone (PC).
  - a. Open the program by double clicking "openphone.exe"
  - b. On the Web interface, click on the "Applications" tab, and click on "Video Conferencing."
  - c. Select the "Call to" option and enter the IP address of the PC running OpenPhone. Click "Save" to discover your computers IP address in the command prompt, type "ipconfig."
  - d. On the OpenPhone application, click "Answer" to accept the call.
3. Connection between two ServSensor Hub Linux/ServSensor V4E Hub (only voice conference).
  - a. On the Web interface of the calling sServSensor Hub Linux/ServSensor V4E Hub, click on the "Applications" tab, and click "Video Conferencing."
  - b. On the right pane, select the "Call to" field and enter the IP address of the receiving ServSensor Hub Linux/ServSensor V4E Hub into this field. Click "Save."
  - c. The connection should automatically establish.

You can end the videoconference call by doing the following:

1. **End the call on OpenPhone (PC):** To end call, click the "Hang Up" button on the OpenPhone. This method can be used to end the call between the system and OpenPhone.
2. **End the call on the unit:** From the Web interface, click on the "Applications" tab and click on "Video Conferencing." On the right pane, select "End call and wait for a new incoming call" option. Then, click "Save."

### Appendix A. Black Box Open Source Software License Disclaimer

#### A. Licensing Information

This product includes copyrighted third-party software licensed under the terms of the GNU General Public License. Specifically, the following parts of this product are subject to the GNU GPL:

GPLv1: libjpeg, perl

GPLv2: Linux operating system kernel, alsamixer, busybox, efax, findutils, glibc, GNU grep, gsmlib, gawk, iptables, libusb, mgetty, minicom, net-tools, nmap, normalize, ntp, openvpn, , rawrec, resize-image, RRDTool, ser2net, ssmtp, tplay, udev

GPLv3: bash, samba

LGPLv2.1: libmodbus

Please see below after for the exact terms and conditions of those GNU GPL licenses.

This product includes copyrighted third-party software licensed under the terms of the BSD license or similar. Specifically, the following parts of this product are subject to BSD license or similar:

Lighhttpd, ppp, tcpdump, zip.

This product includes other copyrighted third-party free software licensed, specifically, the following parts:

Curl, dropbear, libexpat, CMU Flite, dhclient, ImageMagick, net-snmp, netkit-ftp, openssl, php, portmap, zlib.

All listed software packages are copyright by their respective authors. Please see their source code for detailed information.

#### Availability of Source Codes

Black Box has included the full source code of the GPL licensed software on the CD-ROM shipped with this product.

Black Box will also provide the source code of the GPL licensed software to you on DVD-ROM for a charge covering the cost of performing such distribution (such as the cost of media, shipping and handling) upon email request to [info@blackbox.com](mailto:info@blackbox.com)

This offer is valid for three (3) years from the date on which you purchased the product.

#### B. GNU GPL v2

##### GNU GENERAL PUBLIC LICENSE

Version 2, June 1991

Copyright (C) 1989, 1991 Free Software Foundation, Inc.

51 Franklin Street, Fifth Floor, Boston, MA 02110-1301, USA

Everyone is permitted to copy and distribute verbatim copies of this license document, but changing it is not allowed.

##### Preamble

The licenses for most software are designed to take away your freedom to share and change it. By contrast, the GNU General Public License is intended to guarantee your freedom to share and change free software--to make sure the software is free for all its users. This General Public License applies to most of the Free Software Foundation's software and to any other program whose authors commit to using it. (Some other Free Software Foundation software is covered by the GNU Lesser General Public License instead.) You can apply it to your programs, too.

## Appendix A: Black Box Open Source Software License Disclaimer

---

When we speak of free software, we are referring to freedom, not price. Our General Public Licenses are designed to make sure that you have the freedom to distribute copies of free software (and charge for this service if you wish), that you receive source code or can get it if you want it, that you can change the software or use pieces of it in new free programs; and that you know you can do these things.

To protect your rights, we need to make restrictions that forbid anyone to deny you these rights or to ask you to surrender the rights. These restrictions translate to certain responsibilities for you if you distribute copies of the software, or if you modify it.

For example, if you distribute copies of such a program, whether gratis or for a fee, you must give the recipients all the rights that you have. You must make sure that they, too, receive or can get the source code. And you must show them these terms so they know their rights.

We protect your rights with two steps: (1) copyright the software, and (2) offer you this license which gives you legal permission to copy, distribute and/or modify the software.

Also, for each author's protection and ours, we want to make certain that everyone understands that there is no warranty for this free software. If the software is modified by someone else and passed on, we want its recipients to know that what they have is not the original, so that any problems introduced by others will not reflect on the original authors' reputations.

Finally, any free program is threatened constantly by software patents. We wish to avoid the danger that redistributors of a free program will individually obtain patent licenses, in effect making the program proprietary. To prevent this, we have made it clear that any patent must be licensed for everyone's free use or not licensed at all.

The precise terms and conditions for copying, distribution and modification follow.

### **TERMS AND CONDITIONS FOR COPYING, DISTRIBUTION AND MODIFICATION**

**0.** This License applies to any program or other work which contains a notice placed by the copyright holder saying it may be distributed under the terms of this General Public License. The "Program", below, refers to any such program or work, and a "work based on the Program" means either the Program or any derivative work under copyright law: that is to say, a work containing the Program or a portion of it, either verbatim or with modifications and/or translated into another language. (Hereinafter, translation is included without limitation in the term "modification".) Each licensee is addressed as "you".

Activities other than copying, distribution and modification are not covered by this License; they are outside its scope. The act of running the Program is not restricted, and the output from the Program is covered only if its contents constitute a work based on the Program (independent of having been made by running the Program). Whether that is true depends on what the Program does.

**1.** You may copy and distribute verbatim copies of the Program's source code as you receive it, in any medium, provided that you conspicuously and appropriately publish on each copy an appropriate copyright notice and disclaimer of warranty; keep intact all the notices that refer to this License and to the absence of any warranty; and give any other recipients of the Program a copy of this License along with the Program.

You may charge a fee for the physical act of transferring a copy, and you may at your option offer warranty protection in exchange for a fee.

**2.** You may modify your copy or copies of the Program or any portion of it, thus forming a work based on the Program, and copy and distribute such modifications or work under the terms of Section 1 above, provided that you also meet all of these conditions:

- a)** You must cause the modified files to carry prominent notices stating that you changed the files and the date of any change.
- b)** You must cause any work that you distribute or publish, that in whole or in part contains or is derived from the Program or any part thereof, to be licensed as a whole at no charge to all third parties under the terms of this License.

c) If the modified program normally reads commands interactively when run, you must cause it, when started running for such interactive use in the most ordinary way, to print or display an announcement including an appropriate copyright notice and a notice that there is no warranty (or else, saying that you provide a warranty) and that users may redistribute the program under these conditions, and telling the user how to view a copy of this License. (Exception: if the Program itself is interactive but does not normally print such an announcement, your work based on the Program is not required to print an announcement.)

These requirements apply to the modified work as a whole. If identifiable sections of that work are not derived from the Program, and can be reasonably considered independent and separate works in themselves, then this License, and its terms, do not apply to those sections when you distribute them as separate works. But when you distribute the same sections as part of a whole which is a work based on the Program, the distribution of the whole must be on the terms of this License, whose permissions for other licensees extend to the entire whole, and thus to each and every part regardless of who wrote it.

Thus, it is not the intent of this section to claim rights or contest your rights to work written entirely by you; rather, the intent is to exercise the right to control the distribution of derivative or collective works based on the Program.

In addition, mere aggregation of another work not based on the Program with the Program (or with a work based on the Program) on a volume of a storage or distribution medium does not bring the other work under the scope of this License.

3. You may copy and distribute the Program (or a work based on it, under Section 2) in object code or executable form under the terms of Sections 1 and 2 above provided that you also do one of the following:

- a) Accompany it with the complete corresponding machine-readable source code, which must be distributed under the terms of Sections 1 and 2 above on a medium customarily used for software interchange; or,
- b) Accompany it with a written offer, valid for at least three years, to give any third party, for a charge no more than your cost of physically performing source distribution, a complete machine-readable copy of the corresponding source code, to be distributed under the terms of Sections 1 and 2 above on a medium customarily used for software interchange; or,
- c) Accompany it with the information you received as to the offer to distribute corresponding source code. (This alternative is allowed only for noncommercial distribution and only if you received the program in object code or executable form with such an offer, in accord with Subsection b above.)

The source code for a work means the preferred form of the work for making modifications to it. For an executable work, complete source code means all the source code for all modules it contains, plus any associated interface definition files, plus the scripts used to control compilation and installation of the executable. However, as a special exception, the source code distributed need not include anything that is normally distributed (in either source or binary form) with the major components (compiler, kernel, and so on) of the operating system on which the executable runs, unless that component itself accompanies the executable.

If distribution of executable or object code is made by offering access to copy from a designated place, then offering equivalent access to copy the source code from the same place counts as distribution of the source code, even though third parties are not compelled to copy the source along with the object code.

4. You may not copy, modify, sublicense, or distribute the Program except as expressly provided under this License. Any attempt otherwise to copy, modify, sublicense or distribute the Program is void, and will automatically terminate your rights under this License. However, parties who have received copies, or rights, from you under this License will not have their licenses terminated so long as such parties remain in full compliance.

5. You are not required to accept this License, since you have not signed it. However, nothing else grants you permission to modify or distribute the Program or its derivative works. These actions are prohibited by law if you do not accept this License. Therefore, by modifying or distributing the Program (or any work based on the Program), you indicate your acceptance of this License to do so, and all its terms and conditions for copying, distributing or modifying the Program or works based on it.

6. Each time you redistribute the Program (or any work based on the Program), the recipient automatically receives a license from the original licensor to copy, distribute or modify the Program subject to these terms and conditions. You may not impose any further restrictions on the recipients' exercise of the rights granted herein. You are not responsible for enforcing compliance by third parties to this License.



## Appendix A: Black Box Open Source Software License Disclaimer

---

7. If, as a consequence of a court judgment or allegation of patent infringement or for any other reason (not limited to patent issues), conditions are imposed on you (whether by court order, agreement or otherwise) that contradict the conditions of this License, they do not excuse you from the conditions of this License. If you cannot distribute so as to satisfy simultaneously your obligations under this License and any other pertinent obligations, then as a consequence you may not distribute the Program at all. For example, if a patent license would not permit royalty-free redistribution of the Program by all those who receive copies directly or indirectly through you, then the only way you could satisfy both it and this License would be to refrain entirely from distribution of the Program.

If any portion of this section is held invalid or unenforceable under any particular circumstance, the balance of the section is intended to apply and the section as a whole is intended to apply in other circumstances.

It is not the purpose of this section to induce you to infringe any patents or other property right claims or to contest validity of any such claims; this section has the sole purpose of protecting the integrity of the free software distribution system, which is implemented by public license practices. Many people have made generous contributions to the wide range of software distributed through that system in reliance on consistent application of that system; it is up to the author/donor to decide if he or she is willing to distribute software through any other system and a licensee cannot impose that choice.

This section is intended to make thoroughly clear what is believed to be a consequence of the rest of this License.

8. If the distribution and/or use of the Program is restricted in certain countries either by patents or by copyrighted interfaces, the original copyright holder who places the Program under this License may add an explicit geographical distribution limitation excluding those countries, so that distribution is permitted only in or among countries not thus excluded. In such case, this License incorporates the limitation as if written in the body of this License.

9. The Free Software Foundation may publish revised and/or new versions of the General Public License from time to time. Such new versions will be similar in spirit to the present version, but may differ in detail to address new problems or concerns.

Each version is given a distinguishing version number. If the Program specifies a version number of this License which applies to it and "any later version", you have the option of following the terms and conditions either of that version or of any later version published by the Free Software Foundation. If the Program does not specify a version number of this License, you may choose any version ever published by the Free Software Foundation.

10. If you wish to incorporate parts of the Program into other free programs whose distribution conditions are different, write to the author to ask for permission. For software which is copyrighted by the Free Software Foundation, write to the Free Software Foundation; we sometimes make exceptions for this. Our decision will be guided by the two goals of preserving the free status of all derivatives of our free software and of promoting the sharing and reuse of software generally.

### NO WARRANTY

11. BECAUSE THE PROGRAM IS LICENSED FREE OF CHARGE, THERE IS NO WARRANTY FOR THE PROGRAM, TO THE EXTENT PERMITTED BY APPLICABLE LAW. EXCEPT WHEN OTHERWISE STATED IN WRITING THE COPYRIGHT HOLDERS AND/OR OTHER PARTIES PROVIDE THE PROGRAM "AS IS" WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THE ENTIRE RISK AS TO THE QUALITY AND PERFORMANCE OF THE PROGRAM IS WITH YOU. SHOULD THE PROGRAM PROVE DEFECTIVE, YOU ASSUME THE COST OF ALL NECESSARY SERVICING, REPAIR OR CORRECTION.

12. IN NO EVENT UNLESS REQUIRED BY APPLICABLE LAW OR AGREED TO IN WRITING WILL ANY COPYRIGHT HOLDER, OR ANY OTHER PARTY WHO MAY MODIFY AND/OR REDISTRIBUTE THE PROGRAM AS PERMITTED ABOVE, BE LIABLE TO YOU FOR DAMAGES, INCLUDING ANY GENERAL, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES ARISING OUT OF THE USE OR INABILITY TO USE THE PROGRAM (INCLUDING BUT NOT LIMITED TO LOSS OF DATA OR DATA BEING RENDERED INACCURATE OR LOSSES SUSTAINED BY YOU OR THIRD PARTIES OR A FAILURE OF THE PROGRAM TO OPERATE WITH ANY OTHER PROGRAMS), EVEN IF SUCH HOLDER OR OTHER PARTY HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES.

### END OF TERMS AND CONDITIONS

### How to Apply These Terms to Your New Programs

If you develop a new program, and you want it to be of the greatest possible use to the public, the best way to achieve this is to make it free software which everyone can redistribute and change under these terms.

To do so, attach the following notices to the program. It is safest to attach them to the start of each source file to most effectively convey the exclusion of warranty; and each file should have at least the "copyright" line and a pointer to where the full notice is found.

one line to give the program's name and an idea of what it does.

```
Copyright (C) yyyy  name of author
```

```
This program is free software; you can redistribute it and/or modify it under the terms of
the GNU General Public License as published by the Free Software Foundation; either version
2 of the License, or (at your option) any later version.
```

```
This program is distributed in the hope that it will be useful, but WITHOUT ANY WARRANTY;
without even the implied warranty of MERCHANTABILITY or FITNESS FOR A PARTICULAR PURPOSE.
See the GNU General Public License for more details.
```

```
You should have received a copy of the GNU General Public License along with this program;
if not, write to the Free Software Foundation, Inc., 51 Franklin Street, Fifth Floor, Boston,
MA 02110-1301, USA.
```

Also add information on how to contact you by electronic and paper mail.

If the program is interactive, make it output a short notice like this when it starts in an interactive mode:

```
Gnomovision version 69, Copyright (C) year name of author
```

```
Gnomovision comes with ABSOLUTELY NO WARRANTY; for details type `show w'. This is free
software, and you are welcome to redistribute it under certain conditions; type `show c' for
details.
```

The hypothetical commands `show w' and `show c' should show the appropriate parts of the General Public License. Of course, the commands you use may be called something other than `show w' and `show c'; they could even be mouse-clicks or menu items--whatever suits your program.

You should also get your employer (if you work as a programmer) or your school, if any, to sign a "copyright disclaimer" for the program, if necessary. Here is a sample; alter the names:

```
Yoyodyne, Inc., hereby disclaims all copyright interest in the program `Gnomovision' (which
makes passes at compilers) written by James Hacker.
```

```
signature of Ty Coon, 1 April 1989
```

```
Ty Coon, President of Vice
```

This General Public License does not permit incorporating your program into proprietary programs. If your program is a subroutine library, you may consider it more useful to permit linking proprietary applications with the library. If this is what you want to do, use the GNU Lesser General Public License instead of this License.

---

### C. GNU GPL v3

#### GNU GENERAL PUBLIC LICENSE

Version 3, 29 June 2007

Copyright © 2007 Free Software Foundation, Inc. <<https://fsf.org/>>

Everyone is permitted to copy and distribute verbatim copies of this license document, but changing it is not allowed.

#### Preamble

The GNU General Public License is a free, copyleft license for software and other kinds of works.

The licenses for most software and other practical works are designed to take away your freedom to share and change the works. By contrast, the GNU General Public License is intended to guarantee your freedom to share and change all versions of a program--to make sure it remains free software for all its users. We, the Free Software Foundation, use the GNU General Public License for most of our software; it applies also to any other work released this way by its authors. You can apply it to your programs, too.

When we speak of free software, we are referring to freedom, not price. Our General Public Licenses are designed to make sure that you have the freedom to distribute copies of free software (and charge for them if you wish), that you receive source code or can get it if you want it, that you can change the software or use pieces of it in new free programs, and that you know you can do these things.

To protect your rights, we need to prevent others from denying you these rights or asking you to surrender the rights. Therefore, you have certain responsibilities if you distribute copies of the software, or if you modify it: responsibilities to respect the freedom of others.

For example, if you distribute copies of such a program, whether gratis or for a fee, you must pass on to the recipients the same freedoms that you received. You must make sure that they, too, receive or can get the source code. And you must show them these terms so they know their rights.

Developers that use the GNU GPL protect your rights with two steps: (1) assert copyright on the software, and (2) offer you this License giving you legal permission to copy, distribute and/or modify it.

For the developers' and authors' protection, the GPL clearly explains that there is no warranty for this free software. For both users' and authors' sake, the GPL requires that modified versions be marked as changed, so that their problems will not be attributed erroneously to authors of previous versions.

Some devices are designed to deny users access to install or run modified versions of the software inside them, although the manufacturer can do so. This is fundamentally incompatible with the aim of protecting users' freedom to change the software. The systematic pattern of such abuse occurs in the area of products for individuals to use, which is precisely where it is most unacceptable. Therefore, we have designed this version of the GPL to prohibit the practice for those products. If such problems arise substantially in other domains, we stand ready to extend this provision to those domains in future versions of the GPL, as needed to protect the freedom of users.

Finally, every program is threatened constantly by software patents. States should not allow patents to restrict development and use of software on general-purpose computers, but in those that do, we wish to avoid the special danger that patents applied to a free program could make it effectively proprietary. To prevent this, the GPL assures that patents cannot be used to render the program non-free.

The precise terms and conditions for copying, distribution and modification follow.

### TERMS AND CONDITIONS

#### 0. Definitions.

"This License" refers to version 3 of the GNU General Public License.

"Copyright" also means copyright-like laws that apply to other kinds of works, such as semiconductor masks.

"The Program" refers to any copyrightable work licensed under this License. Each licensee is addressed as "you". "Licensees" and "recipients" may be individuals or organizations.

To "modify" a work means to copy from or adapt all or part of the work in a fashion requiring copyright permission, other than the making of an exact copy. The resulting work is called a "modified version" of the earlier work or a work "based on" the earlier work.

A "covered work" means either the unmodified Program or a work based on the Program.

To "propagate" a work means to do anything with it that, without permission, would make you directly or secondarily liable for infringement under applicable copyright law, except executing it on a computer or modifying a private copy. Propagation includes copying, distribution (with or without modification), making available to the public, and in some countries other activities as well.

To "convey" a work means any kind of propagation that enables other parties to make or receive copies. Mere interaction with a user through a computer network, with no transfer of a copy, is not conveying.

An interactive user interface displays "Appropriate Legal Notices" to the extent that it includes a convenient and prominently visible feature that (1) displays an appropriate copyright notice, and (2) tells the user that there is no warranty for the work (except to the extent that warranties are provided), that licensees may convey the work under this License, and how to view a copy of this License. If the interface presents a list of user commands or options, such as a menu, a prominent item in the list meets this criterion.

#### 1. Source Code.

The "source code" for a work means the preferred form of the work for making modifications to it. "Object code" means any non-source form of a work.

A "Standard Interface" means an interface that either is an official standard defined by a recognized standards body, or, in the case of interfaces specified for a particular programming language, one that is widely used among developers working in that language.

The "System Libraries" of an executable work include anything, other than the work as a whole, that (a) is included in the normal form of packaging a Major Component, but which is not part of that Major Component, and (b) serves only to enable use of the work with that Major Component, or to implement a Standard Interface for which an implementation is available to the public in source code form. A "Major Component", in this context, means a major essential component (kernel, window system, and so on) of the specific operating system (if any) on which the executable work runs, or a compiler used to produce the work, or an object code interpreter used to run it.

The "Corresponding Source" for a work in object code form means all the source code needed to generate, install, and (for an executable work) run the object code and to modify the work, including scripts to control those activities. However, it does not include the work's System Libraries, or general-purpose tools or generally available free programs which are used unmodified in performing those activities but which are not part of the work. For example, Corresponding Source includes interface definition files associated with source files for the work, and the source code for shared libraries and dynamically linked subprograms that the work is specifically designed to require, such as by intimate data communication or control flow between those subprograms and other parts of the work.

The Corresponding Source need not include anything that users can regenerate automatically from other parts of the Corresponding Source.

The Corresponding Source for a work in source code form is that same work.

# Appendix A: Black Box Open Source Software License Disclaimer

---

## 2. Basic Permissions.

All rights granted under this License are granted for the term of copyright on the Program, and are irrevocable provided the stated conditions are met. This License explicitly affirms your unlimited permission to run the unmodified Program. The output from running a covered work is covered by this License only if the output, given its content, constitutes a covered work. This License acknowledges your rights of fair use or other equivalent, as provided by copyright law.

You may make, run and propagate covered works that you do not convey, without conditions so long as your license otherwise remains in force. You may convey covered works to others for the sole purpose of having them make modifications exclusively for you, or provide you with facilities for running those works, provided that you comply with the terms of this License in conveying all material for which you do not control copyright. Those thus making or running the covered works for you must do so exclusively on your behalf, under your direction and control, on terms that prohibit them from making any copies of your copyrighted material outside their relationship with you.

Conveying under any other circumstances is permitted solely under the conditions stated below. Sublicensing is not allowed; section 10 makes it unnecessary.

## 3. Protecting Users' Legal Rights From Anti-Circumvention Law.

No covered work shall be deemed part of an effective technological measure under any applicable law fulfilling obligations under article 11 of the WIPO copyright treaty adopted on 20 December 1996, or similar laws prohibiting or restricting circumvention of such measures.

When you convey a covered work, you waive any legal power to forbid circumvention of technological measures to the extent such circumvention is effected by exercising rights under this License with respect to the covered work, and you disclaim any intention to limit operation or modification of the work as a means of enforcing, against the work's users, your or third parties' legal rights to forbid circumvention of technological measures.

## 4. Conveying Verbatim Copies.

You may convey verbatim copies of the Program's source code as you receive it, in any medium, provided that you conspicuously and appropriately publish on each copy an appropriate copyright notice; keep intact all notices stating that this License and any non-permissive terms added in accord with section 7 apply to the code; keep intact all notices of the absence of any warranty; and give all recipients a copy of this License along with the Program.

You may charge any price or no price for each copy that you convey, and you may offer support or warranty protection for a fee.

## 5. Conveying Modified Source Versions.

You may convey a work based on the Program, or the modifications to produce it from the Program, in the form of source code under the terms of section 4, provided that you also meet all of these conditions:

- a) The work must carry prominent notices stating that you modified it, and giving a relevant date.
- b) The work must carry prominent notices stating that it is released under this License and any conditions added under section 7. This requirement modifies the requirement in section 4 to "keep intact all notices".
- c) You must license the entire work, as a whole, under this License to anyone who comes into possession of a copy. This License will therefore apply, along with any applicable section 7 additional terms, to the whole of the work, and all its parts, regardless of how they are packaged. This License gives no permission to license the work in any other way, but it does not invalidate such permission if you have separately received it.
- d) If the work has interactive user interfaces, each must display Appropriate Legal Notices; however, if the Program has interactive interfaces that do not display Appropriate Legal Notices, your work need not make them do so.

A compilation of a covered work with other separate and independent works, which are not by their nature extensions of the covered work, and which are not combined with it such as to form a larger program, in or on a volume of a storage or distribution medium, is called an "aggregate" if the compilation and its resulting copyright are not used to limit the access or legal rights of the compilation's users beyond what the individual works permit. Inclusion of a covered work in an aggregate does not cause this License to apply to the other parts of the aggregate.

### 6. Conveying Non-Source Forms.

You may convey a covered work in object code form under the terms of sections 4 and 5, provided that you also convey the machine-readable Corresponding Source under the terms of this License, in one of these ways:

- a) Convey the object code in, or embodied in, a physical product (including a physical distribution medium), accompanied by the Corresponding Source fixed on a durable physical medium customarily used for software interchange.
- b) Convey the object code in, or embodied in, a physical product (including a physical distribution medium), accompanied by a written offer, valid for at least three years and valid for as long as you offer spare parts or customer support for that product model, to give anyone who possesses the object code either (1) a copy of the Corresponding Source for all the software in the product that is covered by this License, on a durable physical medium customarily used for software interchange, for a price no more than your reasonable cost of physically performing this conveying of source, or (2) access to copy the Corresponding Source from a network server at no charge.
- c) Convey individual copies of the object code with a copy of the written offer to provide the Corresponding Source. This alternative is allowed only occasionally and noncommercially, and only if you received the object code with such an offer, in accord with subsection 6b.
- d) Convey the object code by offering access from a designated place (gratis or for a charge), and offer equivalent access to the Corresponding Source in the same way through the same place at no further charge. You need not require recipients to copy the Corresponding Source along with the object code. If the place to copy the object code is a network server, the Corresponding Source may be on a different server (operated by you or a third party) that supports equivalent copying facilities, provided you maintain clear directions next to the object code saying where to find the Corresponding Source. Regardless of what server hosts the Corresponding Source, you remain obligated to ensure that it is available for as long as needed to satisfy these requirements.
- e) Convey the object code using peer-to-peer transmission, provided you inform other peers where the object code and Corresponding Source of the work are being offered to the general public at no charge under subsection 6d.

A separable portion of the object code, whose source code is excluded from the Corresponding Source as a System Library, need not be included in conveying the object code work.

A “User Product” is either (1) a “consumer product”, which means any tangible personal property which is normally used for personal, family, or household purposes, or (2) anything designed or sold for incorporation into a dwelling. In determining whether a product is a consumer product, doubtful cases shall be resolved in favor of coverage. For a particular product received by a particular user, “normally used” refers to a typical or common use of that class of product, regardless of the status of the particular user or of the way in which the particular user actually uses, or expects or is expected to use, the product. A product is a consumer product regardless of whether the product has substantial commercial, industrial or non-consumer uses, unless such uses represent the only significant mode of use of the product.

“Installation Information” for a User Product means any methods, procedures, authorization keys, or other information required to install and execute modified versions of a covered work in that User Product from a modified version of its Corresponding Source. The information must suffice to ensure that the continued functioning of the modified object code is in no case prevented or interfered with solely because modification has been made.

If you convey an object code work under this section in, or with, or specifically for use in, a User Product, and the conveying occurs as part of a transaction in which the right of possession and use of the User Product is transferred to the recipient in perpetuity or for a fixed term (regardless of how the transaction is characterized), the Corresponding Source conveyed under this section must be accompanied by the Installation Information. But this requirement does not apply if neither you nor any third party retains the ability to install modified object code on the User Product (for example, the work has been installed in ROM).

The requirement to provide Installation Information does not include a requirement to continue to provide support service, warranty, or updates for a work that has been modified or installed by the recipient, or for the User Product in which it has been modified or installed. Access to a network may be denied when the modification itself materially and adversely affects the operation of the network or violates the rules and protocols for communication across the network.



## Appendix A: Black Box Open Source Software License Disclaimer

---

Corresponding Source conveyed, and Installation Information provided, in accord with this section must be in a format that is publicly documented (and with an implementation available to the public in source code form), and must require no special password or key for unpacking, reading or copying.

### 7. Additional Terms.

“Additional permissions” are terms that supplement the terms of this License by making exceptions from one or more of its conditions. Additional permissions that are applicable to the entire Program shall be treated as though they were included in this License, to the extent that they are valid under applicable law. If additional permissions apply only to part of the Program, that part may be used separately under those permissions, but the entire Program remains governed by this License without regard to the additional permissions.

When you convey a copy of a covered work, you may at your option remove any additional permissions from that copy, or from any part of it. (Additional permissions may be written to require their own removal in certain cases when you modify the work.) You may place additional permissions on material, added by you to a covered work, for which you have or can give appropriate copyright permission.

Notwithstanding any other provision of this License, for material you add to a covered work, you may (if authorized by the copyright holders of that material) supplement the terms of this License with terms:

- a) Disclaiming warranty or limiting liability differently from the terms of sections 15 and 16 of this License; or
- b) Requiring preservation of specified reasonable legal notices or author attributions in that material or in the Appropriate Legal Notices displayed by works containing it; or
- c) Prohibiting misrepresentation of the origin of that material, or requiring that modified versions of such material be marked in reasonable ways as different from the original version; or
- d) Limiting the use for publicity purposes of names of licensors or authors of the material; or
- e) Declining to grant rights under trademark law for use of some trade names, trademarks, or service marks; or
- f) Requiring indemnification of licensors and authors of that material by anyone who conveys the material (or modified versions of it) with contractual assumptions of liability to the recipient, for any liability that these contractual assumptions directly impose on those licensors and authors.

All other non-permissive additional terms are considered “further restrictions” within the meaning of section 10. If the Program as you received it, or any part of it, contains a notice stating that it is governed by this License along with a term that is a further restriction, you may remove that term. If a license document contains a further restriction but permits relicensing or conveying under this License, you may add to a covered work material governed by the terms of that license document, provided that the further restriction does not survive such relicensing or conveying.

If you add terms to a covered work in accord with this section, you must place, in the relevant source files, a statement of the additional terms that apply to those files, or a notice indicating where to find the applicable terms.

Additional terms, permissive or non-permissive, may be stated in the form of a separately written license, or stated as exceptions; the above requirements apply either way.

### 8. Termination.

You may not propagate or modify a covered work except as expressly provided under this License. Any attempt otherwise to propagate or modify it is void, and will automatically terminate your rights under this License (including any patent licenses granted under the third paragraph of section 11).

However, if you cease all violation of this License, then your license from a particular copyright holder is reinstated (a) provisionally, unless and until the copyright holder explicitly and finally terminates your license, and (b) permanently, if the copyright holder fails to notify you of the violation by some reasonable means prior to 60 days after the cessation.

Moreover, your license from a particular copyright holder is reinstated permanently if the copyright holder notifies you of the violation by some reasonable means, this is the first time you have received notice of violation of this License (for any work) from that copyright holder, and you cure the violation prior to 30 days after your receipt of the notice.

Termination of your rights under this section does not terminate the licenses of parties who have received copies or rights from you under this License. If your rights have been terminated and not permanently reinstated, you do not qualify to receive new licenses for the same material under section 10.

### **9. Acceptance Not Required for Having Copies.**

You are not required to accept this License in order to receive or run a copy of the Program. Ancillary propagation of a covered work occurring solely as a consequence of using peer-to-peer transmission to receive a copy likewise does not require acceptance. However, nothing other than this License grants you permission to propagate or modify any covered work. These actions infringe copyright if you do not accept this License. Therefore, by modifying or propagating a covered work, you indicate your acceptance of this License to do so.

### **10. Automatic Licensing of Downstream Recipients.**

Each time you convey a covered work, the recipient automatically receives a license from the original licensors, to run, modify and propagate that work, subject to this License. You are not responsible for enforcing compliance by third parties with this License.

An “entity transaction” is a transaction transferring control of an organization, or substantially all assets of one, or subdividing an organization, or merging organizations. If propagation of a covered work results from an entity transaction, each party to that transaction who receives a copy of the work also receives whatever licenses to the work the party's predecessor in interest had or could give under the previous paragraph, plus a right to possession of the Corresponding Source of the work from the predecessor in interest, if the predecessor has it or can get it with reasonable efforts.

You may not impose any further restrictions on the exercise of the rights granted or affirmed under this License. For example, you may not impose a license fee, royalty, or other charge for exercise of rights granted under this License, and you may not initiate litigation (including a cross-claim or counterclaim in a lawsuit) alleging that any patent claim is infringed by making, using, selling, offering for sale, or importing the Program or any portion of it.

### **11. Patents.**

A “contributor” is a copyright holder who authorizes use under this License of the Program or a work on which the Program is based. The work thus licensed is called the contributor's “contributor version”.

A contributor's “essential patent claims” are all patent claims owned or controlled by the contributor, whether already acquired or hereafter acquired, that would be infringed by some manner, permitted by this License, of making, using, or selling its contributor version, but do not include claims that would be infringed only as a consequence of further modification of the contributor version. For purposes of this definition, “control” includes the right to grant patent sublicenses in a manner consistent with the requirements of this License.

Each contributor grants you a non-exclusive, worldwide, royalty-free patent license under the contributor's essential patent claims, to make, use, sell, offer for sale, import and otherwise run, modify and propagate the contents of its contributor version.

In the following three paragraphs, a “patent license” is any express agreement or commitment, however denominated, not to enforce a patent (such as an express permission to practice a patent or covenant not to sue for patent infringement). To “grant” such a patent license to a party means to make such an agreement or commitment not to enforce a patent against the party.

If you convey a covered work, knowingly relying on a patent license, and the Corresponding Source of the work is not available for anyone to copy, free of charge and under the terms of this License, through a publicly available network server or other readily accessible means, then you must either (1) cause the Corresponding Source to be so available, or (2) arrange to deprive yourself of the benefit of the patent license for this particular work, or (3) arrange, in a manner consistent with the requirements of this License, to extend the patent license to downstream recipients. “Knowingly relying” means you have actual knowledge that, but for the patent license, your conveying the covered work in a country, or your recipient's use of the covered work in a country, would infringe one or more identifiable patents in that country that you have reason to believe are valid.

## Appendix A: Black Box Open Source Software License Disclaimer

---

If, pursuant to or in connection with a single transaction or arrangement, you convey, or propagate by procuring conveyance of, a covered work, and grant a patent license to some of the parties receiving the covered work authorizing them to use, propagate, modify or convey a specific copy of the covered work, then the patent license you grant is automatically extended to all recipients of the covered work and works based on it.

A patent license is “discriminatory” if it does not include within the scope of its coverage, prohibits the exercise of, or is conditioned on the non-exercise of one or more of the rights that are specifically granted under this License. You may not convey a covered work if you are a party to an arrangement with a third party that is in the business of distributing software, under which you make payment to the third party based on the extent of your activity of conveying the work, and under which the third party grants, to any of the parties who would receive the covered work from you, a discriminatory patent license (a) in connection with copies of the covered work conveyed by you (or copies made from those copies), or (b) primarily for and in connection with specific products or compilations that contain the covered work, unless you entered into that arrangement, or that patent license was granted, prior to 28 March 2007.

Nothing in this License shall be construed as excluding or limiting any implied license or other defenses to infringement that may otherwise be available to you under applicable patent law.

### **12. No Surrender of Others' Freedom.**

If conditions are imposed on you (whether by court order, agreement or otherwise) that contradict the conditions of this License, they do not excuse you from the conditions of this License. If you cannot convey a covered work so as to satisfy simultaneously your obligations under this License and any other pertinent obligations, then as a consequence you may not convey it at all. For example, if you agree to terms that obligate you to collect a royalty for further conveying from those to whom you convey the Program, the only way you could satisfy both those terms and this License would be to refrain entirely from conveying the Program.

### **13. Use with the GNU Affero General Public License.**

Notwithstanding any other provision of this License, you have permission to link or combine any covered work with a work licensed under version 3 of the GNU Affero General Public License into a single combined work, and to convey the resulting work. The terms of this License will continue to apply to the part which is the covered work, but the special requirements of the GNU Affero General Public License, section 13, concerning interaction through a network will apply to the combination as such.

### **14. Revised Versions of this License.**

The Free Software Foundation may publish revised and/or new versions of the GNU General Public License from time to time. Such new versions will be similar in spirit to the present version, but may differ in detail to address new problems or concerns.

Each version is given a distinguishing version number. If the Program specifies that a certain numbered version of the GNU General Public License “or any later version” applies to it, you have the option of following the terms and conditions either of that numbered version or of any later version published by the Free Software Foundation. If the Program does not specify a version number of the GNU General Public License, you may choose any version ever published by the Free Software Foundation.

If the Program specifies that a proxy can decide which future versions of the GNU General Public License can be used, that proxy's public statement of acceptance of a version permanently authorizes you to choose that version for the Program.

Later license versions may give you additional or different permissions. However, no additional obligations are imposed on any author or copyright holder as a result of your choosing to follow a later version.

### **15. Disclaimer of Warranty.**

THERE IS NO WARRANTY FOR THE PROGRAM, TO THE EXTENT PERMITTED BY APPLICABLE LAW. EXCEPT WHEN OTHERWISE STATED IN WRITING THE COPYRIGHT HOLDERS AND/OR OTHER PARTIES PROVIDE THE PROGRAM “AS IS” WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THE ENTIRE RISK AS TO THE QUALITY AND PERFORMANCE OF THE PROGRAM IS WITH YOU. SHOULD THE PROGRAM PROVE DEFECTIVE, YOU ASSUME THE COST OF ALL NECESSARY SERVICING, REPAIR OR CORRECTION.

### 16. Limitation of Liability.

IN NO EVENT UNLESS REQUIRED BY APPLICABLE LAW OR AGREED TO IN WRITING WILL ANY COPYRIGHT HOLDER, OR ANY OTHER PARTY WHO MODIFIES AND/OR CONVEYS THE PROGRAM AS PERMITTED ABOVE, BE LIABLE TO YOU FOR DAMAGES, INCLUDING ANY GENERAL, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES ARISING OUT OF THE USE OR INABILITY TO USE THE PROGRAM (INCLUDING BUT NOT LIMITED TO LOSS OF DATA OR DATA BEING RENDERED INACCURATE OR LOSSES SUSTAINED BY YOU OR THIRD PARTIES OR A FAILURE OF THE PROGRAM TO OPERATE WITH ANY OTHER PROGRAMS), EVEN IF SUCH HOLDER OR OTHER PARTY HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES.

### 17. Interpretation of Sections 15 and 16.

If the disclaimer of warranty and limitation of liability provided above cannot be given local legal effect according to their terms, reviewing courts shall apply local law that most closely approximates an absolute waiver of all civil liability in connection with the Program, unless a warranty or assumption of liability accompanies a copy of the Program in return for a fee.

END OF TERMS AND CONDITIONS

### How to Apply These Terms to Your New Programs

If you develop a new program, and you want it to be of the greatest possible use to the public, the best way to achieve this is to make it free software which everyone can redistribute and change under these terms.

To do so, attach the following notices to the program. It is safest to attach them to the start of each source file to most effectively state the exclusion of warranty; and each file should have at least the “copyright” line and a pointer to where the full notice is found.

```
<one line to give the program's name and a brief idea of what it does.>
```

```
Copyright (C) <year> <name of author>
```

```
This program is free software: you can redistribute it and/or modify it under the terms
of the GNU General Public License as published by the Free Software Foundation, either
version 3 of the License, or (at your option) any later version.
```

```
This program is distributed in the hope that it will be useful, but WITHOUT ANY
WARRANTY; without even the implied warranty of MERCHANTABILITY or FITNESS FOR A
PARTICULAR PURPOSE. See the GNU General Public License for more details.
```

```
You should have received a copy of the GNU General Public License along with this
program. If not, see <https://www.gnu.org/licenses/>.
```

Also add information on how to contact you by electronic and paper mail.

If the program does terminal interaction, make it output a short notice like this when it starts in an interactive mode:

```
<program> Copyright (C) <year> <name of author>
```

```
This program comes with ABSOLUTELY NO WARRANTY; for details type `show w'.
```

```
This is free software, and you are welcome to redistribute it under certain conditions;
type `show c' for details.
```

The hypothetical commands `show w' and `show c' should show the appropriate parts of the General Public License. Of course, your program's commands might be different; for a GUI interface, you would use an “about box”.

You should also get your employer (if you work as a programmer) or school, if any, to sign a “copyright disclaimer” for the program, if necessary. For more information on this, and how to apply and follow the GNU GPL, see <<https://www.gnu.org/licenses/>>.

## Appendix A: Black Box Open Source Software License Disclaimer

---

The GNU General Public License does not permit incorporating your program into proprietary programs. If your program is a subroutine library, you may consider it more useful to permit linking proprietary applications with the library. If this is what you want to do, use the GNU Lesser General Public License instead of this License. But first, please read <<https://www.gnu.org/licenses/why-not-lgpl.html>>.

### D. GNU LGPL v2.1

#### GNU LESSER GENERAL PUBLIC LICENSE

Version 2.1, February 1999

Copyright (C) 1991, 1999 Free Software Foundation, Inc.

51 Franklin Street, Fifth Floor, Boston, MA 02110-1301 USA

Everyone is permitted to copy and distribute verbatim copies of this license document, but changing it is not allowed.

[This is the first released version of the Lesser GPL. It also counts as the successor of the GNU Library Public License, version 2, hence the version number 2.1.]

#### Preamble

The licenses for most software are designed to take away your freedom to share and change it. By contrast, the GNU General Public Licenses are intended to guarantee your freedom to share and change free software--to make sure the software is free for all its users.

This license, the Lesser General Public License, applies to some specially designated software packages--typically libraries--of the Free Software Foundation and other authors who decide to use it. You can use it too, but we suggest you first think carefully about whether this license or the ordinary General Public License is the better strategy to use in any particular case, based on the explanations below.

When we speak of free software, we are referring to freedom of use, not price. Our General Public Licenses are designed to make sure that you have the freedom to distribute copies of free software (and charge for this service if you wish); that you receive source code or can get it if you want it; that you can change the software and use pieces of it in new free programs; and that you are informed that you can do these things.

To protect your rights, we need to make restrictions that forbid distributors to deny you these rights or to ask you to surrender these rights. These restrictions translate to certain responsibilities for you if you distribute copies of the library or if you modify it.

For example, if you distribute copies of the library, whether gratis or for a fee, you must give the recipients all the rights that we gave you. You must make sure that they, too, receive or can get the source code. If you link other code with the library, you must provide complete object files to the recipients, so that they can relink them with the library after making changes to the library and recompiling it. And you must show them these terms so they know their rights.

We protect your rights with a two-step method: (1) we copyright the library, and (2) we offer you this license, which gives you legal permission to copy, distribute and/or modify the library.

To protect each distributor, we want to make it very clear that there is no warranty for the free library. Also, if the library is modified by someone else and passed on, the recipients should know that what they have is not the original version, so that the original author's reputation will not be affected by problems that might be introduced by others.

Finally, software patents pose a constant threat to the existence of any free program. We wish to make sure that a company cannot effectively restrict the users of a free program by obtaining a restrictive license from a patent holder. Therefore, we insist that any patent license obtained for a version of the library must be consistent with the full freedom of use specified in this license.

Most GNU software, including some libraries, is covered by the ordinary GNU General Public License. This license, the GNU Lesser General Public License, applies to certain designated libraries, and is quite different from the ordinary General Public License. We use this license for certain libraries in order to permit linking those libraries into non-free programs.

When a program is linked with a library, whether statically or using a shared library, the combination of the two is legally speaking a combined work, a derivative of the original library. The ordinary General Public License therefore permits such linking only if the entire combination fits its criteria of freedom. The Lesser General Public License permits more lax criteria for linking other code with the library.

We call this license the "Lesser" General Public License because it does Less to protect the user's freedom than the ordinary General Public License. It also provides other free software developers Less of an advantage over competing non-free programs. These disadvantages are the reason we use the ordinary General Public License for many libraries. However, the Lesser license provides advantages in certain special circumstances.

For example, on rare occasions, there may be a special need to encourage the widest possible use of a certain library, so that it becomes a de-facto standard. To achieve this, non-free programs must be allowed to use the library. A more frequent case is that a free library does the same job as widely used non-free libraries. In this case, there is little to gain by limiting the free library to free software only, so we use the Lesser General Public License.

In other cases, permission to use a particular library in non-free programs enables a greater number of people to use a large body of free software. For example, permission to use the GNU C Library in non-free programs enables many more people to use the whole GNU operating system, as well as its variant, the GNU/Linux operating system.

Although the Lesser General Public License is Less protective of the users' freedom, it does ensure that the user of a program that is linked with the Library has the freedom and the wherewithal to run that program using a modified version of the Library.

The precise terms and conditions for copying, distribution and modification follow. Pay close attention to the difference between a "work based on the library" and a "work that uses the library". The former contains code derived from the library, whereas the latter must be combined with the library in order to run.

### **TERMS AND CONDITIONS FOR COPYING, DISTRIBUTION AND MODIFICATION**

**0.** This License Agreement applies to any software library or other program which contains a notice placed by the copyright holder or other authorized party saying it may be distributed under the terms of this Lesser General Public License (also called "this License"). Each licensee is addressed as "you".

A "library" means a collection of software functions and/or data prepared so as to be conveniently linked with application programs (which use some of those functions and data) to form executables.

The "Library", below, refers to any such software library or work which has been distributed under these terms. A "work based on the Library" means either the Library or any derivative work under copyright law: that is to say, a work containing the Library or a portion of it, either verbatim or with modifications and/or translated straightforwardly into another language. (Hereinafter, translation is included without limitation in the term "modification".)

"Source code" for a work means the preferred form of the work for making modifications to it. For a library, complete source code means all the source code for all modules it contains, plus any associated interface definition files, plus the scripts used to control compilation and installation of the library.

Activities other than copying, distribution and modification are not covered by this License; they are outside its scope. The act of running a program using the Library is not restricted, and output from such a program is covered only if its contents constitute a work based on the Library (independent of the use of the Library in a tool for writing it). Whether that is true depends on what the Library does and what the program that uses the Library does.

**1.** You may copy and distribute verbatim copies of the Library's complete source code as you receive it, in any medium, provided that you conspicuously and appropriately publish on each copy an appropriate copyright notice and disclaimer of warranty; keep intact all the notices that refer to this License and to the absence of any warranty; and distribute a copy of this License along with the Library.

You may charge a fee for the physical act of transferring a copy, and you may at your option offer warranty protection in exchange for a fee.



## Appendix A: Black Box Open Source Software License Disclaimer

---

2. You may modify your copy or copies of the Library or any portion of it, thus forming a work based on the Library, and copy and distribute such modifications or work under the terms of Section 1 above, provided that you also meet all of these conditions:

- a) The modified work must itself be a software library.
- b) You must cause the files modified to carry prominent notices stating that you changed the files and the date of any change.
- c) You must cause the whole of the work to be licensed at no charge to all third parties under the terms of this License.
- d) If a facility in the modified Library refers to a function or a table of data to be supplied by an application program that uses the facility, other than as an argument passed when the facility is invoked, then you must make a good faith effort to ensure that, in the event an application does not supply such function or table, the facility still operates, and performs whatever part of its purpose remains meaningful.

(For example, a function in a library to compute square roots has a purpose that is entirely well-defined independent of the application. Therefore, Subsection 2d requires that any application-supplied function or table used by this function must be optional: if the application does not supply it, the square root function must still compute square roots.)

These requirements apply to the modified work as a whole. If identifiable sections of that work are not derived from the Library, and can be reasonably considered independent and separate works in themselves, then this License, and its terms, do not apply to those sections when you distribute them as separate works. But when you distribute the same sections as part of a whole which is a work based on the Library, the distribution of the whole must be on the terms of this License, whose permissions for other licensees extend to the entire whole, and thus to each and every part regardless of who wrote it.

Thus, it is not the intent of this section to claim rights or contest your rights to work written entirely by you; rather, the intent is to exercise the right to control the distribution of derivative or collective works based on the Library.

In addition, mere aggregation of another work not based on the Library with the Library (or with a work based on the Library) on a volume of a storage or distribution medium does not bring the other work under the scope of this License.

3. You may opt to apply the terms of the ordinary GNU General Public License instead of this License to a given copy of the Library. To do this, you must alter all the notices that refer to this License, so that they refer to the ordinary GNU General Public License, version 2, instead of to this License. (If a newer version than version 2 of the ordinary GNU General Public License has appeared, then you can specify that version instead if you wish.) Do not make any other change in these notices.

Once this change is made in a given copy, it is irreversible for that copy, so the ordinary GNU General Public License applies to all subsequent copies and derivative works made from that copy.

This option is useful when you wish to copy part of the code of the Library into a program that is not a library.

4. You may copy and distribute the Library (or a portion or derivative of it, under Section 2) in object code or executable form under the terms of Sections 1 and 2 above provided that you accompany it with the complete corresponding machine-readable source code, which must be distributed under the terms of Sections 1 and 2 above on a medium customarily used for software interchange.

If distribution of object code is made by offering access to copy from a designated place, then offering equivalent access to copy the source code from the same place satisfies the requirement to distribute the source code, even though third parties are not compelled to copy the source along with the object code.

5. A program that contains no derivative of any portion of the Library, but is designed to work with the Library by being compiled or linked with it, is called a "work that uses the Library". Such a work, in isolation, is not a derivative work of the Library, and therefore falls outside the scope of this License.

However, linking a "work that uses the Library" with the Library creates an executable that is a derivative of the Library (because it contains portions of the Library), rather than a "work that uses the library". The executable is therefore covered by this License. Section 6 states terms for distribution of such executables.

When a "work that uses the Library" uses material from a header file that is part of the Library, the object code for the work may be a derivative work of the Library even though the source code is not. Whether this is true is especially significant if the work can be linked without the Library, or if the work is itself a library. The threshold for this to be true is not precisely defined by law.

If such an object file uses only numerical parameters, data structure layouts and accessors, and small macros and small inline functions (ten lines or less in length), then the use of the object file is unrestricted, regardless of whether it is legally a derivative work. (Executables containing this object code plus portions of the Library will still fall under Section 6.)

Otherwise, if the work is a derivative of the Library, you may distribute the object code for the work under the terms of Section 6. Any executables containing that work also fall under Section 6, whether or not they are linked directly with the Library itself.

**6.** As an exception to the Sections above, you may also combine or link a "work that uses the Library" with the Library to produce a work containing portions of the Library, and distribute that work under terms of your choice, provided that the terms permit modification of the work for the customer's own use and reverse engineering for debugging such modifications.

You must give prominent notice with each copy of the work that the Library is used in it and that the Library and its use are covered by this License. You must supply a copy of this License. If the work during execution displays copyright notices, you must include the copyright notice for the Library among them, as well as a reference directing the user to the copy of this License. Also, you must do one of these things:

- a) Accompany the work with the complete corresponding machine-readable source code for the Library including whatever changes were used in the work (which must be distributed under Sections 1 and 2 above); and, if the work is an executable linked with the Library, with the complete machine-readable "work that uses the Library", as object code and/or source code, so that the user can modify the Library and then relink to produce a modified executable containing the modified Library. (It is understood that the user who changes the contents of definitions files in the Library will not necessarily be able to recompile the application to use the modified definitions.)
- b) Use a suitable shared library mechanism for linking with the Library. A suitable mechanism is one that (1) uses at run time a copy of the library already present on the user's computer system, rather than copying library functions into the executable, and (2) will operate properly with a modified version of the library, if the user installs one, as long as the modified version is interface-compatible with the version that the work was made with.
- c) Accompany the work with a written offer, valid for at least three years, to give the same user the materials specified in Subsection 6a, above, for a charge no more than the cost of performing this distribution.
- d) If distribution of the work is made by offering access to copy from a designated place, offer equivalent access to copy the above specified materials from the same place.
- e) Verify that the user has already received a copy of these materials or that you have already sent this user a copy.

For an executable, the required form of the "work that uses the Library" must include any data and utility programs needed for reproducing the executable from it. However, as a special exception, the materials to be distributed need not include anything that is normally distributed (in either source or binary form) with the major components (compiler, kernel, and so on) of the operating system on which the executable runs, unless that component itself accompanies the executable.

It may happen that this requirement contradicts the license restrictions of other proprietary libraries that do not normally accompany the operating system. Such a contradiction means you cannot use both them and the Library together in an executable that you distribute.

**7.** You may place library facilities that are a work based on the Library side-by-side in a single library together with other library facilities not covered by this License, and distribute such a combined library, provided that the separate distribution of the work based on the Library and of the other library facilities is otherwise permitted, and provided that you do these two things:

- a) Accompany the combined library with a copy of the same work based on the Library, uncombined with any other library facilities. This must be distributed under the terms of the Sections above.
- b) Give prominent notice with the combined library of the fact that part of it is a work based on the Library, and explaining where to find the accompanying uncombined form of the same work.

**8.** You may not copy, modify, sublicense, link with, or distribute the Library except as expressly provided under this License. Any attempt otherwise to copy, modify, sublicense, link with, or distribute the Library is void, and will automatically terminate your rights under this License. However, parties who have received copies, or rights, from you under this License will not have their licenses terminated so long as such parties remain in full compliance.

## Appendix A: Black Box Open Source Software License Disclaimer

---

9. You are not required to accept this License, since you have not signed it. However, nothing else grants you permission to modify or distribute the Library or its derivative works. These actions are prohibited by law if you do not accept this License. Therefore, by modifying or distributing the Library (or any work based on the Library), you indicate your acceptance of this License to do so, and all its terms and conditions for copying, distributing or modifying the Library or works based on it.

10. Each time you redistribute the Library (or any work based on the Library), the recipient automatically receives a license from the original licensor to copy, distribute, link with or modify the Library subject to these terms and conditions. You may not impose any further restrictions on the recipients' exercise of the rights granted herein. You are not responsible for enforcing compliance by third parties with this License.

11. If, as a consequence of a court judgment or allegation of patent infringement or for any other reason (not limited to patent issues), conditions are imposed on you (whether by court order, agreement or otherwise) that contradict the conditions of this License, they do not excuse you from the conditions of this License. If you cannot distribute so as to satisfy simultaneously your obligations under this License and any other pertinent obligations, then as a consequence you may not distribute the Library at all. For example, if a patent license would not permit royalty-free redistribution of the Library by all those who receive copies directly or indirectly through you, then the only way you could satisfy both it and this License would be to refrain entirely from distribution of the Library.

If any portion of this section is held invalid or unenforceable under any particular circumstance, the balance of the section is intended to apply, and the section as a whole is intended to apply in other circumstances.

It is not the purpose of this section to induce you to infringe any patents or other property right claims or to contest validity of any such claims; this section has the sole purpose of protecting the integrity of the free software distribution system which is implemented by public license practices. Many people have made generous contributions to the wide range of software distributed through that system in reliance on consistent application of that system; it is up to the author/donor to decide if he or she is willing to distribute software through any other system and a licensee cannot impose that choice.

This section is intended to make thoroughly clear what is believed to be a consequence of the rest of this License.

12. If the distribution and/or use of the Library is restricted in certain countries either by patents or by copyrighted interfaces, the original copyright holder who places the Library under this License may add an explicit geographical distribution limitation excluding those countries, so that distribution is permitted only in or among countries not thus excluded. In such case, this License incorporates the limitation as if written in the body of this License.

13. The Free Software Foundation may publish revised and/or new versions of the Lesser General Public License from time to time. Such new versions will be similar in spirit to the present version, but may differ in detail to address new problems or concerns.

Each version is given a distinguishing version number. If the Library specifies a version number of this License which applies to it and "any later version", you have the option of following the terms and conditions either of that version or of any later version published by the Free Software Foundation. If the Library does not specify a license version number, you may choose any version ever published by the Free Software Foundation.

14. If you wish to incorporate parts of the Library into other free programs whose distribution conditions are incompatible with these, write to the author to ask for permission. For software which is copyrighted by the Free Software Foundation, write to the Free Software Foundation; we sometimes make exceptions for this. Our decision will be guided by the two goals of preserving the free status of all derivatives of our free software and of promoting the sharing and reuse of software generally.

### **NO WARRANTY**

15. BECAUSE THE LIBRARY IS LICENSED FREE OF CHARGE, THERE IS NO WARRANTY FOR THE LIBRARY, TO THE EXTENT PERMITTED BY APPLICABLE LAW. EXCEPT WHEN OTHERWISE STATED IN WRITING THE COPYRIGHT HOLDERS AND/OR OTHER PARTIES PROVIDE THE LIBRARY "AS IS" WITHOUT WARRANTY OF ANY KIND, EITHER EXPRESSED OR IMPLIED, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THE ENTIRE RISK AS TO THE QUALITY AND PERFORMANCE OF THE LIBRARY IS WITH YOU. SHOULD THE LIBRARY PROVE DEFECTIVE, YOU ASSUME THE COST OF ALL NECESSARY SERVICING, REPAIR OR CORRECTION.

16. IN NO EVENT UNLESS REQUIRED BY APPLICABLE LAW OR AGREED TO IN WRITING WILL ANY COPYRIGHT HOLDER, OR ANY OTHER PARTY WHO MAY MODIFY AND/OR REDISTRIBUTE THE LIBRARY AS PERMITTED ABOVE, BE LIABLE TO YOU FOR DAMAGES, INCLUDING ANY GENERAL, SPECIAL, INCIDENTAL OR CONSEQUENTIAL DAMAGES ARISING OUT OF THE USE OR INABILITY TO USE THE LIBRARY (INCLUDING BUT NOT LIMITED TO LOSS OF DATA OR DATA BEING RENDERED INACCURATE OR LOSSES SUSTAINED BY YOU OR THIRD PARTIES OR A FAILURE OF THE LIBRARY TO OPERATE WITH ANY OTHER SOFTWARE), EVEN IF SUCH HOLDER OR OTHER PARTY HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES.

### END OF TERMS AND CONDITIONS

#### How to Apply These Terms to Your New Libraries

If you develop a new library, and you want it to be of the greatest possible use to the public, we recommend making it free software that everyone can redistribute and change. You can do so by permitting redistribution under these terms (or, alternatively, under the terms of the ordinary General Public License).

To apply these terms, attach the following notices to the library. It is safest to attach them to the start of each source file to most effectively convey the exclusion of warranty; and each file should have at least the "copyright" line and a pointer to where the full notice is found.

one line to give the library's name and an idea of what it does.

Copyright (C) year name of author

This library is free software; you can redistribute it and/or modify it under the terms of the GNU Lesser General Public License as published by the Free Software Foundation; either version 2.1 of the License, or (at your option) any later version.

This library is distributed in the hope that it will be useful, but WITHOUT ANY WARRANTY; without even the implied warranty of MERCHANTABILITY or FITNESS FOR A PARTICULAR PURPOSE. See the GNU Lesser General Public License for more details.

You should have received a copy of the GNU Lesser General Public License along with this library; if not, write to the Free Software Foundation, Inc., 51 Franklin Street, Fifth Floor, Boston, MA 02110-1301 USA

Also add information on how to contact you by electronic and paper mail.

You should also get your employer (if you work as a programmer) or your school, if any, to sign a "copyright disclaimer" for the library, if necessary. Here is a sample; alter the names:

Yoyodyne, Inc., hereby disclaims all copyright interest in the library `Frob' (a library for tweaking knobs) written by James Random Hacker.

signature of Ty Coon, 1 April 1990

Ty Coon, President of Vice

That's all there is to it!

## Appendix A: Black Box Open Source Software License Disclaimer

---

### E. BSD and BSD like Licenses

- lighttpd

Copyright (c) 2004, Jan Kneschke, incremental

All rights reserved.

- Redistribution and use in source and binary forms, with or without modification, are permitted provided that the following conditions are met:
- Redistributions of source code must retain the above copyright notice, this list of conditions and the following disclaimer.
- Redistributions in binary form must reproduce the above copyright notice, this list of conditions and the following disclaimer in the documentation and/or other materials provided with the distribution.
- Neither the name of the 'incremental' nor the names of its contributors may be used to endorse or promote products derived from this software without specific prior written permission.

THIS SOFTWARE IS PROVIDED BY THE COPYRIGHT HOLDERS AND CONTRIBUTORS "AS IS" AND ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE DISCLAIMED. IN NO EVENT SHALL THE COPYRIGHT OWNER OR CONTRIBUTORS BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, SPECIAL, EXEMPLARY, OR CONSEQUENTIAL DAMAGES (INCLUDING, BUT NOT LIMITED TO, PROCUREMENT OF SUBSTITUTE GOODS OR SERVICES; LOSS OF USE, DATA, OR PROFITS; OR BUSINESS INTERRUPTION) HOWEVER CAUSED AND ON ANY THEORY OF LIABILITY, WHETHER IN CONTRACT, STRICT LIABILITY, OR TORT (INCLUDING NEGLIGENCE OR OTHERWISE) ARISING IN ANY WAY OUT OF THE USE OF THIS SOFTWARE, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGE.

- Ppp

All of the code can be freely used and redistributed. The individual source files each have their own copyright and permission notice. Pppd, pppstats and pppdump are under BSD-style notices. Some of the pppd plugins are GPL'd. Chat is public domain.

- Tcpcdump

Redistribution and use in source and binary forms, with or without modification, are permitted provided that the following conditions are met:

1. Redistributions of source code must retain the above copyright notice, this list of conditions and the following disclaimer.
2. Redistributions in binary form must reproduce the above copyright notice, this list of conditions and the following disclaimer in the documentation and/or other materials provided with the distribution.
3. The names of the authors may not be used to endorse or promote products derived from this software without specific prior written permission.

THIS SOFTWARE IS PROVIDED "AS IS" AND WITHOUT ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING, WITHOUT LIMITATION, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE.

- zip

This is version 2005-Feb-10 of the Info-ZIP copyright and license. The definitive version of this document should be available at <ftp://ftp.info-zip.org/pub/infozip/license.html> indefinitely.

Copyright (c) 1990-2005 Info-ZIP. All rights reserved.

For the purposes of this copyright and license, "Info-ZIP" is defined as the following set of individuals:

Mark Adler, John Bush, Karl Davis, Harald Denker, Jean-Michel Dubois, Jean-loup Gailly, Hunter Goatley, Ed Gordon, Ian Gorman, Chris Herborth, Dirk Haase, Greg Hartwig, Robert Heath, Jonathan Hudson, Paul Kienitz, David Kirschbaum, Johnny Lee, Onno van der Linden, Igor Mandrichenko, Steve P. Miller, Sergio Monesi, Keith Owens, George Petrov, Greg Roelofs, Kai Uwe Rommel, Steve Salisbury, Dave Smith, Steven M. Schweda, Christian Spieler, Cosmin Truta, Antoine Verheijen, Paul von Behren, Rich Wales, Mike White

This software is provided "as is," without warranty of any kind, express or implied. In no event shall Info-ZIP or its contributors be held liable for any direct, indirect, incidental, special or consequential damages arising out of the use of or inability to use this software.

Permission is granted to anyone to use this software for any purpose, including commercial applications, and to alter it and redistribute it freely, subject to the following restrictions:

1. Redistributions of source code must retain the above copyright notice, definition, disclaimer, and this list of conditions.
2. Redistributions in binary form (compiled executables) must reproduce the above copyright notice, definition, disclaimer, and this list of conditions in documentation and/or other materials provided with the distribution. The sole exception to this condition is redistribution of a standard UnZipSFX binary (including SFXWiz) as part of a self-extracting archive; that is permitted without inclusion of this license, as long as the normal SFX banner has not been removed from the binary or disabled.
3. Altered versions--including, but not limited to, ports to new operating systems, existing ports with new graphical interfaces, and dynamic, shared, or static library versions--must be plainly marked as such and must not be misrepresented as being the original source. Such altered versions also must not be misrepresented as being Info-ZIP releases--including, but not limited to, labeling of the altered versions with the names "Info-ZIP" (or any variation thereof, including, but not limited to, different capitalizations), "Pocket UnZip," "WiZ" or "MacZip" without the explicit permission of Info-ZIP. Such altered versions are further prohibited from misrepresentative use of the Zip-Bugs or Info-ZIP e-mail addresses or of the Info-ZIP URL(s).
4. Info-ZIP retains the right to use the names "Info-ZIP," "Zip," "UnZip," "UnZipSFX," "WiZ," "Pocket UnZip," "Pocket Zip," and "MacZip" for its own source and binary releases.

### F. Other Licenses

- Dropbear

License terms available at <https://github.com/mkj/dropbear/blob/master/LICENSE>

- ImageMagick

License terms available at <https://www.imagemagick.org/script/license.php>

- Net-snmp

License terms available at <http://www.net-snmp.org/about/license.html>

- CMU Flite

License terms available at [http://www.festvox.org/flite/doc/flite\\_2.html#Copying](http://www.festvox.org/flite/doc/flite_2.html#Copying)

- Curl

License terms available at <https://curl.haxx.se/docs/copyright.html>

- dhclient

License terms available at <https://www.isc.org/downloads/software-support-policy/isc-license/>

- CMU Flite

Copyright (c) 1998-2000 Thai Open Source Software Center Ltd and Clark Cooper

Copyright (c) 2001-2017 Expat maintainers



## Appendix A: Black Box Open Source Software License Disclaimer

---

Permission is hereby granted, free of charge, to any person obtaining a copy of this software and associated documentation files (the "Software"), to deal in the Software without restriction, including without limitation the rights to use, copy, modify, merge, publish, distribute, sublicense, and/or sell copies of the Software, and to permit persons to whom the Software is furnished to do so, subject to the following conditions:

The above copyright notice and this permission notice shall be included in all copies or substantial portions of the Software.

THE SOFTWARE IS PROVIDED "AS IS", WITHOUT WARRANTY OF ANY KIND, EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO THE WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE AND NONINFRINGEMENT. IN NO EVENT SHALL THE AUTHORS OR COPYRIGHT HOLDERS BE LIABLE FOR ANY CLAIM, DAMAGES OR OTHER LIABILITY, WHETHER IN AN ACTION OF CONTRACT, TORT OR OTHERWISE, ARISING FROM, OUT OF OR IN CONNECTION WITH THE SOFTWARE OR THE USE OR OTHER DEALINGS IN THE SOFTWARE

- netkit-ftp

Copyright (c) 1985, 1989 Regents of the University of California.

All rights reserved.

Redistribution and use in source and binary forms, with or without modification, are permitted provided that the following conditions are met:

1. Redistributions of source code must retain the above copyright notice, this list of conditions and the following disclaimer.
2. Redistributions in binary form must reproduce the above copyright notice, this list of conditions and the following disclaimer in the documentation and/or other materials provided with the distribution.
3. All advertising materials mentioning features or use of this software must display the following acknowledgement: This product includes software developed by the the University of California, Berkeley and its contributors.
4. Neither the name of the University nor the names of its contributors may be used to endorse or promote products derived from this software without specific prior written permission.

THIS SOFTWARE IS PROVIDED BY THE REGENTS AND CONTRIBUTORS "AS IS" AND ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE DISCLAIMED. IN NO EVENT SHALL THE REGENTS OR CONTRIBUTORS BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, SPECIAL, EXEMPLARY, OR CONSEQUENTIAL DAMAGES (INCLUDING, BUT NOT LIMITED TO, PROCUREMENT OF SUBSTITUTE GOODS OR SERVICES; LOSS OF USE, DATA, OR PROFITS; OR BUSINESS INTERRUPTION) HOWEVER CAUSED AND ON ANY THEORY OF LIABILITY, WHETHER IN CONTRACT, STRICT LIABILITY, OR TORT (INCLUDING NEGLIGENCE OR OTHERWISE) ARISING IN ANY WAY OUT OF THE USE OF THIS SOFTWARE, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGE.

- Openssl

License terms available at <https://www.openssl.org/source/license.html>

- portmap

Copyright (c) 2001-2004, BLFS Development Team

All rights reserved.

Redistribution and use in source and binary forms, with or without modification, are permitted provided that the following conditions are met:

Redistributions in any form must retain the above copyright notice, this list of conditions and the following disclaimer.

Neither the name of "Linux From Scratch" nor the names of its contributors may be used to endorse or promote products derived from this material without specific prior written permission.

Any material derived from Linux From Scratch must contain a reference to the "Linux From Scratch" project.

THIS SOFTWARE IS PROVIDED BY THE COPYRIGHT HOLDERS AND CONTRIBUTORS "AS IS" AND ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE DISCLAIMED. IN NO EVENT SHALL THE REGENTS OR CONTRIBUTORS BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, SPECIAL, EXEMPLARY, OR CONSEQUENTIAL DAMAGES (INCLUDING, BUT NOT LIMITED TO, PROCUREMENT OF SUBSTITUTE GOODS OR SERVICES; LOSS OF USE, DATA, OR PROFITS; OR BUSINESS INTERRUPTION) HOWEVER CAUSED AND ON ANY THEORY OF LIABILITY, WHETHER IN CONTRACT, STRICT LIABILITY, OR TORT (INCLUDING NEGLIGENCE OR OTHERWISE) ARISING IN ANY WAY OUT OF THE USE OF THIS SOFTWARE, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGE.

- zlib

zlib.h -- interface of the 'zlib' general purpose compression library

version 1.2.11, January 15th, 2017

Copyright (C) 1995-2017 Jean-loup Gailly and Mark Adler

This software is provided 'as-is', without any express or implied warranty. In no event will the authors be held liable for any damages arising from the use of this software.

Permission is granted to anyone to use this software for any purpose, including commercial applications, and to alter it and redistribute it freely, subject to the following restrictions:

1. The origin of this software must not be misrepresented; you must not claim that you wrote the original software. If you use this software in a product, an acknowledgment in the product documentation would be appreciated but is not required.
2. Altered source versions must be plainly marked as such, and must not be misrepresented as being the original software.
3. This notice may not be removed or altered from any source distribution.

Jean-loup Gailly      Mark Adler


jloup@gzip.org      madler@alumni.caltech.edu





**Black Box Tech Support: FREE! Live. 24/7.**

Tech support the  
way it should be.

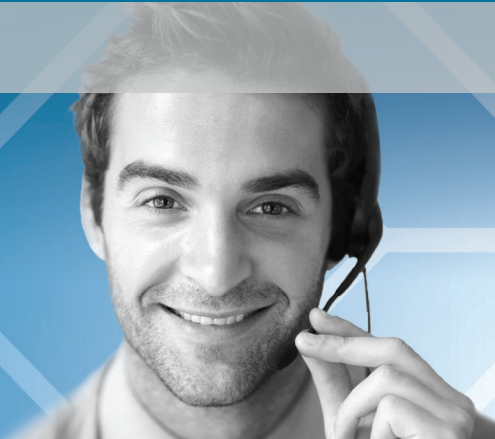

Great tech support is just 60 seconds away at 877-877-2269 or [blackbox.com](https://blackbox.com).



### About Black Box

Black Box Network Services is your source for an extensive range of networking and infrastructure products. You'll find everything from cabinets and racks and power and surge protection products to media converters and Ethernet switches all supported by free, live 24/7 Tech support available in 60 seconds or less.

© Copyright 2019. All rights reserved.